


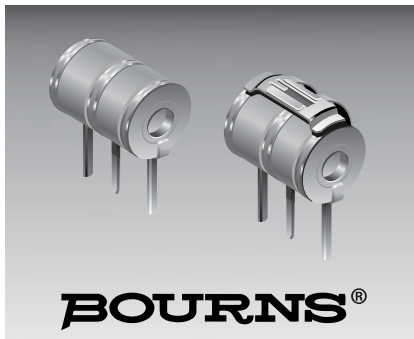

Features

- Balanced TRIGARD®
- 8 mm diameter, 11 mm long
- UL recognized
- Custom configurations available
- High surge current rating
- Stable breakdown throughout life

Applications

- Telecommunications
- Industrial electronics
- Commercial electronics
- Consumer electronics
- Automotive, aircraft, military electronics

2026 Series - 3-Pole Gas Discharge Tube

Characteristics

Test Methods per ITU-T (CCITT) K.12, IEEE C62.31, IEC 60384-14, Telcordia GR 1361

Characteristic	Model No.					
	2026-07	2026-09	2026-15	2026-20	2026-23	2026-25
DC Sparkover $\pm 20\%$ @ 100 V/s	75 V	90 V	150 V	200 V	230 V	250 V ¹
Impulse Sparkover						
100 V/ μ s	275 V	275 V	350 V	425 V	450 V	475 V
1000 V/ μ s	700 V	600 V	575 V	625 V	650 V	700 V

Characteristic	Model No.					
	2026-30	2026-35	2026-40	2026-42	2026-47	2026-60
DC Sparkover $\pm 20\%$ @ 100 V/s	300 V	350 V	400 V	420 V	470 V	600 V
Impulse Sparkover						
100 V/ μ s	550 V	625 V	675 V	725 V	800 V	925 V
1000 V/ μ s	775 V	875 V	925 V	1000 V	1100 V	1250 V

Impulse Transverse Delay	1000 V/ μ s	< 75 ns
Insulation Resistance	100 V (50 V for Model 2026-07 & 2026-09)	> $10^{10} \Omega$
Glow Voltage	10 mA	~ 70 V
Arc Voltage	1A	~ 10 V
Glow-Arc Transition Current		< 0.5 A
Capacitance	1 MHz	< 2 pF
DC Holdover Voltage ²	> 135 V, (52 V for Model 2026-07 & 2026-09, 80 V for Model 2026-15)	< 150 ms
Impulse Discharge Current	40000 A, 8/20 μ s ³	1 operation minimum
	20000 A, 8/20 μ s	> 10 operations
	1000 A, 10/1000 μ s	> 400 operations
Alternating Discharge Current	130 Arms, 11 cycles ³	1 operation minimum
	20 Arms, 1 s	> 10 operations
Operating Temperature		- 55 to +85 °C

Optional Switch-Grade Failsafe device available.

Notes:

- **UL recognized component, UL File E153537.**
- Model number marking on tube: 26-xxx V.
- The rated discharge current for TRIGARD® Gas Discharge Tubes is the total current equally divided between each line to ground.
- Sparkover limits after life $\pm 25\%$, IR $> 10^8 \Omega$ (-25 %, +30 % for Model 2026-07, 2026-09 and 2026-60).

¹ Tube meets BT requirement Type 14 A/1 (210-310 V).

² Network applied.


³ DC Sparkover may exceed $\pm 25\%$ after discharge, but will continue to protect without venting.

2026 Series - 3-Pole Gas Discharge Tube


BOURNS®

Product Dimensions


2026-XX-A

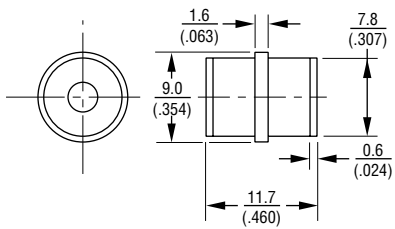


2026-XX-A1

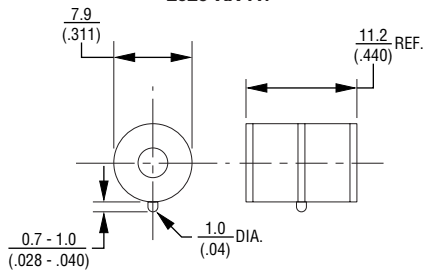


2026-XX-C2

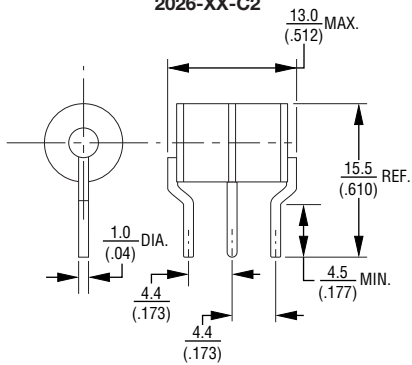


2026-XX-C3

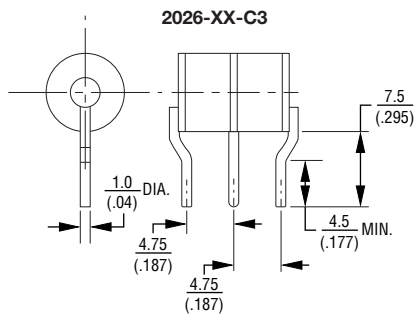


2026-XX-C8

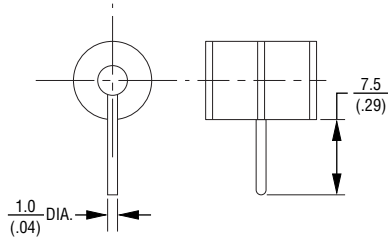


2026-XX-C13

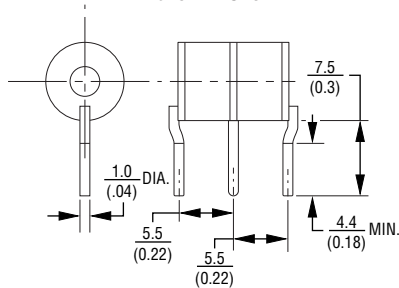


2026-XX-C14

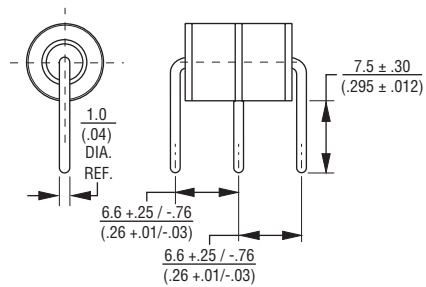


2026-XX-C18

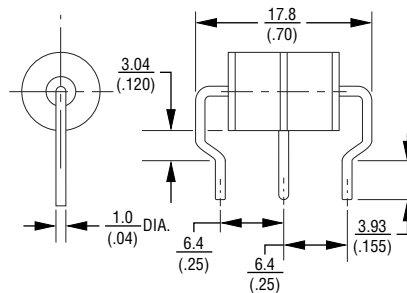

2026-XX-C — 1.0mm (0.040 in.) dia. lead wire
2026-XX-CB — 0.8mm (0.032 in.) dia. lead wire

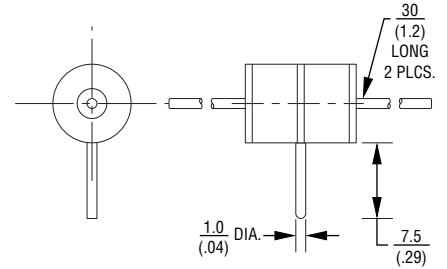

FAILSAFE CONFIGURATION
2026-XX-C2F SHOWN

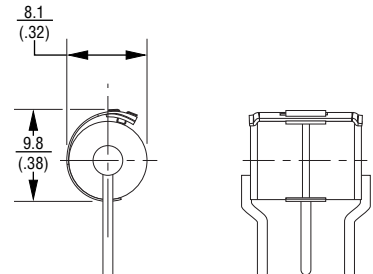


DIMENSIONS = $\frac{\text{MILLIMETERS}}{(\text{INCHES})}$

Specifications are subject to change without notice.
Customers should verify actual device performance in their specific applications.

2026 Series - 3-Pole Gas Discharge Tube

BOURNS®

Switch-Grade Failsafe Device Shorting Curve 2026-XX-XF

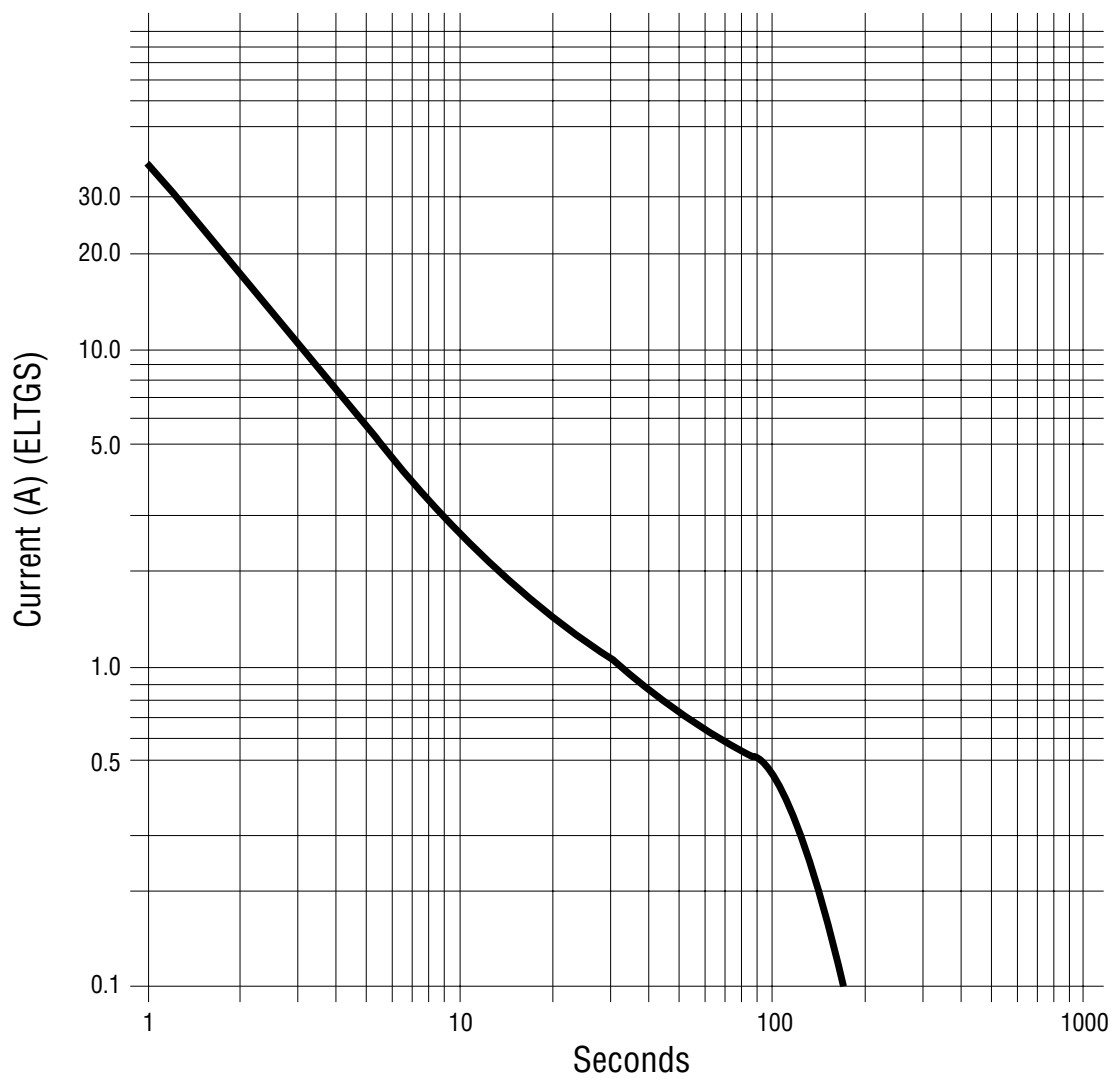

ELTGS = Each Line to Ground Simultaneously

NOTE: When using a GDT failsafe device, it is imperative that all components associated and connected to the GDT with failsafe be tested in their respective completely integrated environment (finished product) to assure desired operation.