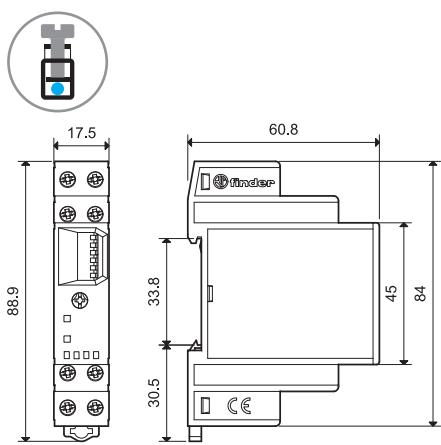


## Features

### Multi-function and multi-voltage timer

- One module 17.5 mm wide housing
- Seven functions (4 with supply start and 3 with control signal)
- Additional Reset function
- Six time ranges from 0.1s to 10h
- 35 mm rail (EN 60715) mounting

81.01  
Screw terminal




**81.01**




- Multi-voltage (DC non polarized)
- Multi-function
- 35 mm rail (EN 60715) mounting

**AI:** On-delay  
**DI:** Interval  
**SW:** Symmetrical flasher (starting pulse on)  
**SP:** Symmetrical flasher (starting pulse off)  
**BE:** Off-delay with control signal  
**DE:** Interval with control signal on  
**EEb:** Interval with control signal off



Wiring diagram  
(supply START)



Wiring diagram  
(control signal)

### Contact specification

Contact configuration	1 CO (SPDT)
Rated current/Maximum peak current A	16/30
Rated voltage/Maximum switching voltage V AC	250/400
Rated load AC1 VA	4,000
Rated load AC15 (230 V AC) VA	750
Single phase motor rating (230 V AC) kW	0.55
Breaking capacity DC1: 30/110/220 V A	16/0.3/0.12
Minimum switching load mW (V/mA)	500 (10/5)
Standard contact material	AgCdO

### Supply specification

Nominal voltage (U <sub>N</sub> )	V AC (50/60 Hz)	12...230
	V DC	12...230 (non polarized)
Rated power AC/DC	VA (50 Hz)/W	< 2 / < 2
Operating range	V AC	10.8...250
	V DC	10.8...250

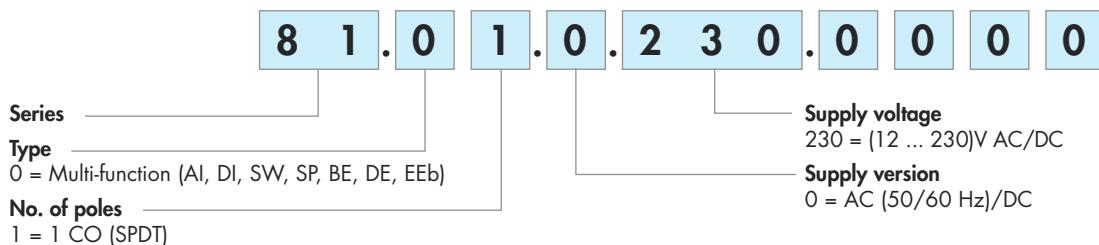
### Technical data

Specified time range	[0.1...1]s, [1...10]s, [10...60]s, [1...10]min, [10...60]min, [1...10]h	
Repeatability	%	± 1
Recovery time	ms	≤ 50
Minimum control impulse	ms	50
Setting accuracy-full range	%	± 5
Electrical life at rated load in AC1	cycles	100·10 <sup>3</sup>
Ambient temperature range	°C	-10...+50
Protection category		IP 20
Approvals (according to type)	  	

## 81 Series - Modular timers 16 A

## Ordering information

Example: 81 series, modular timer multi-voltage, 1 CO (SPDT) - 16 A, supply rated at (12...230)V AC/DC.



## Technical data

## EMC specifications

Type of test	Reference standard
Electrostatic discharge	EN 61000-4-2
contact discharge	4 kV
air discharge	EN 61000-4-2
8 kV	
Radio-frequency electromagnetic field (80 ÷ 1,000 MHz)	EN 61000-4-3
Fast transients (burst) (5-50 ns, 5 kHz) on Supply terminals	EN 61000-4-4
Surges (1.2/50 µs) on Supply terminals	EN 61000-4-5
common mode	4 kV
differential mode	EN 61000-4-5
4 kV	
Radio-frequency common mode (0.15 ÷ 80 MHz) on Supply terminals	EN 61000-4-6
Radiated and conducted emission	EN 55022
	class A

## Other data

Current absorption on signal control (B1)	< 1 mA (S-X)	< 1 mA (R-X)
Voltage potential on the input terminal R - X and S - X	Not galvanic separation from the supply voltage on A1 - A2	
Power lost to the environment	without contact current	W 1.3
	with rated current	W 3.2
	Screw torque	Nm 0.8
Max. wire size	solid cable	stranded cable
	mm <sup>2</sup> 1x6 / 2x4	1x4 / 2x2.5
	AWG 1x10 / 2x12	1x12 / 2x14

H




Time range  
setting

(0.1...1)s	(1...10)s	(10...60)s	(1...10)min	(10...60)min	(1...10)h
1	1	1	1	1	1
2	2	2	2	2	2
3	3	3	3	3	3
4	4	4	4	4	4
5	5	5	5	5	5
6	6	6	6	6	6

NOTE: time range and function must be set before energising the timer.

**Functions**

**U** = Supply voltage  
**S** = Signal switch  
**R** = Reset  
 = Output contact


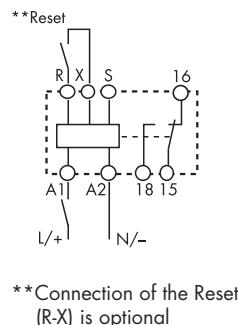
LED (green)	LED (red)	Supply voltage	NO output contact	Contacts	
		Open	Closed		
		OFF	Open	15 - 18	15 - 16
		ON	Open	15 - 18	15 - 16
		ON	Closed	15 - 16	15 - 18

Supply Start = Start via contact in supply line (A1).

Control signal = Start via contact into control terminal (X-S).

**Wiring diagram**


Supply START


**(A1) On-delay.**


Apply power to timer. Output contacts transfer after preset time has elapsed. Reset occurs when power is removed.


**(D1) Interval.**

Apply power to timer. Output contacts transfer immediately. After the preset time has elapsed, contacts reset.




**(SW) Symmetrical flasher (starting pulse on).**

Apply power to timer. Output contacts transfer immediately and cycle between ON and OFF for as long as power is applied. The ratio is 1:1 (time on = time off).



**(SP) Symmetrical flasher (starting pulse off).**

Apply power to timer. First transfer of contact occurs after preset time has elapsed. The timer now cycles between OFF and ON as long as power is applied. The ratio is 1:1 (time on = time off).


Control signal


**(B1) Off-delay with control signal.**

Power is permanently applied to the timer. The output contacts transfer immediately on closure of the Signal Switch (S). Opening the Signal Switch initiates the preset delay, after which time the output contacts reset.


**(D1b) Interval with control signal on.**

Power is permanently applied to the timer. On momentary or maintained closure of Signal Switch (S), the output contacts transfer, and remain so for the duration of the preset delay, after which they reset.


**(D2b) Interval with control signal off.**

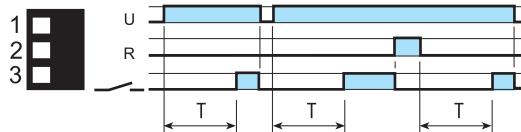
Power is permanently applied to the timer. On opening of the Signal Switch (S) the output contacts transfer, and remain so for the duration of the preset delay, after which they reset.

\* Terminals R, S & X must not be directly connected to the timer supply voltage, but they should be considered to be at supply voltage potential for the purposes of insulation.

\*\*Connection of the Reset (R-X) is optional

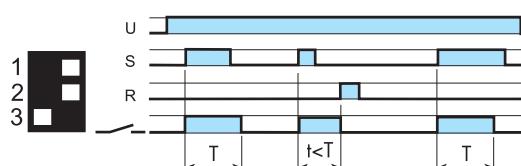
**RESET function (R)**

For each and every function and time range, the timer is immediately reset when the reset switch is closed.


**Example:**

Supply START; ON delay function

**Closing the external reset switch immediately resets the timer. Opening the reset switch re-initiates the timing function.**


**Example:**

Control signal; ON pulse function.

**Closing the external reset switch terminates the interval time and resets the timer. To re-start, it is necessary to open the reset switch, before closing the control signal contact.**

## 81 Series - Modular timers 16 A

### Accessories



019.01

**Identification tag**, for type 81.01, plastic, 1 tag, 17x25.5 mm

019.01



060.72

**Sheet of marker tags**, for type 81.01, plastic, 72 tags, 6x12 mm

060.72

H