

Specification Status: Released

Electrical Rating at 20°C

Rated Operating Voltage/ Interrupt Current:

240 V_{AC} /5.5 A_{RMS}
 240 V_{DC} /5.5 A_{DC}
 135 V_{AC}/20.0 A_{RMS}
 135 V_{DC}/20.0 A_{DC}

Max Interrupt Voltage: 265 V_{AC/DC} 5.5 A_{RMS}

Insulating Material :
 Cured, Flame Retardant Epoxy Polymer

Lead Material: 22 AWG Sn Plated Copper

Marking:

 Manufacturer's Mark and Voltage
 XX 240
 Part Identification
 L040
 Lot Identification (can be on back)
 00000

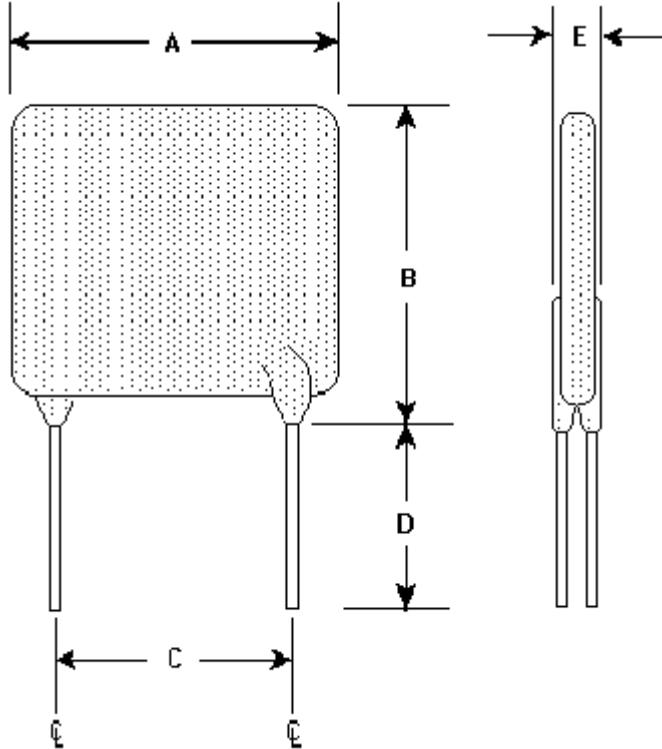


TABLE I. DIMENSIONS:

	A MIN	A MAX	B MIN	B MAX	C MIN	C MAX	D MIN	D MAX	E MIN	E MAX
mm:	--	11.5	--	19.5	4.3	5.8	7.6	--	--	3.8
in*:	--	(0.46)	--	(0.77)	(0.17)	(0.23)	(0.30)	--	--	(0.15)

*Rounded off approximation

TABLE II. PERFORMANCE RATINGS:

I _{HOLD} RATED CURRENT	CURRENT RATINGS		TIME TO TRIP	RESISTANCE		POST-TRIP RESISTANCE STANDARD TRIP	NOMINAL TRIPPED POWER DISSIPATION @ 265 V _{RMS}
AMPS AT 20°C HOLD	AMPS AT 20°C HOLD	AMPS AT 20°C TRIP	SECONDS AT 20°C, 2.0A MAX	OHMS AT 20°C MIN	OHMS AT 20°C MAX	OHMS AT 20°C MAX	WATTS AT 20°C
0.40	0.40	0.90	24.0	0.6	0.97	1.9	2.0

Recognitions:

UL, TUV, CSA, CQC.

Reference Documents:

PS300

Precedence:

This specification takes precedence over documents referenced herein.

Effectivity:

Reference documents shall be the issue in effect on the date of invitation for bid.

Warning:

Refer to Page 2 of this document for application limitations.

**WARNING****Warning: Application Limitations for the LVR Product Line**

1. Users should independently evaluate the suitability of and test each product selected for their own application.
2. This product should not be used in an application where the maximum interrupt voltage or maximum interrupt current can be exceeded in a fault condition. Operation beyond the maximum ratings or improper use may result in device damage and possible electrical arcing and flame.
3. A PTC device is not a fuse - it is a nonlinear thermistor that limits current. Because under a fault condition all PTC devices go into a high resistance state but not open circuit, hazardous voltage may be present at PTC locations.
4. The devices are intended for protection against occasional overcurrent or overtemperature fault conditions and should not be used when repeated fault conditions or prolonged trip events are anticipated.
5. In most applications, power must be removed and the fault condition cleared in order to reset a PTC device. However, under certain unusual conditions, a PTC device may automatically reset. Accordingly, PTC devices should not be used in an application where an automatic reset could create a safety hazard, such as garbage disposals and blenders.
6. It is the responsibility of the user to determine the need for back up or fail safe protection to prevent damage that may occur in the event of abnormal function or failure of the PTC device.
7. Operation in circuits with a large inductance can generate a circuit voltage (Ldi/dt) above the rated voltage of a PTC device.
8. Devices are not recommended for reflow soldering.
9. Device performance can be impacted negatively if devices are handled in a manner inconsistent with recommended electronic, thermal, or mechanical procedures for electronic components.
10. PTC devices are not recommended to be installed in applications where the device is constrained such that its PTC properties are inhibited, for example in rigid potting materials or in rigid housings which lack adequate clearance to accommodate device expansion.
11. Contamination of the PTC material with certain silicone-based oils or some aggressive solvents can adversely impact the performance of the devices.



PolySwitch®
PTC Devices
Overcurrent Protection Device

PRODUCT: LVR040S

DOCUMENT: SCD24906

REV LETTER: L

REV DATE: JULY 26, 2016

PAGE NO.: 3 OF 3

Information furnished is believed to be accurate and reliable. However, users should independently evaluate the suitability of and test each product selected for their own applications. Littelfuse products are not designed for, and shall not be used for, any purpose (including, without limitation, military, aerospace, medical, lifesaving, life-sustaining or nuclear facility applications, devices intended for surgical implant into the body, or any other application in which the failure or lack of desired operation of the product may result in personal injury, death, or property damage) other than those expressly set forth in applicable Littelfuse product documentation. Warranties granted by Littelfuse shall be deemed void for products used for any purpose not expressly set forth in applicable Littelfuse documentation. Littelfuse shall not be liable for any claims or damages arising out of products used in applications not expressly intended by Littelfuse as set forth in applicable Littelfuse documentation. The sale and use of Littelfuse products is subject to Littelfuse Terms and Conditions of Sale, unless otherwise agreed by Littelfuse.