

CONFIDENTIAL. THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE PROPERTY OF COOPER INDUSTRIES, INC. IT IS NOT FOR PUBLIC DISCLOSURE. POSSESSION OF THE INFORMATION DOES NOT CONVEY ANY RIGHT TO LOAN, SELL OR DISCLOSE THE INFORMATION. UNAUTHORIZED REPRODUCTION OR USE OF THE INFORMATION IS PROHIBITED. THIS DOCUMENT IS TO BE RETURNED TO COOPER INDUSTRIES, INC. UPON COMPLETION OF THE PURPOSE FOR WHICH IT IS LOANED OR UPON REQUEST.

COPYRIGHT Cooper Industries, Inc.
This is an unpublished work. The disclosure of this work is limited to select personnel. Further dissemination or disclosure to the public is PROHIBITED. This unpublished work is protected by Federal Copyright law and all rights thereunder are reserved by Cooper Industries, Inc.

SCALE

UNLESS OTHERWISE SPECIFIED
TOLERANCES TO BE:

METRIC $\pm 13\text{mm}$

INCHES $\pm .005''$

ANGULAR $\pm 2^\circ$

DATE

9-26-03

NO

KAX 1/2-30

TITLE

FUSE

SUP NO

KAX 1/2-30

DATED

3-27-80

DWG

JG

CK

CHANGE

D

ENG

SB03297

▲ (O) INDICATES CRITICAL DIMENSION
OR FEATURE

PAGE 1 OF 2

METRIC(mm)
INCHES

ⓓ REVISED &
REDRAWN

COOPER Bussmann

St. Louis, MO 63178


DISTRIBUTION

54144

56

J

CUSTOMER PRINT

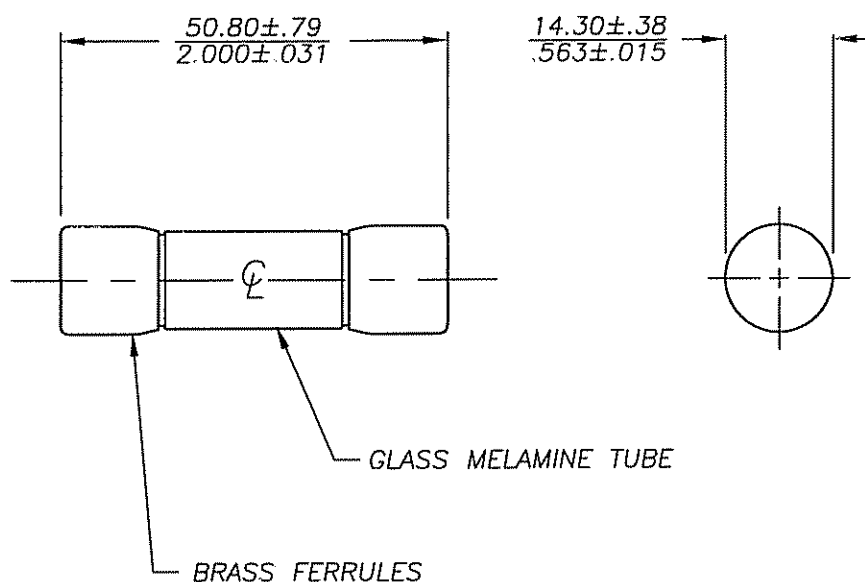


DESIGNED TO:

CARRY 100% OF RATING INDEFINITELY.


OPEN AT 120% AND 180% OF RATING WITHIN 1,000 SECONDS.

OPEN AT 250% OF RATING WITHIN 1 SECOND.

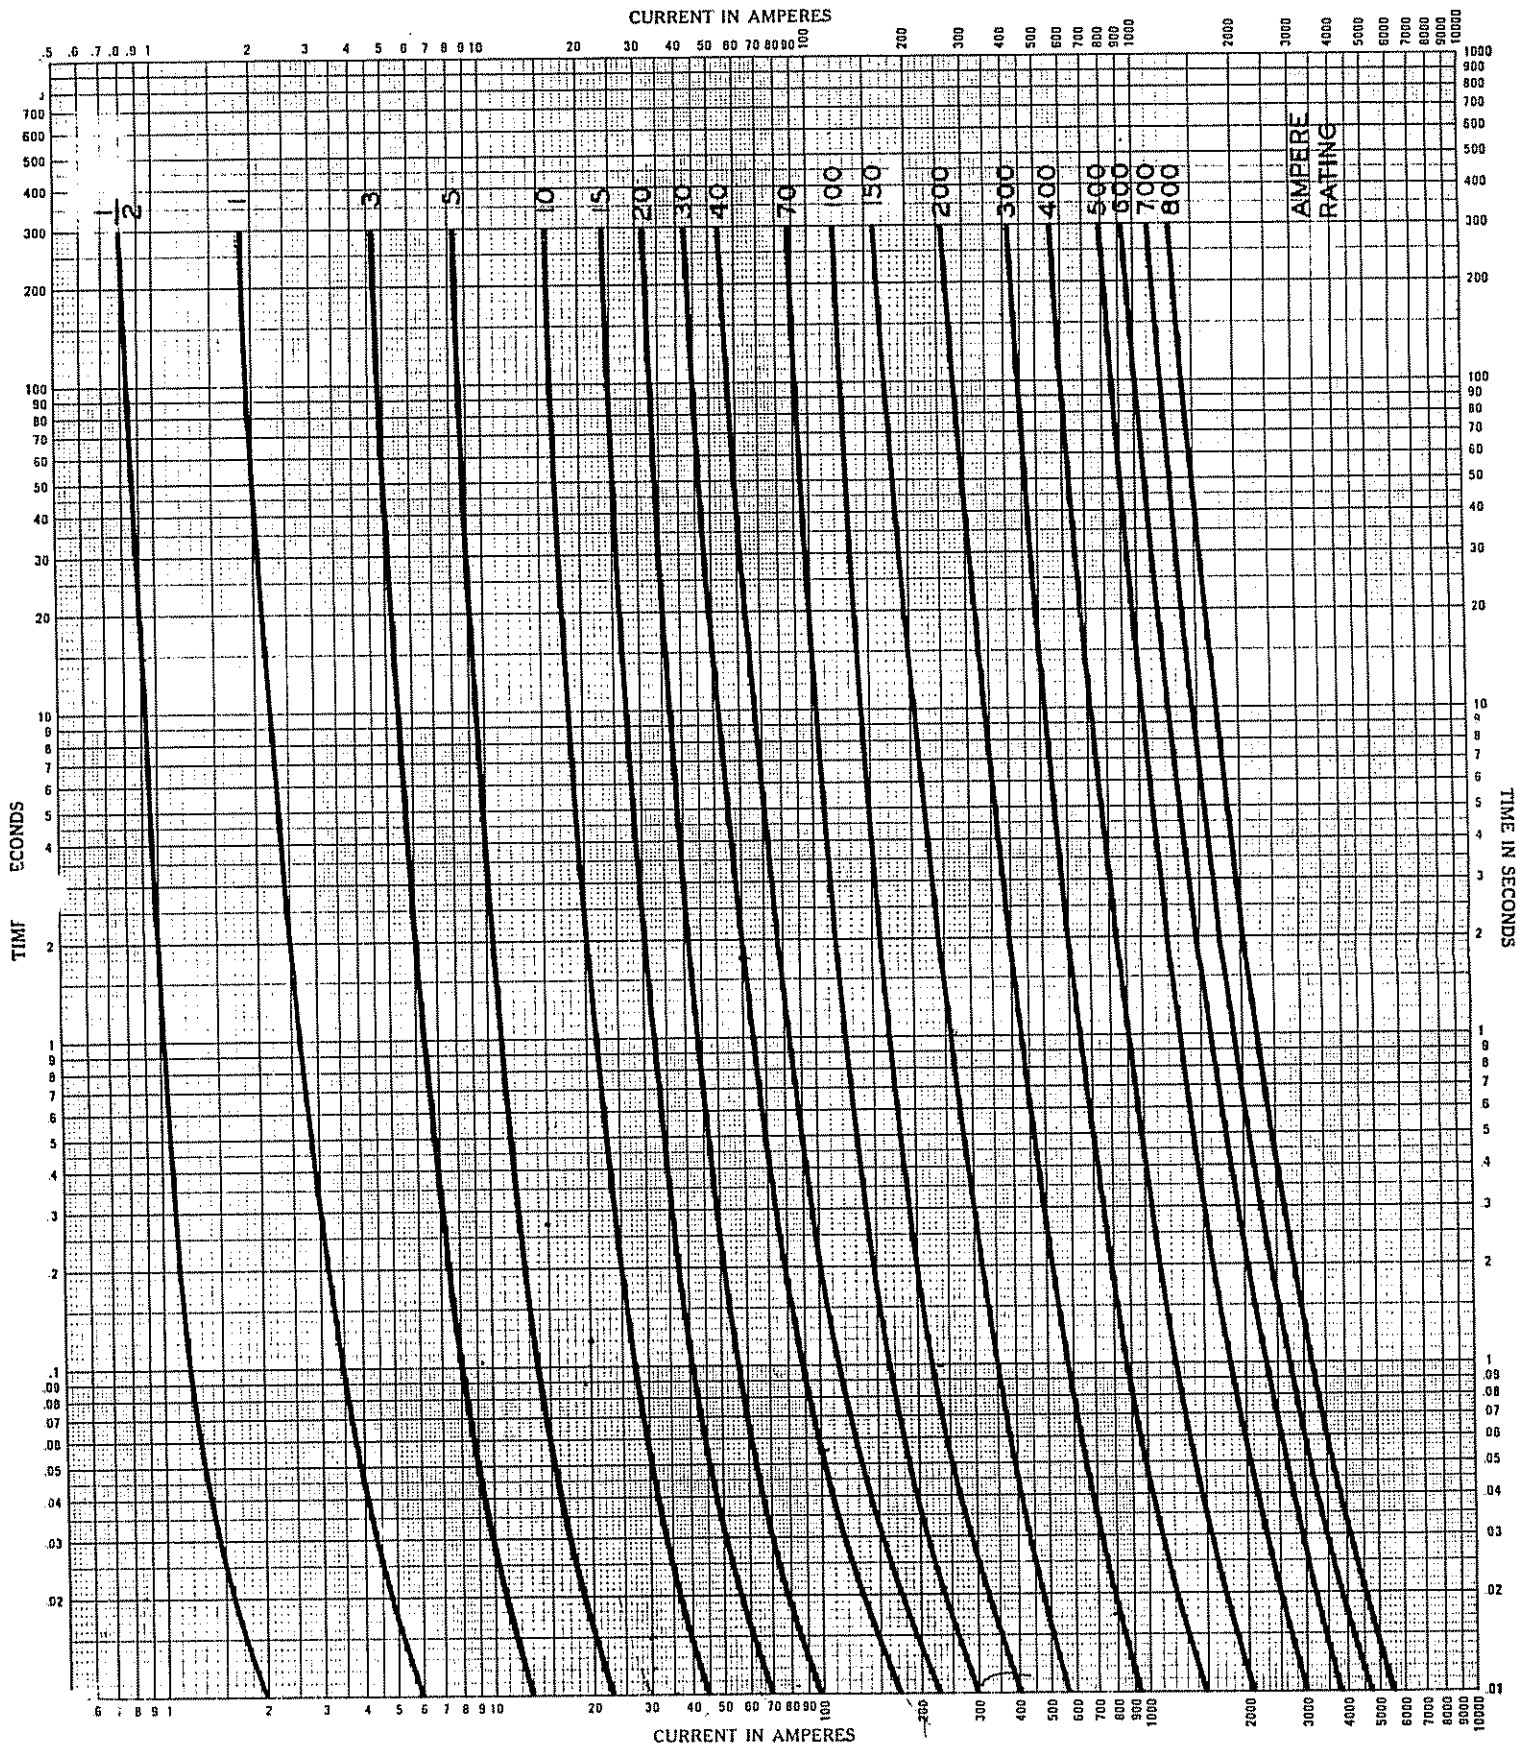

For KAX TRON		TOTAL CLEARING		TIME-CURRENT CHARACTERISTIC CURVES		BUSSMANN MFG. DIVISION	
BASIS FOR DATA Standards		Fuse Links		In		McGraw Edison Co. St. Louis, Mo. 63102	
1. Tests made at		Volts a-c at		p.f. Starting at 25C with no initial load		No 50685	
2. Curves are plotted to		Test points so variations should be				Date 8-16-75	

Type Fuse: KAX
 Test Voltage: 250 RMS
 Frequency: 60 Hz
 Power Factor: Between 40% - 60%
 Arcing Angle: Within 30° prior
 to normal frequency
 peak voltage

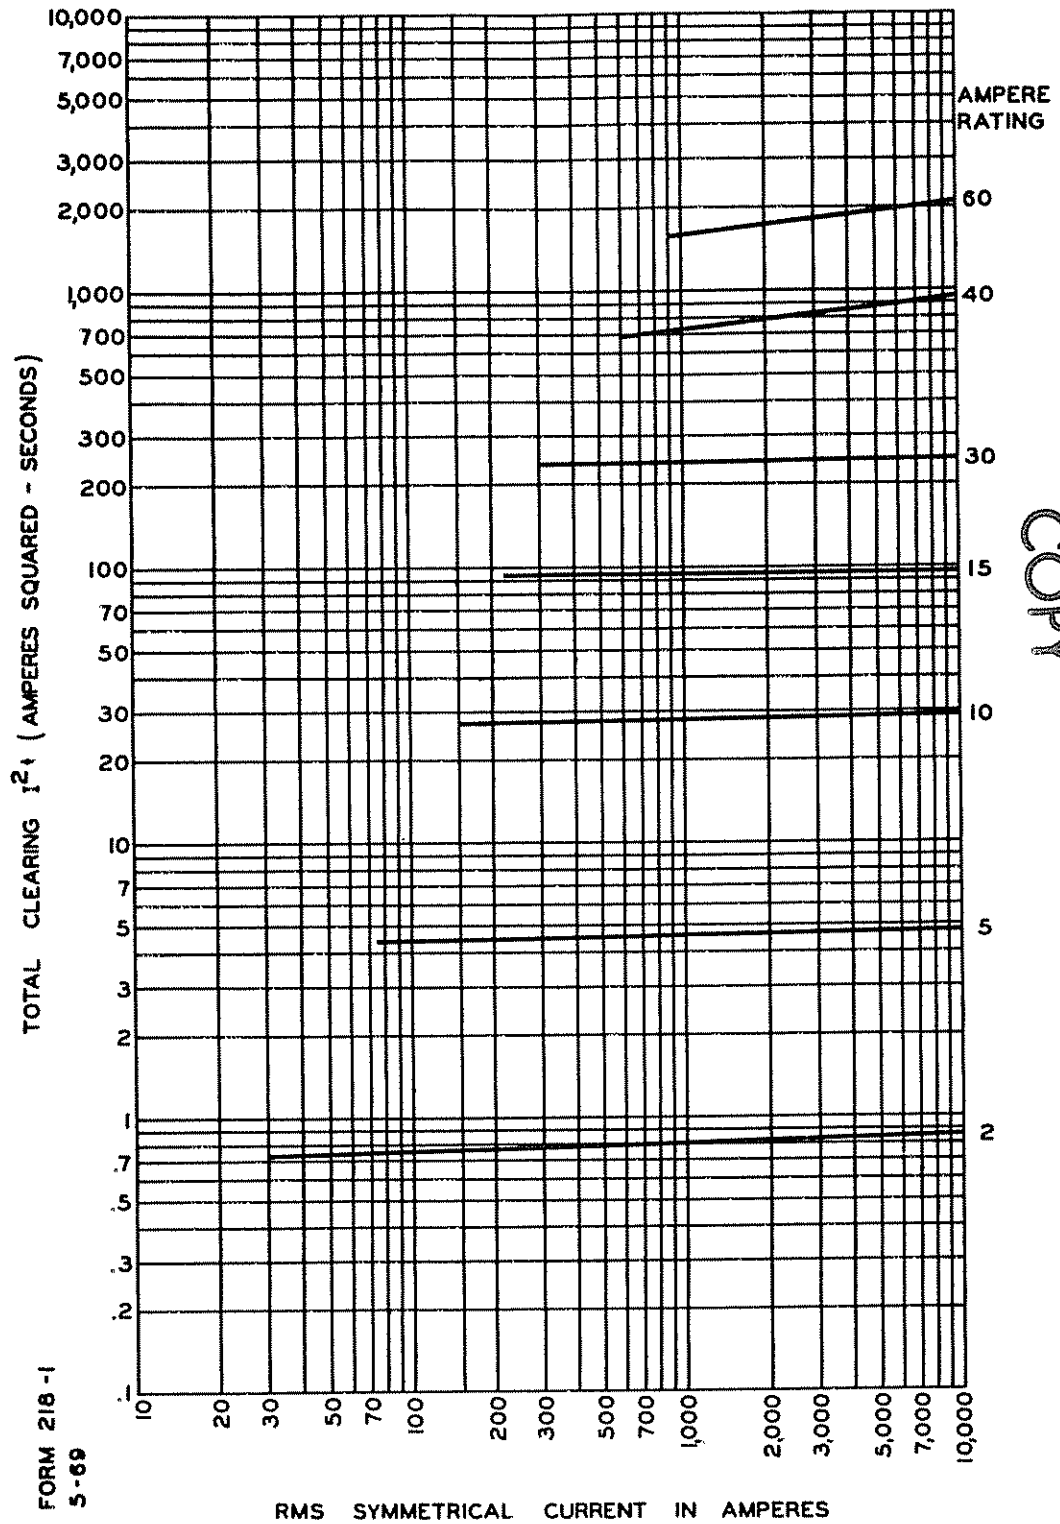

Total Clearing Ampere Squared Seconds
 vs.
 Available Fault Current