


YELLOW MV53173
HIGH EFFICIENCY GREEN MV54173
HIGH EFFICIENCY RED MV57173

PACKAGE DIMENSIONS

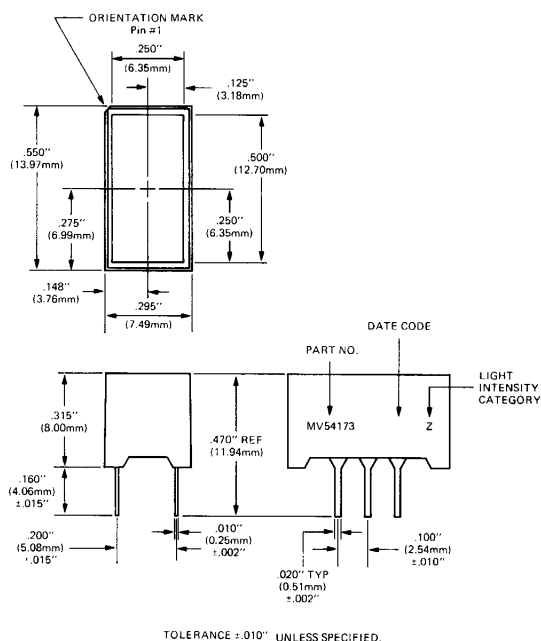

DESCRIPTION

The MV5X173 series is a large rectangular lamp which contains two LED chips with separate anodes and cathodes for each light. The illuminated area is 0.500-inches $\times$ 0.250-inches (12.7 mm $\times$ 6.35 mm).

FEATURES

- .500-inch $\times$.250-inch lighted area available in three colors
- Solid state reliability
- Fast switching—excellent for multiplexing
- Low power consumption
- Directly compatible with IC's
- Wide viewing angle
- .2 inch DIP lead spacing
- Mounting hardware available
- Categorized for Luminous Intensity (See Note 1)

APPLICATIONS

- Panel indicators
- Backlight legends
- Light arrays

ABSOLUTE MAXIMUM RATINGS

	MV53173	MV54173	MV57173
Power dissipation at 25°C	190 mW	200 mW	200 mW
Derate linearly from 50°C	−4.3 mW/°C	−4.5 mW/°C	−4.3 mW/°C
Storage temperature	−40°C to +100°C	−40°C to +100°C	−40°C to +100°C
Operating temperature	−40°C to +85°C	−40°C to +85°C	−40°C to +85°C
Continuous forward current per light (25°C)	20 mA	30 mA	35 mA
Peak forward current per LED chip (1 μ sec pulse width, 300 pps)	60 mA	90 mA	1.0 A
Lead soldering time at 260°C (See Notes 3 and 5)	5 sec.	5 sec.	5 sec.

PARAMETER	TEST CONDITIONS	MV53173	MV54173	MV57173	UNITS
Forward voltage (V _F)					
Typ.	I _F =20 mA	2.0	2.2	2.0	V
Max.	I _F =20 mA	2.5	3.0	2.5	V
Luminous Intensity					
Min. (See Note 1)	I _F =20 mA	4.5	4.5	4.5	mcd
Peak wavelength					
Typ.	I _F =20 mA	585	562	635	nm
Spectral line half width	I _F =20 mA	45	30	45	nm
Capacitance					
Typ.	V=0, f=1 MHz	35	20	35	pF
Reverse voltage (V _R)					
Min.	I _R =100μA	5	5	5	V
Typ.	I _R =100μA	25	50	25	V
Viewing angle (total)		120	120	120	degrees

	MV53173	MV54173	MV57173
Thermal resistance junction to free air θ_{JA}	160°C/W	160°C/W	160°C/W
Wavelength temperature coefficient (case temp.)	1.0 Å/°C	1.0 Å/°C	1.0 Å/°C
Forward voltage temperature coefficient	-1.5 mV/°C	-1.4 mV/°C	-2.0 mV/°C

PIN NO.	ELECTRICAL CONNECTIONS
1	Cathode 1
2	No Pin
3	Anode 2
4	Cathode 2
5	NC
6	Anode 1

For optimum ON and OFF contrast, one of the following filters or equivalents may be used over the lamp:







MV57173
Panelgraphic Red 60
Homalite 100—1605

In situations of high ambient light, a neutral density filter can be used to achieve greater contrast:

Panelgraphic Grey 10
Panelgraphic Grey 10
Homalite 100—1266 Grey

1. The average Luminous Intensity is obtained by summing the Luminous Intensity of each segment and dividing by the total number of segments. The standard of measurement is the Photo Research Corp. "Spectra" Microcandela Meter (Model IV-D) corrected for wavelength. Intensity will not vary more than $\pm 33.3\%$ between all segments within a unit.
2. Leads immersed to 1/16 inch (1.6 mm) from the body of the device. Maximum unit surface temperature is 140°C.
3. All units are categorized for Luminous Intensity. The Intensity category is marked on each part as a suffix letter to the part number.
4. For flux removal, Freon TF, Freon TE, Isopropanol or water may be used to their boiling points.

TYPICAL CURVES (Per LED Chip Unless Indicated) (25°C Free Air Temperature)

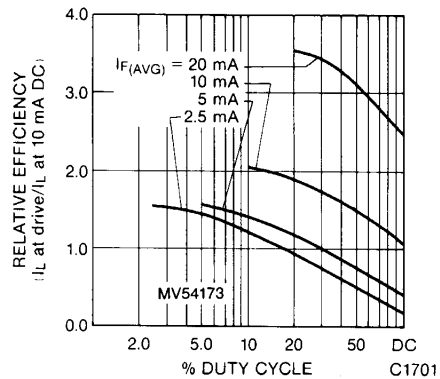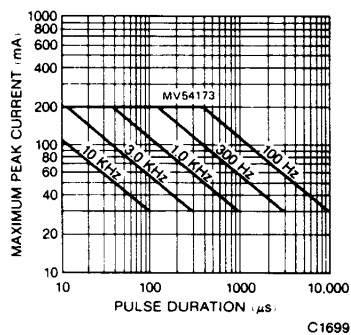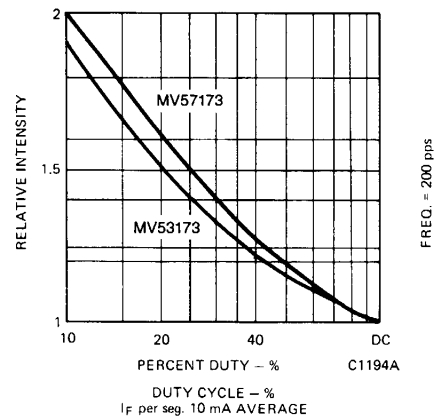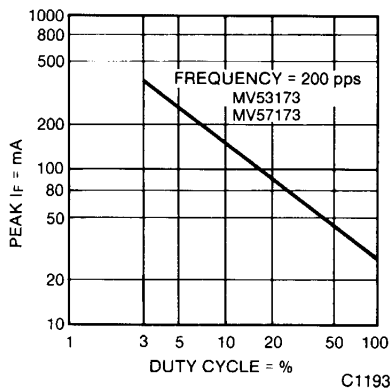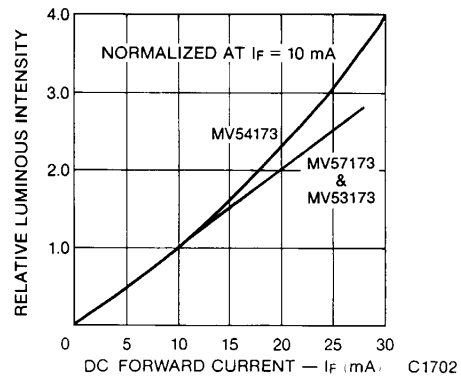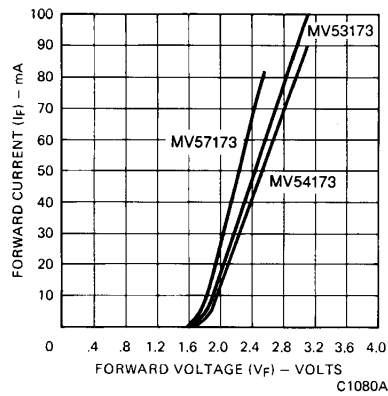

DISCLAIMER

FAIRCHILD SEMICONDUCTOR RESERVES THE RIGHT TO MAKE CHANGES WITHOUT FURTHER NOTICE TO ANY PRODUCTS HEREIN TO IMPROVE RELIABILITY, FUNCTION OR DESIGN. FAIRCHILD DOES NOT ASSUME ANY LIABILITY ARISING OUT OF THE APPLICATION OR USE OF ANY PRODUCT OR CIRCUIT DESCRIBED HEREIN; NEITHER DOES IT CONVEY ANY LICENSE UNDER ITS PATENT RIGHTS, NOR THE RIGHTS OF OTHERS.

LIFE SUPPORT POLICY

FAIRCHILD'S PRODUCTS ARE NOT AUTHORIZED FOR USE AS CRITICAL COMPONENTS IN LIFE SUPPORT DEVICES OR SYSTEMS WITHOUT THE EXPRESS WRITTEN APPROVAL OF THE PRESIDENT OF FAIRCHILD SEMICONDUCTOR CORPORATION. As used herein:

1. Life support devices or systems are devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when properly used in accordance with instructions for use provided in the labeling, can be reasonably expected to result in a significant injury of the user.
2. A critical component in any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.