


695 300 55 695 200 55 695 000 55



695 310 55 695 210 55 695 010 55

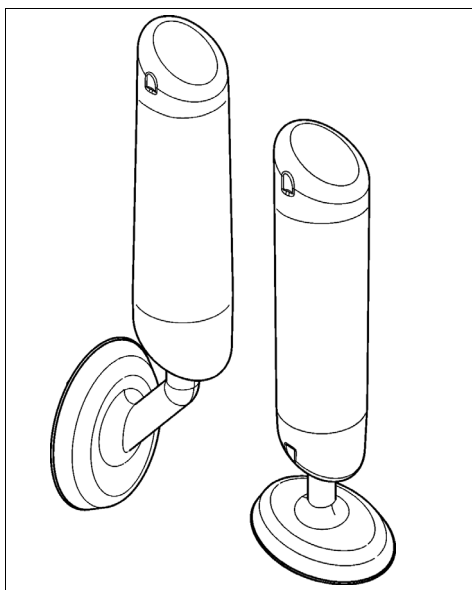


310.695.001.0113

© D



- (D) Anschluss **ausschließlich** durch ausgebildete Elektro-Fachkräfte.
- (GB) Electrical connection is to be made by trained electrical specialists **only**.
- (F) Le branchement doit **uniquement** être effectué par des professionnels.
- (I) Il collegamento deve essere eseguito **solo** da elettricisti specializzati.
- (E) La conexión **sólo** debe ser realizada por electricistas debidamente formados.
- (PT) A ligação deve ser feita **exclusivamente** por profissional eléctrico especializado.
- (NL) De aansluiting mag **enkel** gebeuren door erkende vakmensen.
- (CZ) Připojení smí **provádět** pouze kvalifikovaný personál.
- (PL) Podłączenie **wyłącznie** przez specjalistów-elektryków.
- (FI) Liittäminen kuuluu **ainoastaan** koulutettujen sähköalan ammattilaisten tehtäviin.
- (RUS) Подключение проводится только специалистом-электриком.
- (TR) Bağlantı **sadece** eğitimli elektrik teknisyenleri tarafından yapılmalıdır.
- (CN) 布线需由专业电工执行

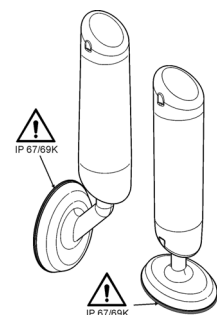


100% Isopropanol


- (D) Reinigung mit Alkohol-Lösungen in höher Konzentration sollte vermieden werden.
- (GB) Cleaning with highly concentrated alcohol solutions should be avoided.
- (F) Le nettoyage avec une solution alcoolisée à concentration élevée doit être évité.



|            |                                  |
|------------|----------------------------------|
| 695 300 55 | 24 V=, 3 x ≤120 mA + 1 x ≤ 20 mA |
| 695 200 55 | 24 V=, ≤ 240 mA + 1 x ≤ 20 mA    |
| 695 000 55 | 24 V=, ≤ 250 mA + 1 x ≤ 20 mA    |
| 695 310 55 | 24 V=, 3 x ≤120 mA + 1 x ≤ 20 mA |
| 695 210 55 | 24 V=, ≤ 240 mA + 1 x ≤ 20 mA    |
| 695 010 55 | 24 V=, ≤ 250 mA + 1 x ≤ 20 mA    |

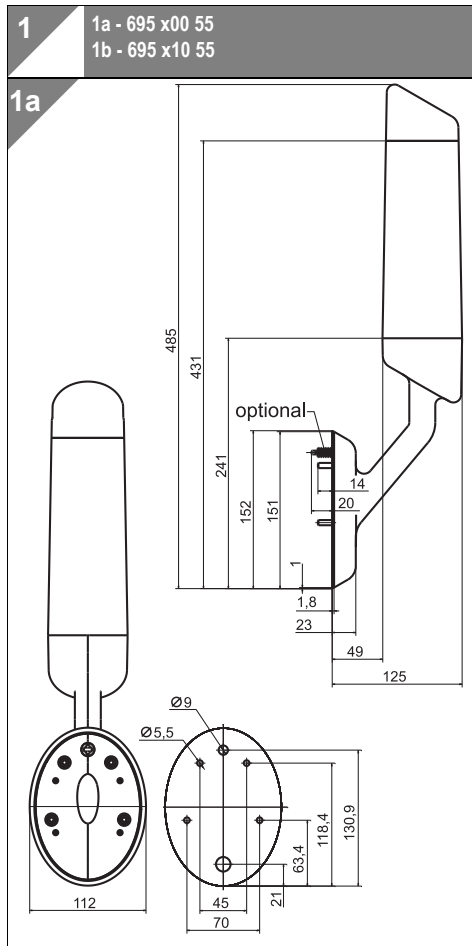








1b

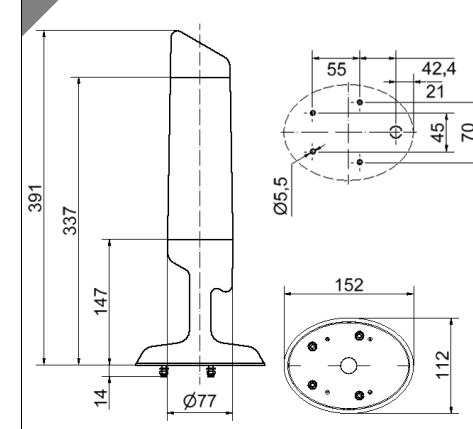

2


2a - 695 x00 55  
2b - 695 x10 55

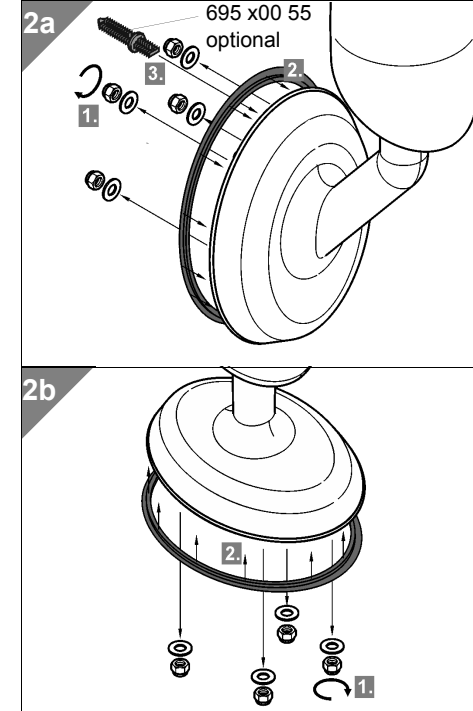

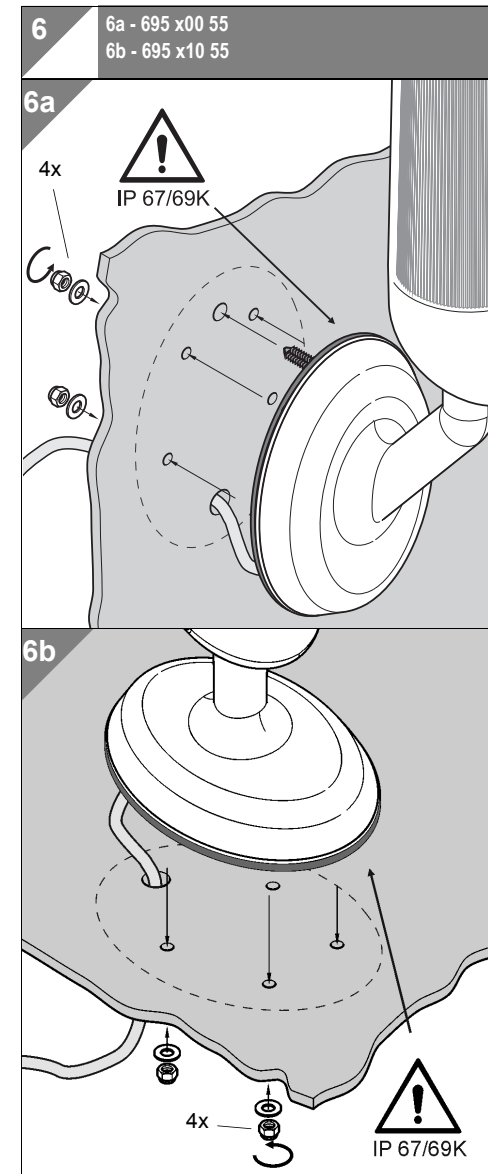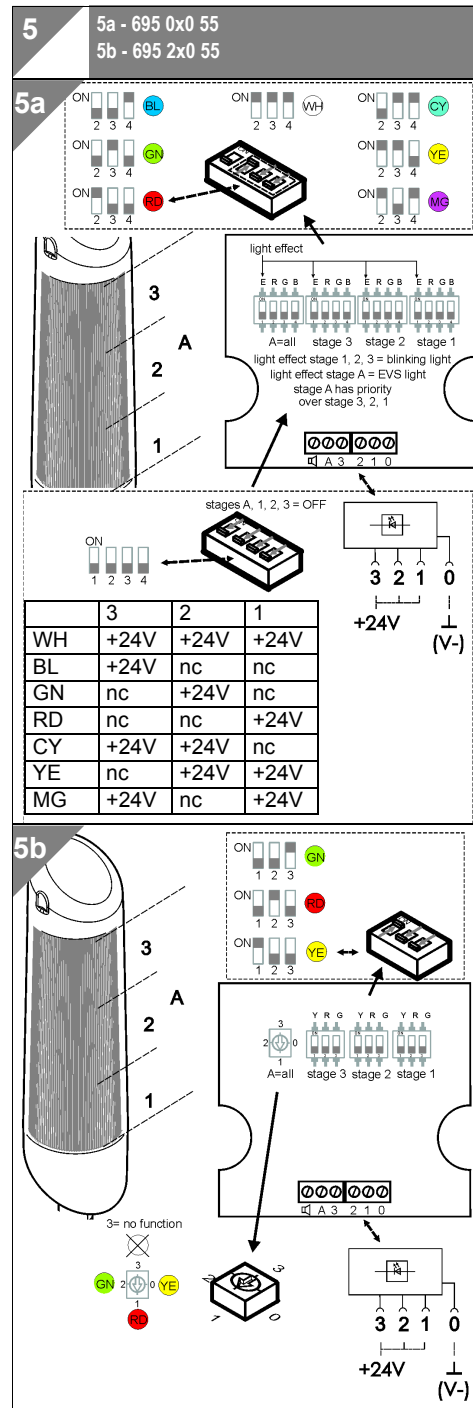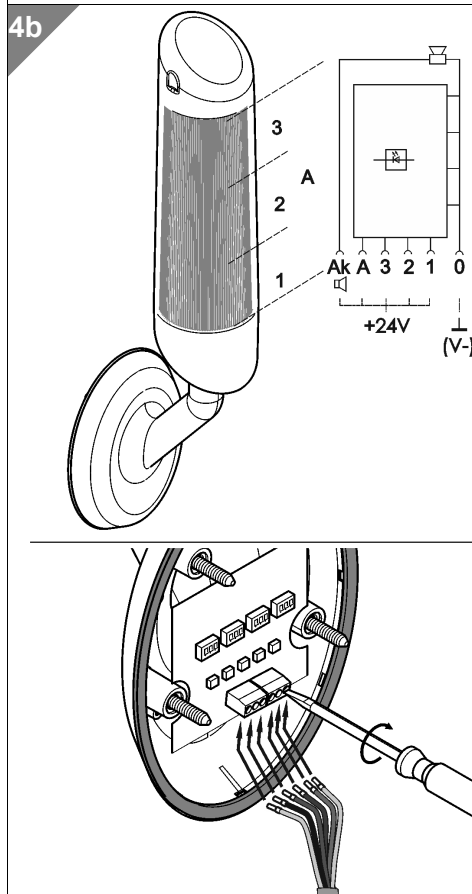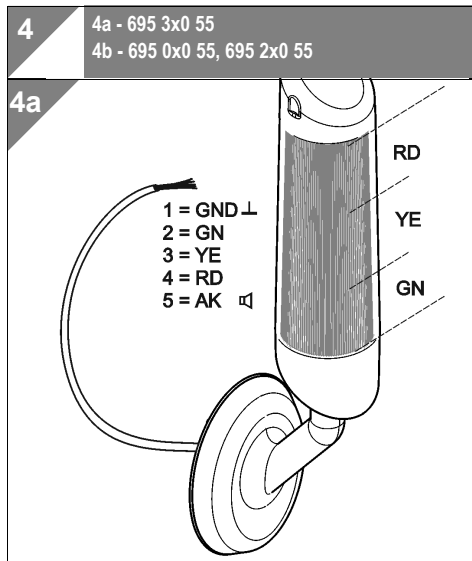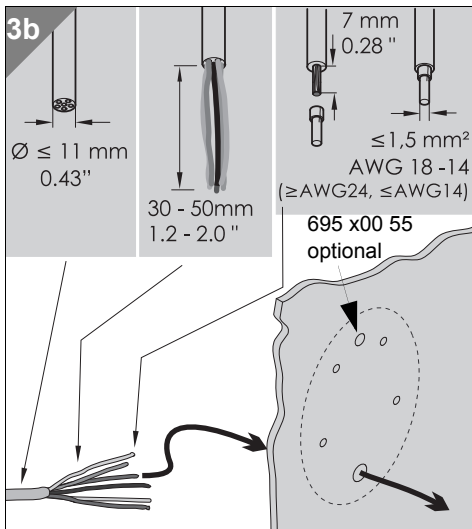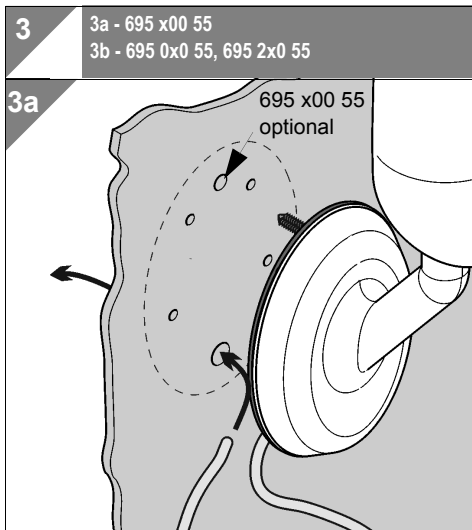

310.695.001.0113

© D

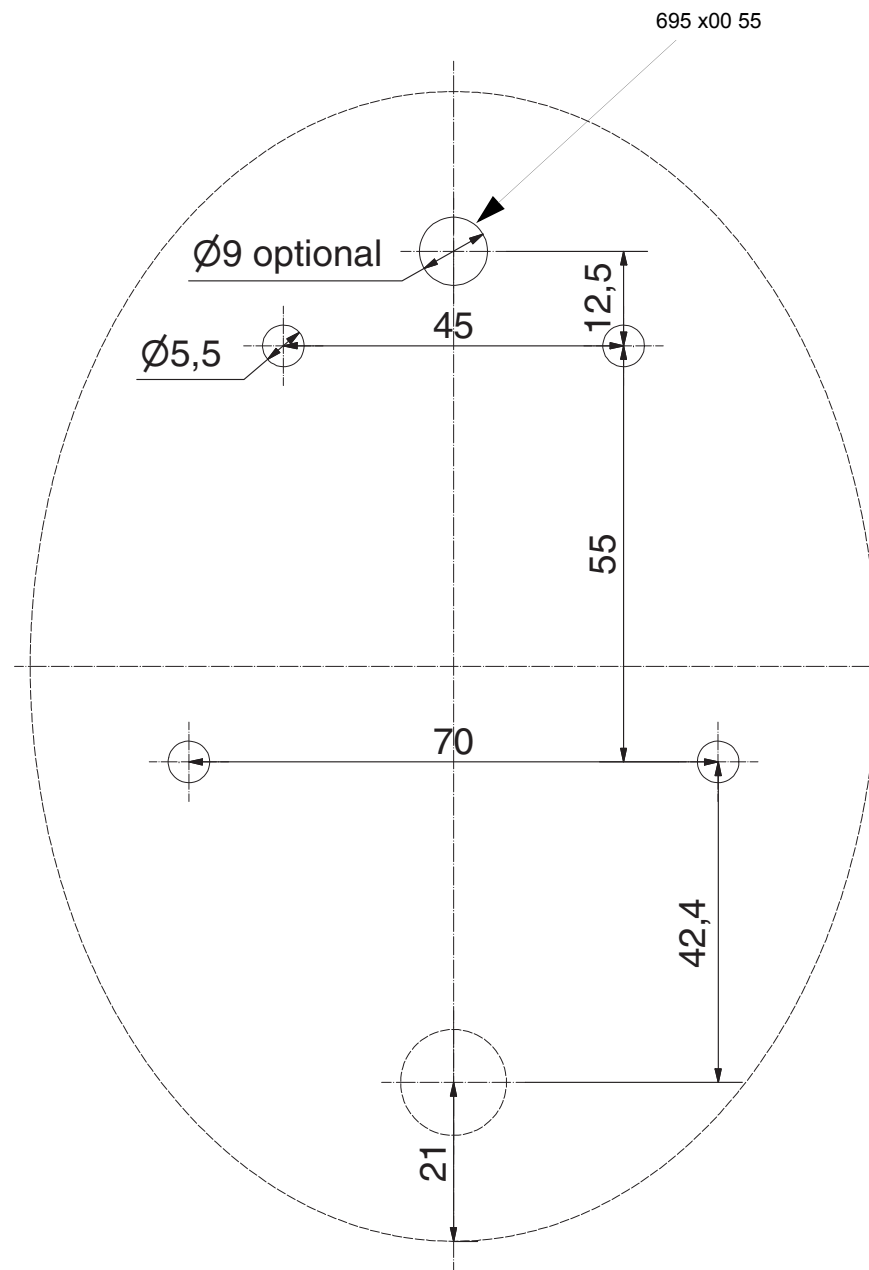

310.695.001.0113

© D