

DIRIS ° A40



Electrical Test Equipment

Product presentation



1. Backlit LDC screen
2. Pushbutton for currents and setup wiring correction
3. Pushbutton for voltages and frequency
4. Pushbutton for active, reactive, apparent power and power factor
5. Pushbutton for maximal and average current and power values
6. Pushbutton for harmonics values
7. Pushbutton for energies and hour run meter

Using electrical parameters means using several analog or digital single-function products such as ammeters, voltmeters or watt meters.

DIRIS A40 and A41, with its six direct access keys and LCD displays, helps you use all the parameters in an LV or HV installation .

These parameters can be centralized on a PC or PLC through an RS 485 link using JBUS/MODBUS ° or PROFIBUS ° DP protocol . The unit is designed so that the installer can easily fit the DIRIS A40 or A41 to the door of a cabinet . To facilitate and optimize the operator's work, the DIRIS A40 and A41 uses one of the most functional principles for integrating communications, metering, harmonics, analog outputs or alarm relays. Simply fit a module to the rear of the casing to add a function .

In addition, DIRIS A40 has a function for correcting connection errors .

DIRIS ° A40



Select a DIRIS°

Auxiliary power supply Us	Catalog number
110 ... 400 VAC / 120 ... 350 VDC (Product Limits)	4825 0A40
110 ... 240 VAC / 120 ... 250 VDC (UL Approved)	

Optional functions



Select a module


Description	Catalog number
Pulse output	4825 0090
2 configurable outputs impulses (type, weight and duration) for +/- kWh, +/- kvarh and KVAh	4825 0091
Pulse output + harmonics	
2 configurable outputs impulses (type, weight and duration) for +/- kWh, +/- kvarh and KVAh	4825 0092
Harmonic analysis by row up to 25 and by phase for 3I, In, 3V and 3U	
Communication: RS 485 JBUS/MODBUS	4825 0093
RS 485 link with JBUS/MODBUS protocol (speed up to 38 400 bauds)	
Analog outputs	4825 0094
2 configurable outputs on 3I, In, 3V, 3U, F, +/- ΣP, +/-ΣQ, ΣS and ΣPF ^{L/C}	
2 modules may be installed, for 4 analog outputs max	4825 0096
2 inputs – 2 outputs	
2 to 6 outputs for monitoring 3I, In, 3V, 3U, F, +/- ΣP, +/-ΣQ, ΣS and ΣPF ^{L/C} , THD 3I, THD In, THD 3V, THD 3U and hours run or remove control	4825 0097
Communication PROFIBUS ° DP	
1 module RS 485 and 1 module protocol PROFIBUS ° DP (speed up to 1 .5 Mbauds)	4825 0097
Memory	
Storing P+, P-, Q+, Q- values with internal/external synchronisation signal (5, 8, 10, 15, 20 and 30 minutes during 31 and 62 days)	4825 0097
Storing last 10 time-stamped alarms	
Storing min/max instantaneous values for 3I, In, 3V, 3U, F, +/- ΣP, +/-ΣQ, ΣS, THD 3U, THD 3V, THD 3I, THDIn	4825 0097
Storing last 10 time-stamped voltage dips, surges and outage (EN 50 160)	
Storing average values according to synchronisation signal for 3U, 3V and F	4825 0097

Technical characteristics

Current measurement on inputs (TRMS)	
CT primary	10 000 A
CT secondary	1 and 5 A
Measurement range	0 ... 11 kA
Input consumption	≤ 0.1 VA
Measurement updating period	1 s
Accuracy	0.2 %
Sustained overload	6 A
Intermittent overload	10 In for 1 s
Impulse withstand voltage	4 kV
Voltage measurement (TRMS)	
Direct measurement between phases	18 ... 500 VAC
VT primary	500 000 VAC
VT secondary	60, 100, 110, 115, 120, 173, 190 VAC
Frequency	50 / 60 Hz
Input consumption	≤ 0.1 VA
Measurement updating period	1 s
Accuracy	0.2 %
Sustained overload	760 VAC
Current-voltage product	
Limitation for 1A CT	10 000 000
Limitation for 5A CT	10 000 000
Power measurement	
Measurement updating period	1 s
Accuracy	0.5 %
Power factor measurement	
Measurement updating period	1 s
Accuracy	0.5 %
Frequency measurement	
Measurement range	45 ... 65 Hz
Measurement updating period	1 s
Accuracy	0.1 %
Energy accuracy	
Active (according to IEC 62053-22)	Class 0.5 S
Reactive (according to IEC 62053-23)	Class 2

Auxiliary power supply	
AC voltage	110 ... 400 VAC
AC tolerance	± 10 %
DC voltage	120 ... 350 VDC / 12 ... 48 VDC
DC tolerance	± 20 % / - 6 ... + 20 %
Frequency	50 / 60 Hz
Consumption	≤ 10 VA
Inputs	
Number	2 ... 6
Power supply	10 ... 30 VDC
Minimum signal width	10 ms
Minimum length between 2 impulses	18 ms
Type	phototransistor
Outputs (alarms / control)	
Number of relays	2 ... 6
Type	230 VAC - 6 A - 1 150 VA
Outputs (pulsed)	
Number of relays	2
Type	100 VDC - 0.5 A - 10 VA
Max. number of operations	≤ 10 ⁸
Outputs (analog)	
Number of outputs	2 ... 4
Type	isolated
Range	0 / 4 ... 20 mA
Charging resistance	600 Ω
Maximum current	30 mA
Communication	
Link	RS485
Type	2 ... 3 wires half duplex
Protocol	JBUS / MODBUS [®] in RTU mode
JBUS / MODBUS [®] speed	1400 ... 38400 bauds
Protocol	PROFIBUS [®] DP
PROFIBUS [®] DP speed	9.8 kbauds ... 1.5 Mbauds
Operating conditions	
Operating temperature	- 10 ... + 55 °C
Storage temperature	- 20 ... + 85 °C
Relative humidity	95 %


Dimensions (in / mm)

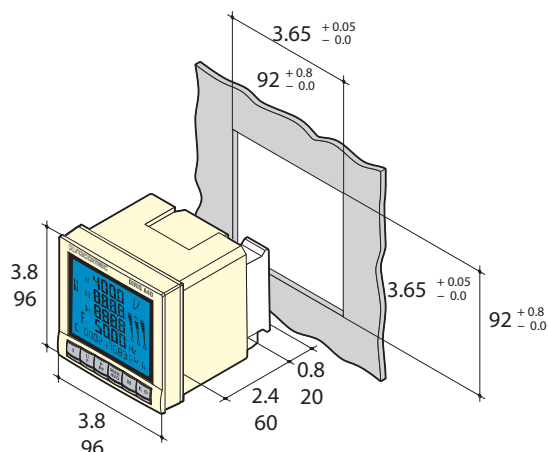

Type	panel mounting
Dimensions H x W x D	96 x 96 x 60 mm
Case protection rating	IP 30
Front protection rating	IP 52
Display type	LCD
Terminal block type	fixed or pull-out
Voltage and other connection section	0.2 ... 2.5 mm ²
Current connection section	0.5 ... 6 mm ²
Weight	400 g


Terminal blocks

DIRIS A40

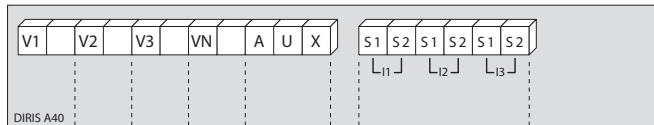


S1 - S2: current inputs
AUX: auxiliary power supply U_s
V1, V2, V3 & VN: voltage inputs

Communication module




RS485 link
R = termination resistance

Metering module




1 - 2: pulse output no . 1
3 - 4: pulse output no . 2

Analog output module




5 - 6: analog output n° 1
7 - 8: analog output n° 2

2 inputs / 2 outputs module



9 - 10: relay output no . 1
11 - 12: relay output no . 2
13 - 14: opto input no . 1
15 - 16: opto input no . 2

Memory module



17 - 18: synchronization input



**Electrical Test
Equipment**

Hoyt Electrical Instrument Works Inc

23 Meter St Penacook NH 03303

T: 800-258-3652 F: 603-753-9592


www.hoytmeter.com

Connections

Recommendation: when disconnecting the DIRIS, the secondaries of each current transformer must be short-circuited. This operation can be carried out automatically from a product in the Disconnect Switch catalog, PTI, please consult us.


Low voltage balanced network

- 3/4 wires with 1 CT

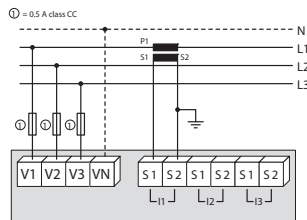


The use of 1 CT reduces by 0.5 % the accuracy of the phase whose current is determined by vector calculation.

- Single phase

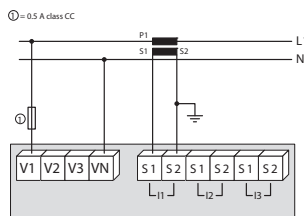


- Two phases

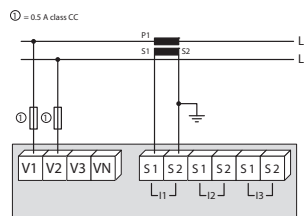


Low voltage unbalanced network

- 3/4 wires with 3 CTs

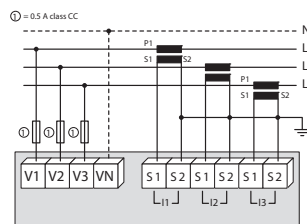


- 3 wires with 2 CTs

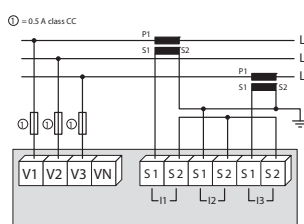

The use of 2 CTs reduces by 0.5 % the accuracy of the phase whose current is determined by vector calculation.


- 3 wires with 2 CTs

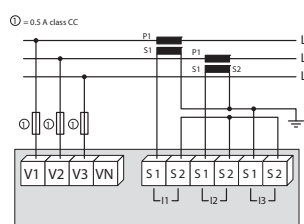


The use of 2 CTs reduces by 0.5 % the accuracy of the phase whose current is determined by vector calculation.

Other information


- Communication via RS485 link



- Voltage transformer connection for HV networks



- AC or DC voltage auxiliary power supply



It is recommended that the auxiliary power supply be protected by the use of 0.5 A class CC fuses.



Electrical Test Equipment