


Dimensions


• LT4H digital timer

(units: mm inch)
Tolerance: $\pm 1.0 \pm .039$

Screw terminal type
(Flush mount)

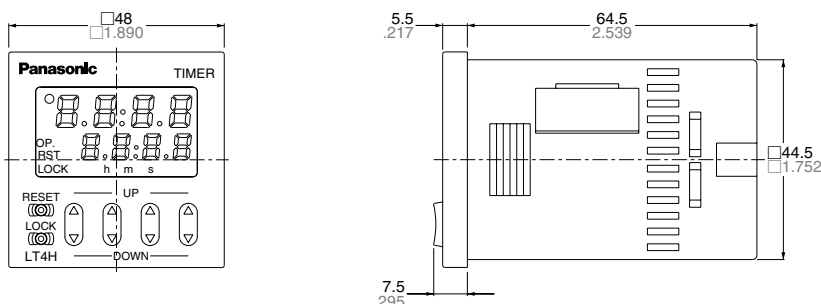


Pin type
(Flush mount/Surface mount)

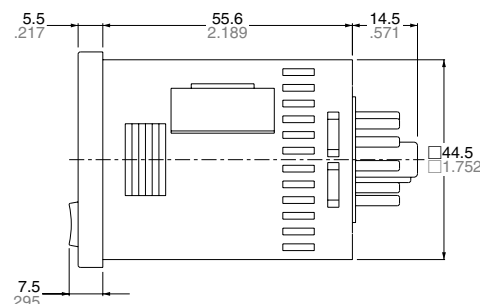


• Dimensions for embedded installation (with adapter installed)


Screw terminal type

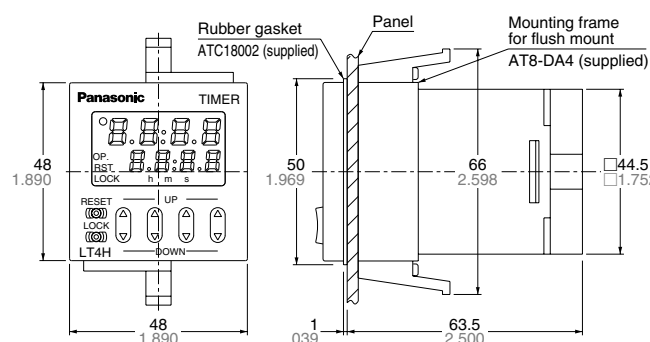

Pin type

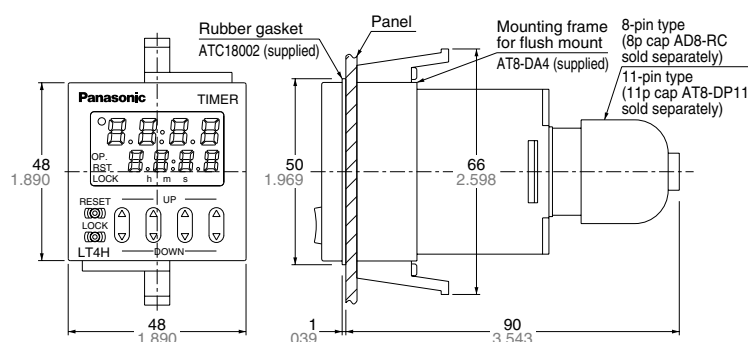


• Dimensions for front panel installations

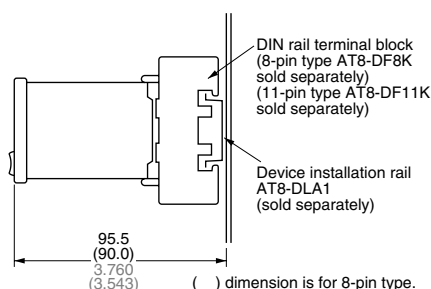


• Installation panel cut-out dimensions

The standard panel cut-out dimensions are shown below. Use the mounting frame (AT8-DA4) and rubber gasket (ATC18002).



• For connected installations




Note) 1: The installation panel thickness should be between 1 and 5 mm (.039 and .197 inch).
2: For connected installations, the waterproofing ability between the unit and installation panel is lost.


Terminal layouts and Wiring diagrams

• 8-pin type

Relay output type

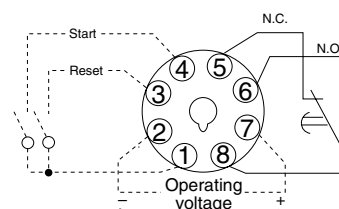


Transistor output type

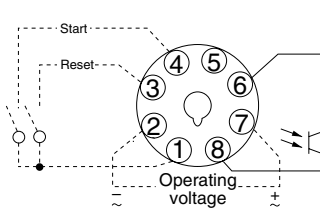


• 11-pin type

Relay output type

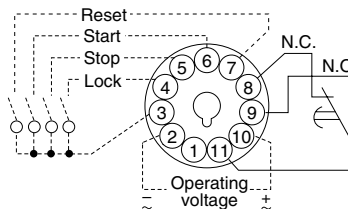


Transistor output type

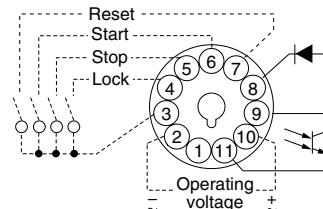


• Screw terminal type

Relay output type

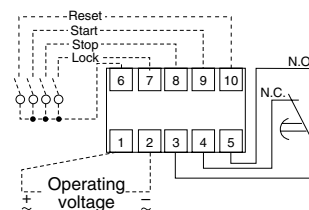

Transistor output type

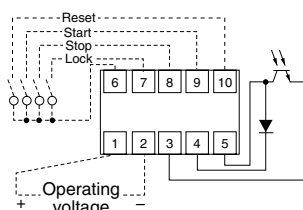

Note) For connecting the output leads of the transistor output type, refer to 5) Transistor output on page 48.


Applicable standard

Safety standard	EN61812-1	Pollution Degree 2/Overvoltage Category II
EMC	(EMI)EN61000-6-4 Radiation interference electric field strength Noise terminal voltage (EMS)EN61000-6-2 Static discharge immunity	EN55011 Group1 ClassA EN55011 Group1 ClassA
	RF electromagnetic field immunity EFT/B immunity Surge immunity Conductivity noise immunity Power frequency magnetic field immunity Voltage dip/Instantaneous stop/Voltage fluctuation immunity	EN61000-4-2 4 kV contact 8 kV air EN61000-4-3 10 V/m AM modulation (80 MHz to 1 GHz) 10 V/m pulse modulation (895 MHz to 905 MHz) EN61000-4-4 2 kV (power supply line) 1 kV (signal line) EN61000-4-5 1 kV (power line) EN61000-4-6 10 V/m AM modulation (0.15 MHz to 80 MHz) EN61000-4-8 30 A/m (50 Hz) EN61000-4-11 10 ms, 30% (rated voltage) 100 ms, 60% (rated voltage) 1,000 ms, 60% (rated voltage) 5,000 ms, 95% (rated voltage)

Dimensions

• LT4H-W digital timer


(units: mm inch)
Tolerance: $\pm 1.0 \pm .039$

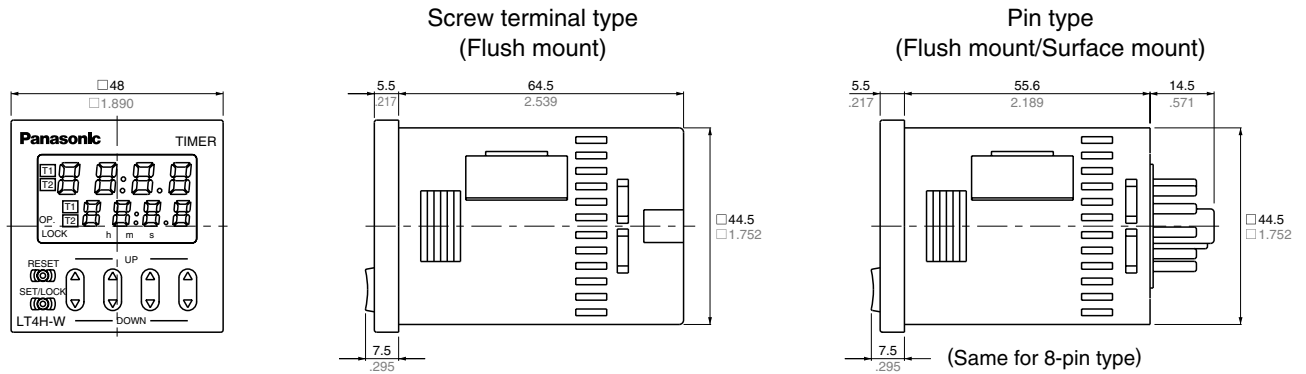


• Dimensions for flush mount (with adapter installed)

Screw terminal type

Pin type

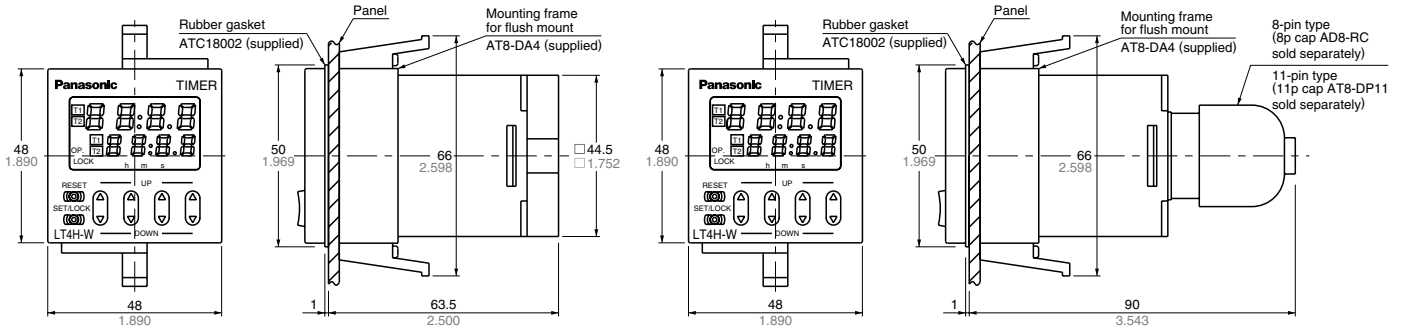


• Dimensions for front panel installations

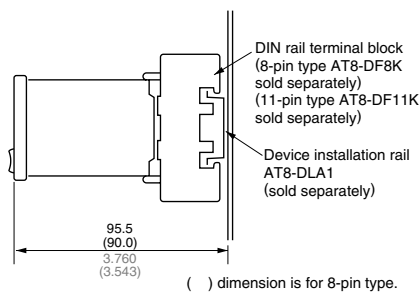


• Installation panel cut-out dimensions

The standard panel cut-out dimensions are shown below. Use the mounting frame (AT8-DA4) and rubber gasket (ATC18002).



• For connected installations



When n timers are continuously installed, the dimension (A) is calculated according to the following formula (n: the number of the timers to be installed):


$$A = (48 \times n - 2.5) \frac{+0.6}{-0.5} \quad A = (1.890 \times n - .098) \frac{+0.024}{-0.024}$$

- Note) 1: The installation panel thickness should be between 1 and 5 mm .039 and .197 inch.
2: For connected installations, the waterproofing ability between the unit and installation panel is lost.


Terminal layouts and Wiring diagrams

• 8-Pin type

Relay output type




Transistor output type




• Screw terminal type

Relay output type




Transistor output type




• 11-Pin type

Relay output type



Transistor output type



Note) For connecting the output leads of the transistor output type, refer to 5) Transistor output on page 48.