



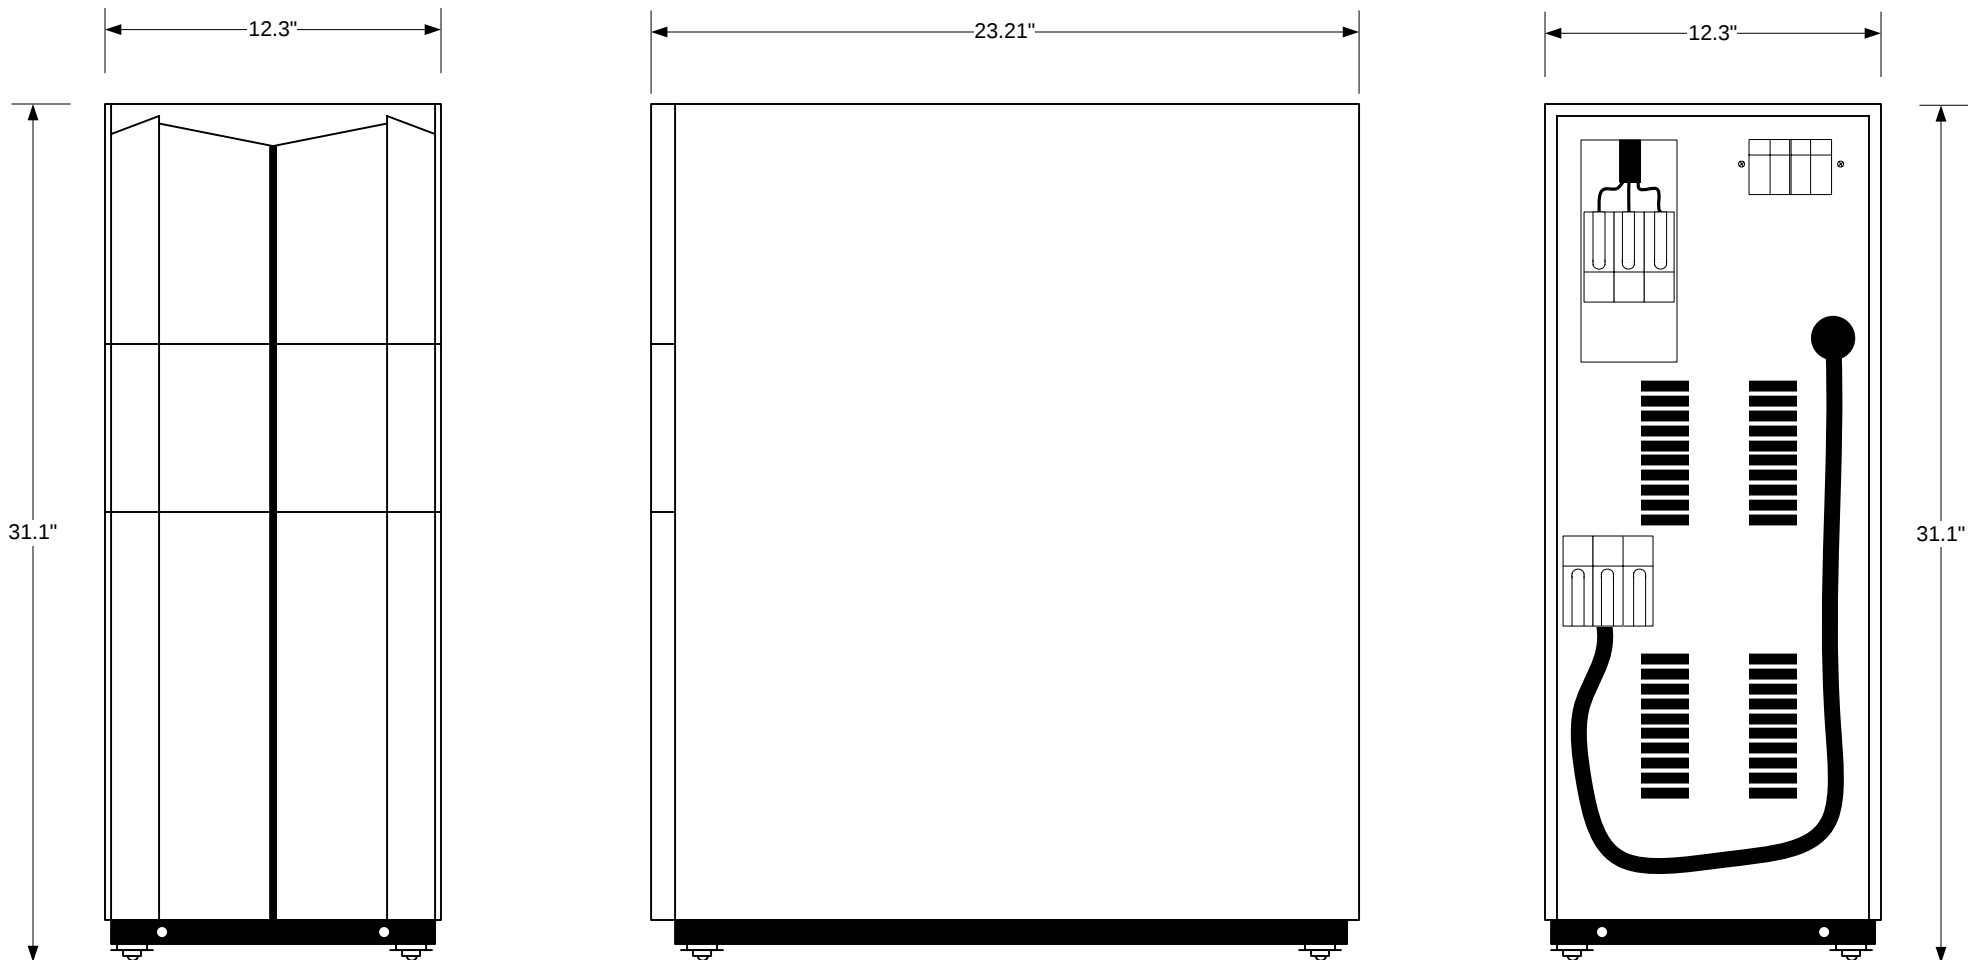

Positive
Terminal

Negative
Terminal

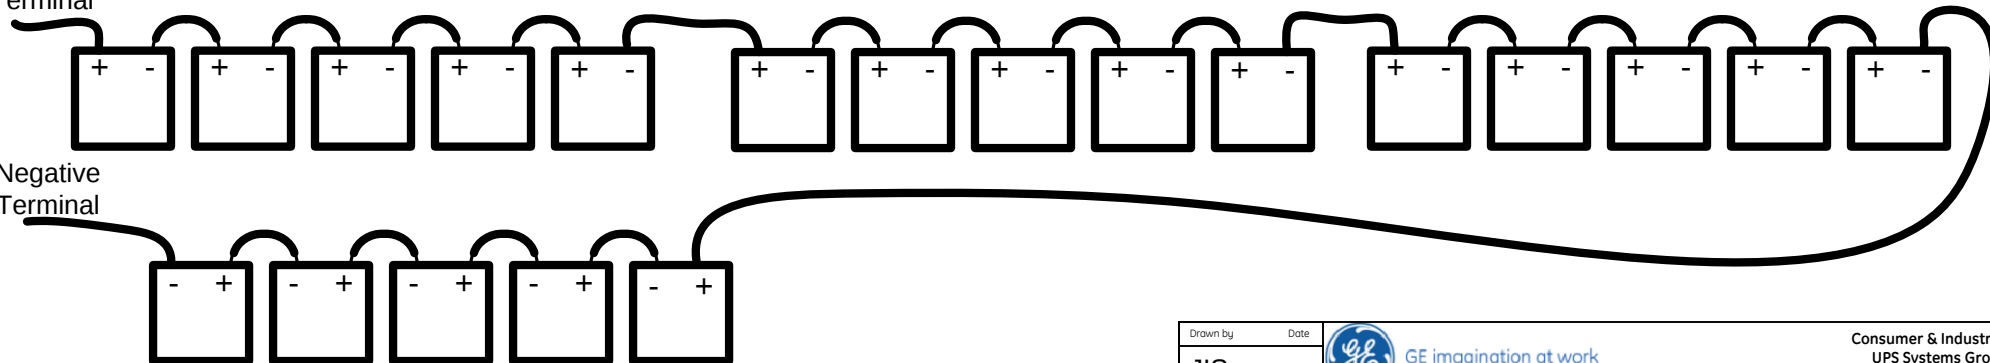

Battery Combinations:

UPS12434 – (Qty 20) 7 AH Batts

UPS12438 – (Qty 20) 14 AH Batts

UPSLPB21AH- (Qty 1 each) UPS12434 & UPS12438

UPSLPG28AH- (Qty 2) UPS12438

Drawn by	Date	 GE imagination at work	Consumer & Industrial UPS Systems Group Bonham, Texas
JIS	08/05/07		
Approved by	Date		
JIS	08/05/07	LP11 Extended Battery Cabinet	
Modified by	Date		
		DWG #: LPEXTBATT- 4	Revision 1.0
			Date 08/05/2007