

## Integra 1560 and 1580 Digital Metering and Transducer Systems





*Integra 1560 and 1580 multi function transducers provide high accuracy <0.2% measurement and communication of up to 50 major electrical and power quality parameters, including true RMS system values, power quality data and total harmonic distortion (THD) measurement up to the 31st harmonic. The range offers a 1560 DIN rail mounted version, and a 1580 variant featuring a base plate for surface mounting. Both transducers offer the same high technical specification and incorporate pulsed, analog and digital communication outputs. Transducers are fully programmable through a Windows based software configuration package, enabling remote commissioning and monitoring via building management systems. Alternatively, an optional menu driven display unit can be used to configure and monitor up to 32 measured parameters.*

## Features

- Measurement and communication of up to 50 electrical and power parameters
- High accuracy <0.2%
- THD measurement and power quality data
- True RMS measurement
- Pulsed, analog and digital outputs
- Modbus and Lonworks interface options
- Fully programmable PT and CT ratios
- Configurable via software package or menu driven interface

## Benefits

- Replaces multiple single function transducers
- DIN rail or base mounted options
- Local or remote configuration and monitoring via building management systems
- ANSI style local or remote LED display option
- Monitoring, control and protection of expensive power assets

## Applications

- Switchgear
- Distribution systems
- Control panels
- Energy management
- Building management
- Utility power monitoring
- Process control
- Motor monitoring

## Approvals

- UL Approved File No. E200300
- CSA pending

## Contents

Operation	Page 2
Accuracy	Page 2
System Input	Page 2
Pulsed and Analog Outputs	Page 2
Digital Communications	Page 2
Software Configuration	Page 3
Programmable Display Unit Option	Page 3
Programmable Parameters	Page 3
Specification	Page 4
Ordering Codes	Page 6
Dimensions	Page 7
Wiring Connections	Page 8
Auxiliary Supply	Page 8
Fusing	Page 8
Safety and Ground Connections	Page 8



## Measurement and Communication

Up to 50 electrical and power quality parameters can be measured and communicated into building management systems or viewed through the software configuration package via a PC.

Volts L1-N, L2-N, L3-N  
Volts L1-L2, L2-L3, L3-L1  
System Volts L-N (Average)  
System Volts L-L (Average)  
Current Line 1, 2 and 3  
System Current (Average)  
Current Sum  
Current Demand  
Current Maximum Demand  
Neutral Current  
System Frequency  
Watts 1, 2 and 3  
System Watts (Sum)  
Watts Demand (Import)  
Watts Maximum Demand (Import)  
Watt-hours (Import)  
VAr 1, 2 and 3  
System VAr (Sum)  
VAr-hours (Import)  
VA 1, 2 and 3  
System VA (Sum)  
Power Factor 1, 2 and 3  
System Power Factor (Average)  
Phase Angle 1, 2 and 3  
System Phase Angle (Average)  
THD Volts 1, 2 and 3  
THD System Volts (Mean)  
THD Amps 1, 2 and 3  
THD System Amps (Mean)

## Operation

The multi function Integra 1560 and 1580 transducers offer uncomplicated operation and high accuracy <0.2% measurement of three phase voltage, current, frequency, Watts, VAr, VA, energy, power factor and total harmonic distortion measurement of both phase and system, current and voltage. A simple Windows based software package is provided to configure the transducer. Once configured, simultaneous monitoring of up to 50 electrical and power quality variables can be communicated into building management systems via pulsed, analog or digital communication options. Status may also be monitored through the software package via a PC. Alternatively, an optional menu driven display unit can be used to configure and monitor up to 32 measured parameters including three phase voltage and current, and system Watts, VAr, VA, power factor, energy and total harmonic distortion. This Integra Display unit can be permanently panel mounted locally to the transducer, or simply connected at times when configuration, adjustment and/or status information is required.

## Accuracy

Integra transducers utilize true RMS measurement techniques up to the 31st harmonic, providing <0.2% accuracy. An exceptional tolerance to high harmonic frequencies is achieved from a robust frequency detection method, which is able to lock the fundamental frequency onto any phase. High integrity measurements are possible where the system approximates CT current in the absence of voltage signals.

## System Input

Designed for all low, medium and high voltage switchgear and distribution systems, the Integra 1560 and 1580 offer programmable PT and CT ratio capability. Direct connected up to 480V AC with 5A CT inputs standard, and 1A CT inputs available as an option.

## System Outputs

### Pulsed Outputs

Integra transducers offer optional pulsed outputs enabling the retransmission of kW.Hr and kVAr.Hr time based parameters. Outputs are pulsed at a rate proportional to the measured kW.h active energy, with pulse width and rate easily programmable either locally or remotely. Output relays have a fully isolated volt free contacts, with connection via screw clamp terminals.

### Analog Outputs

Up to four analog outputs may also be included, enabling onward transmission of linear parameters using industry standard analog signalling. Each analog channel can be assigned to one of 47 measured parameters with the output span fully adjustable to suit customer requirements, and can be configured to operate in normal, reverse, threshold or constant current modes. Analog outputs share a common return which is galvanically isolated from non-analog output terminals.

## Digital Communications

### RS485 Modbus RTU

Integra 1560 and 1580 transducers offer up to two RS485 communication ports for direct connection to SCADA systems using the Modbus RTU protocol, or optionally a single Johnson Controls Metasys NII protocol. Remote monitoring enables the user to record the systems parameters in real time, using high resolution numbers. The Modbus protocol establishes the format for the master's query by placing it into the device address. The slave's response is also constructed using the Modbus protocol; it contains the fields confirming the action taken, the data to be returned, and an error-checking field. The Modbus option includes function 8 subfunction 0, which provides return query data diagnostic support, and the ability to change Modbus word order to suit the requirements of the user.

### Lonworks Interface

The Lonworks interface option is designed to conform to the LonMark Interoperability Guidelines version 3.2. This ensures Integra transducers can be integrated into a single control network without requiring custom node or network tool development.



## Measurement and Display

Up to 32 electrical and power quality measurements can be configured and monitored on the DIS-1540 optional display unit. The displayed parameters appear in the following order.

- 1 System Volts  
System Current  
System kW
- 2 System Volts THD %  
System Current THD %
- 3 Volts L1 – N (4 wire only)  
Volts L2 – N (4 wire only)  
Volts L3 – N (4 wire only)
- 4 Volts L1 – L2  
Volts L2 – L3  
Volts L3 – L1
- 5 Volts Line 1 THD %  
Volts Line 2 THD %  
Volts Line 3 THD %
- 6 Current L1  
Current L2  
Current L3
- 7 Current Line 1 THD %  
Current Line 2 THD %  
Current Line 3 THD %
- 8 Neutral Current (4 wire only)  
Frequency  
Power Factor
- 9 kVar  
kVA  
kW
- 10 kW Hr (7 digit resolution)
- 11 kVar Hr (7 digit resolution)
- 12 kW Demand  
Current Demand
- 13 kW Maximum Demand  
Current Maximum Demand

## Software Configuration

Configuration of up to 50 measured parameters, outputs, pulsed relays, current and power demand are easily programmed through a Windows style user interface, which can be installed on any PC running Windows 95, NT or 2000. Communication to the transducer is achieved with connection to a COM port on the PC via an RS485/RS232 converter.

The configuration software allows the user to load and save the configuration to and from a hard disk on a PC, and to send and retrieve settings to and from the transducer. Settings can be saved to disk for later use, and can be copied from one Integra to the next.

Status information will usually be communicated into a building management system, but can also be monitored through the configuration software. The software interrogates the selected transducer every few seconds to obtain data, which can be viewed on a dedicated measurements page.

## Programmable Display Unit Option

As an alternative to the standard software configuration package, potential and current transformer ratios, communication options and power measurement parameters can be configured via the optional menu driven Integra display unit. A simple two button interface on the front panel of the unit allows display of 32 major electrical and power quality parameters. To prevent unauthorized access to the product configuration settings, all set-up screens can be protected by an optional customer programmable password.

Once configured, the status of each parameter can be viewed by scrolling through 13 screens, featuring a 3 line, 4 digit LED display. The unit requires an independent auxiliary power supply and thus may be positioned either locally, or remotely from the transducer at a distance limited only by the communication restrictions of RS485.

## Programmable Parameters

Integra 1560 and 1580 transducers can be programmed via the RS485 communications port by using the configuration software running on a Windows based PC, or by using the optional programmable Integra display unit.

Parameter	Range
Password:	4 digit 0000 - 9999
Primary Current:	Max 9999A (360MW max**)
PT Primary:	400kV (360MW max**)
Secondary Voltage:	Nominal system voltage
	** maximum PT or CT ratios are limited so that the combination of primary voltage and current do not exceed 360MW at 120% of relevant input
Demand Integration Time:	8, 15, 20, 30 minutes
Reset:	Max demand & active energy registers
Pulse Output Duration:	60, 100, 200 ms
Pulse Rate Divisors:	1, 10, 100, 1000
RS485 Interface Baud Rate:	2.4, 4.8, 9.6, 19.2 kB
RS485 Parity:	Odd / Even / No, 1 or 2 stop bits
Modbus Address:	1 - 247
Analog Outputs:	User definable parameters & ranges






## Specification

<b>Input</b>	
Nominal Input Voltage:	57.7 to 277V L-N, 100 to 480V L-L
Max Continuous Input Voltage:	120% nominal
Max Short Duration Input Voltage:	2 x for 1 second, repeated 10 times at 10 second intervals
System PT Ratios (primary):	Any value up to 400kV **
Nominal Input Voltage Burden:	< 0.2 VA
Nominal Input Current:	5A (1A option)
System CT Primary Values:	9999:5A or 9999:1A max 360MW **
Max Continuous Input Current:	120% nominal
Max Short Duration Current Input:	20 x for 1 second, repeated 5 times at 5 second intervals
Nominal Input Current Burden:	< 0.6 VA
	** maximum PT or CT ratios are limited so that the combination of primary voltage and current do not exceed 360MW at 120% of relevant input
<b>Outputs</b>	
RS485 Communications:	Two wire half duplex
Baud Rates:	2400, 4800, 9600, 19200
Pulsed:	Clean contact SPNO, 100V DC 0.5A max
Pulse Duration:	60, 100 or 200 milliseconds
Pulsed Outputs:	Up to 6
Analog Outputs:	Up to 4
<b>Auxiliary</b>	
Standard Nominal Supply Voltage:	100 V – 250 V AC or DC (85 V – 287 V AC Absolute) (85 V – 312 V DC Absolute)
AC Supply Frequency Range:	45 – 66 Hz
AC Supply Burden:	6VA
Optional Auxiliary DC Supply:	12 V - 48 V DC (10.2 V – 60 V DC Absolute)
DC Supply Burden:	6VA
<b>Measuring Ranges</b>	
Voltage:	80 .. 120% of nominal (functional 5..120%)
Current:	5 .. 120% of nominal (functional 5..120%)
Frequency:	45 .. 66Hz
Power Factor:	0.8 capacitive – 1 – 0.8 inductive
THD:	Up to 31st harmonic 0% - 40%
Energy:	7 digit resolution
<b>Reference Conditions</b>	
Ambient Temperature:	23°±1°C
Input Frequency:	50 or 60 Hz ±2%
Input Waveform:	Sinusoidal (distortion factor < 0.005)
Auxiliary Supply Voltage:	Nominal ±1%
Auxiliary Supply Frequency:	Nominal ±1%
AC Auxiliary Supply Waveform:	Sinusoidal (distortion factor < 0.05)
Magnetic Field of Origin:	Terrestrial flux

continued

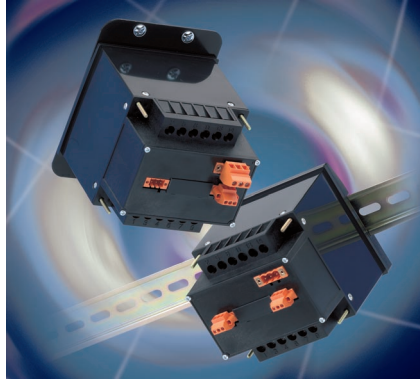

## Specification Continued

<b>Accuracy</b>	
Voltage:	±0.17% of range
Current:	±0.17% of range
Frequency:	0.15% of mid frequency
Power:	±0.2% of range
Power Factor:	1% of unity
Reactive Power (VAR):	±0.5% of range
Apparent Power (VA):	±0.2% of range
THD:	±1%
Neutral Current:	±0.95% of range
Energy:	KWh 1% IEC1036
KVArh:	2%
Temperature Coefficient:	Voltage & current typical: 0.013%/°C Watts typical: 0.018%/°C
Update Time:	Display: 1 second. Optional digital port: 250ms
Analog Output:	±0.2%
<b>Enclosure</b>	
Enclosure Style:	DIN rail or base mounted
Compliant With:	UL E200300 and IEC 1010/BSEN 61010-1
Material:	Polycarbonate
Terminals:	Shrouded screw clamp
Dielectric Voltage:	Withstand test 3.25kV RMS 50Hz for 1 minute between all electrical circuits
Operating Temperature:	-20 to +60°C
Storage Temperature:	-30 to +80°C
Relative Humidity:	0 .. 90% non condensing
Warm-up Time:	1 minute
Shock:	30g in 3 planes
Vibration:	10 .. 55 Hz, 0.15mm amplitude
DIN Rail Transducer Dimensions:	5.5" high* x 3.72" wide x 3.72" deep 139.6mm high x 94.4mm wide x 94.4mm deep *Excluding connectors
Base Mounted Transducer Dimensions:	5.2" high* x 3.74" wide x 5.24" deep 131.5mm high x 95mm wide x 133.5mm deep *Excluding connectors
Transducer Display Dimensions:	4.31" high x 4.31" wide x 2.9" deep 109.4mm high x 109.4mm wide x 73.7mm deep
Panel Cut Out (Display):	4.06" (103mm) diameter, 4 stud positions

## Accuracy Definition

Error change due to variation of an influence quantity in the manner described in section 6 of IEC688:1992.

THD accuracy relates to a typical harmonic profile.



## Order Code Example

### INT-1564-M-5-M-120


Integra 1560 transducer, 3 phase 4 wire, DIN rail mounted, 241 to 480V L-L nominal input voltage, 5A CT input, auxiliary supply 100 to 250V AC or DC, one relay pulsed output and two RS485 Modbus communication ports.

## Ordering Codes


Ordering Code	Product Configuration				
INT-1561-*5**-option-***	Integra 1560 single phase 5A CT input, DIN Rail				
INT-1562-*5**-option-***	Integra 1560 single phase 3 wire 5A CT input, DIN Rail				
INT-1563-*5**-option-***	Integra 1560 3 phase 3 wire 5A CT input, DIN Rail				
INT-1564-*5**-option-***	Integra 1560 3 phase 4 wire 5A CT input, DIN Rail				
INT-1581-*5**-option-***	Integra 1580 single phase 5A CT input, Base mount				
INT-1582-*5**-option-***	Integra 1580 single phase 3 wire 5A CT input, Base mount				
INT-1583-*5**-option-***	Integra 1580 3 phase 3 wire 5A CT input, Base mount				
INT-1584-*5**-option-***	Integra 1580 3 phase 4 wire 5A CT input, Base mount				
Input Voltage Suffix *					
L	57.7 – 139V L-N		1561 & 1581		
	114 - 278 V L-L (57.7 – 139V L-N)		1562 & 1582		
	100 – 240 V L-L (57.7 – 139V L-N)		1563,4 & 1583,4		
M	140 – 277 V L-N		1561 & 1581		
	279 – 480 V L-L (140 – 240V L-N)		1562 & 1582		
	241 – 480 V L-L (140 – 277V L-N)		1563,4 & 1583,4		
Auxiliary Supply Suffix **					
L	12 – 48V DC				
M	100 – 250V AC/DC				
Communications Options	Pulsed / Relay Outputs	RS485 Interface Modbus or Johnson Controls Metasys NII	Lonworks Interface	Analog outputs	
010		1			
011		1		1	
012		1		2	
013		1		3	
014		1		4	
020		2			
021		2		1	
022		2		2	
023		2		3	
024		2		4	
040		1	1		
110	1	1			
111	1	1		1	
112	1	1		2	
113	1	1		3	
114	1	1		4	
120	1	2			
121	1	2		1	
122	1	2		2	
123	1	2		3	
124	1	2		4	
210	2	1			
211	2	1		1	
212	2	1		2	
220	2	2			
221	2	2		1	
222	2	2		2	
410	4	1			
411	4	1		1	
412	4	1		2	
420	4	2			
421	4	2		1	
422	4	2		2	
610	6	1			
611	6	1		1	
612	6	1		2	
620	6	2			
621	6	2		1	
622	6	2		2	
Analog Output Range ***					
0	No output				
1	0-20 mA, 10V compliance (user configurable as 4-20 mA) Available for up to 3 output channels only				
2	0-1 mA, 10V compliance				
3	-1/0/+1 mA, 10V compliance				
4	0-5 mA, 10V compliance				
6	0-10 mA, 10V compliance				




**Dimensions**  
**Integra 1560 DIN Rail Mounted Transducer**

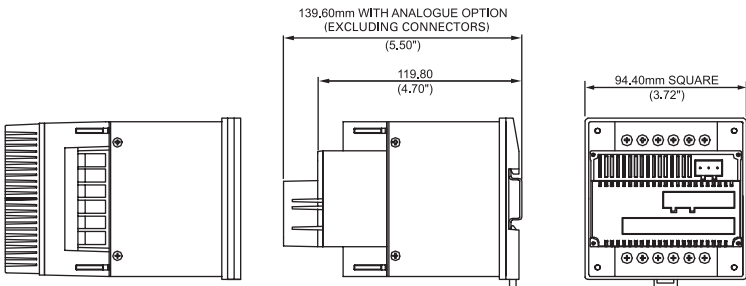


**Integra 1580 Base Mounted Transducer**

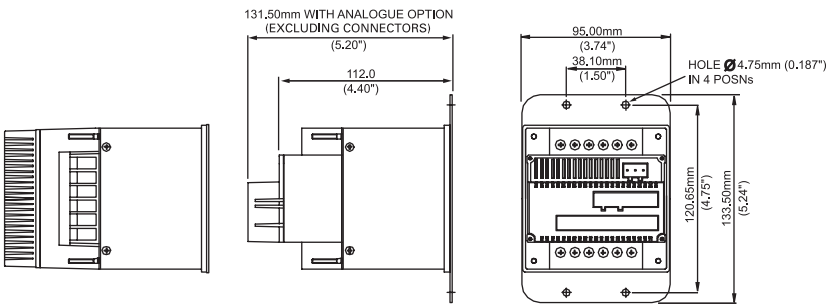

**Optional Remote Display (for use with Integra 1560 or 1580 Transducer)**

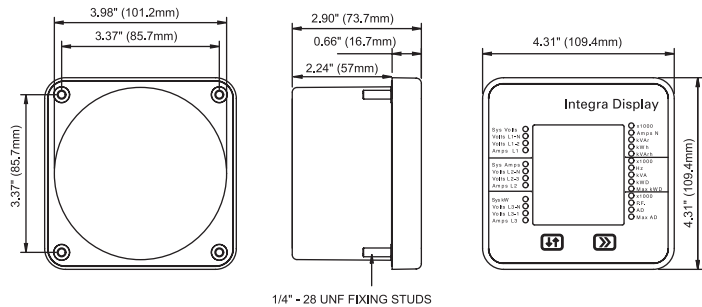

**Optional Remote Display Panel Cut Out**

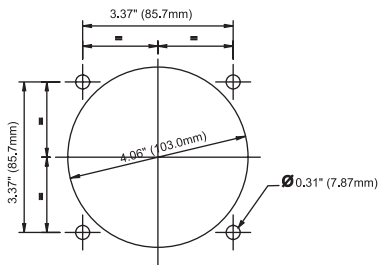







## Wiring

Input connections are made directly to shrouded screw clamp terminals. Terminals for both current and voltage connections are sized to accept two #9 AWG (3mm<sup>2</sup>) solid or stranded wires. Connections for auxiliary power, pulsed and analog options are via screw clamp connectors. Connectors offer retained wire protection leaves suitable for one #10 AWG (2.5mm<sup>2</sup>) solid or stranded wire. Digital interface connections are similarly via screw clamp connection, wire protection leaves and sized to accept one #14 AWG (1.5mm<sup>2</sup>) solid or stranded wire.


**1560/1580**  
**3 Phase 3 Wire Unbalanced Load**

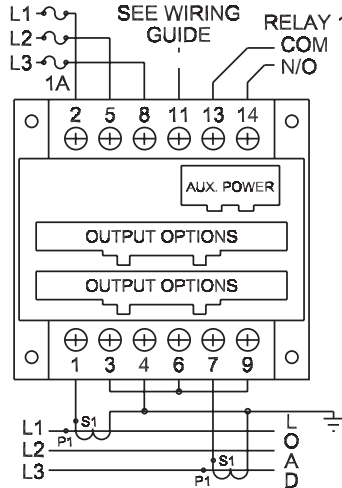

**1560/1580**  
**3 Phase 4 Wire Unbalanced Load**

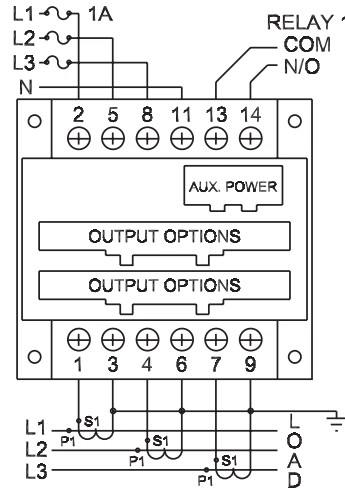

**DIS-1540 Remote Display**

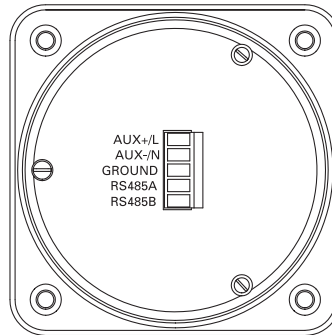

## Auxiliary Supply

The Integra family should ideally be powered from a dedicated supply, either 100 – 250V AC or DC (85V – 280V AC Absolute or 85V – 312V DC Absolute) or 12-48V DC (10.2V – 60V DC Absolute). However the device may be powered from the signal source, provided the source remains within the working range of the chosen auxiliary supply.

## Fusing

It is recommended that all voltage lines be fitted with 1 amp fuses.

## Safety / Ground Connections

For Safety reasons all CT secondary connections should be grounded in accordance with local regulations.

All of the above information, including drawings, illustrations and graphic designs, reflects our present understanding and is to the best of our knowledge and belief correct and reliable. Users, however, should independently evaluate the suitability of each product for the desired application. Under no circumstances does this constitute an assurance of any particular quality or performance. Such an assurance is only provided in the context of our product specifications or explicit contractual arrangements. Our liability for these products is set forth in our standard terms and conditions of sale. ALR, AMP, AXICOM, B&H, BOWTHORPE EMP, CROMPTON INSTRUMENTS, DORMAN SMITH, DULMISON, GURO, HELLSTERN, LA PRAIRIE, MORLYNN, RAYCHEM, and SIMEL are trademarks.

**Energy Division – a pioneer in the development of economical solutions for the electrical power industry. Our product range includes: Cable accessories, connectors & fittings, electrical equipment, instruments, lighting, insulators & insulation enhancement and surge arresters.**

**Western Canada**

Phone: ++1 403 257 3080  
Fax: ++1 403 257 6657

**Eastern Canada**

Phone: ++1 905 671 2304  
Fax: ++1 905 671 3661

**Mexico**

Phone: ++52 55 5729 0405  
Fax: ++52 55 5361 8545

**Mexico**

Phone: ++52 55 5383 1585  
Fax: ++52 55 5382 0016

**Brazil**

Phone: ++55 11 3611 1862  
Fax: ++55 11 3611 2457

**Colombia**

Phone: ++571 240 9396  
Fax: ++571 660 0084

**Chile**

Phone: ++562 209 8211  
Fax: ++562 223 1477

**Peru**

Phone: ++511 442 4242  
Fax: ++511 421 0368

**Argentina**

Phone: ++54 11 4733 2277  
Fax: ++54 11 4733 2267

**Venezuela**

Phone: ++58 414 249 8857  
Fax: ++58 212 963 2561

**Central America**

Phone: ++1 954 602 5001  
Fax: ++1 954 602 5021

**Caribbean**

Phone: ++1 954 602 5001  
Fax: ++1 954 602 5021



**AMP**

**AXICOM**



**Bowthorpe EMP**



**Hellstern**



**Raychem**

**SIMEL**

**Tyco Electronics Corporation, Crompton Instruments**

1610 Cobb International Blvd, Suite 4, Kennesaw, GA, 30152, USA

Phone: 1 800 425 8903 Fax: 1 770 423 7194

<http://energy.tycoelectronics.com>