




JUMO dTRON 316



JUMO dTRON 308

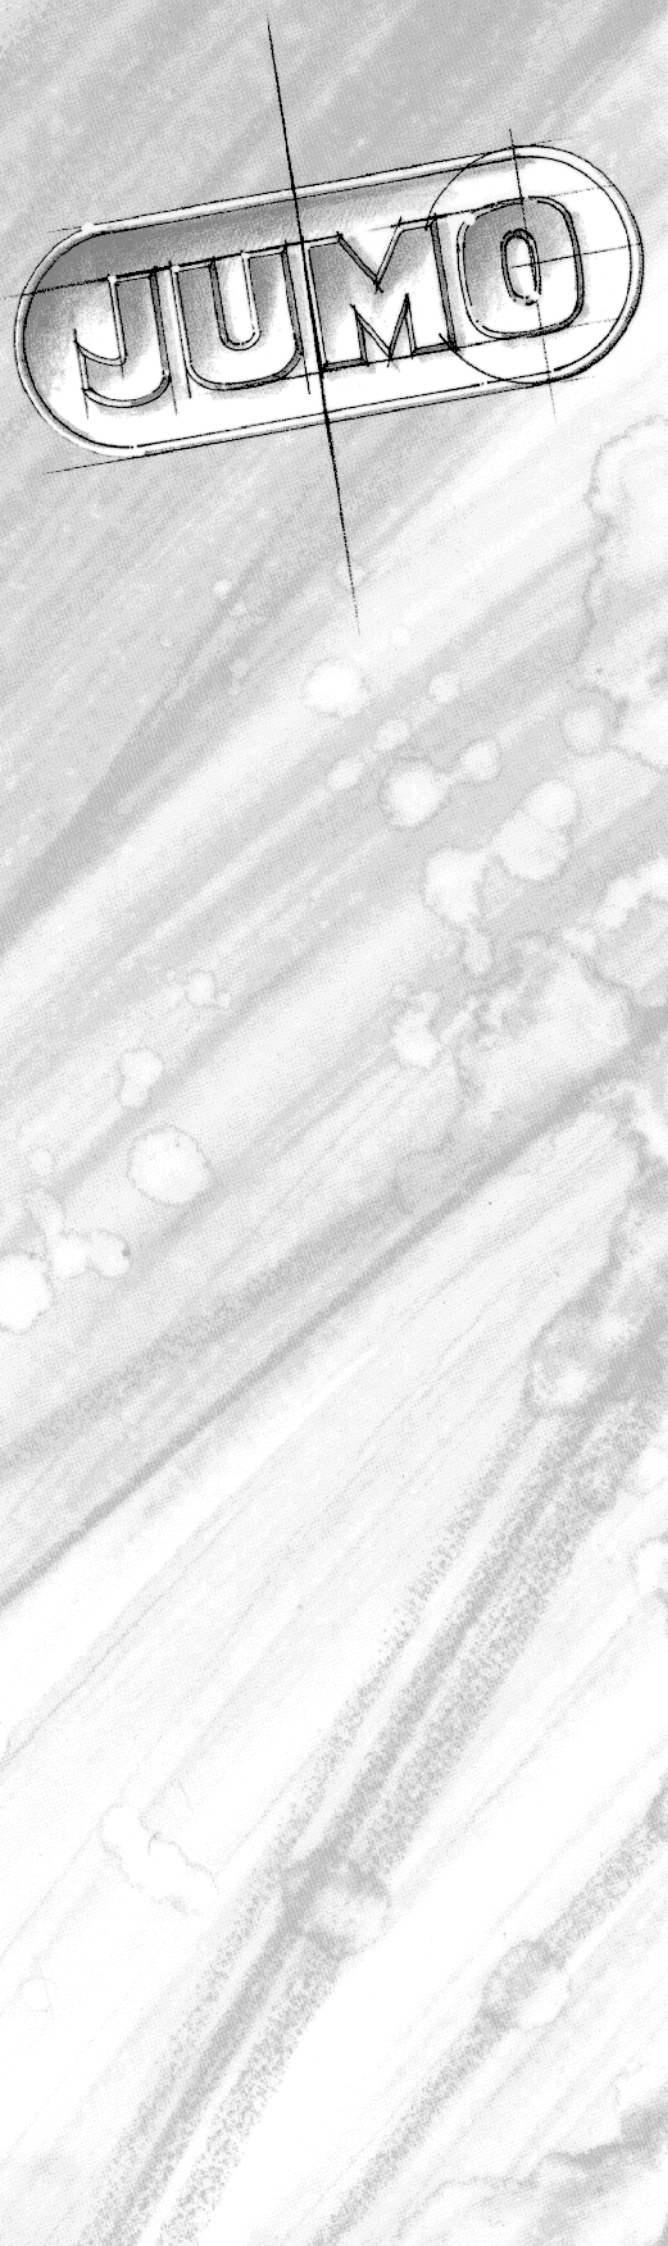

JUMO dTRON 308



JUMO dTRON 304

JUMO dTRON 304

JUMO dTRON 308

JUMO dTRON 316

Compact Controller
with program function

B 70.3041.0
Operating Manual

06.05/00442056



Please read this Operating Manual before commissioning the instrument. Keep the manual in a place which is accessible to all users at all times.

Please assist us to improve this operating manual. Your comments will be appreciated.

Phone +49 661 6003-0

Fax +49 661 6003-607

All necessary settings are described in this operating manual. If any difficulties should still arise during start-up, please do not carry out any unauthorized manipulations on the unit. You could endanger your rights under the instrument warranty!

Please contact the nearest subsidiary or the head office in such a case.



When returning modules, assemblies or components, the regulations of EN 100 015 "Protection of electrostatic sensitive devices" must be observed. Only use the appropriate **ESD** packaging for transport.

Please note that we can not accept any liability for damage caused by ESD.

ESD=electrostatic discharge

1	Introduction	5
1.1	Description	5
1.2	Typographical conventions	6
2	Identifying the instrument version	7
2.1	Type designation	7
2.2	Scope of delivery	8
2.3	Accessories	8
3	Mounting	9
3.1	Mounting site and climatic conditions	9
3.2	Dimensions	9
3.2.1	Type 703044	9
3.2.2	Type 703042/43	10
3.2.3	Type 703041	10
3.3	Side-by-side mounting	11
3.4	Fitting in position	11
3.5	Removing the controller module	12
4	Electrical connection	13
4.1	Installation notes	13
4.2	Electrical isolation	14
4.3	Connection diagrams	15
4.3.1	Type 703041	15
4.3.2	Type 703042/43/44	16

5	Operation	19
5.1	Displays and keys	19
5.2	Level concept	20
5.3	Level inhibit	20
5.4	Entries and operator prompting	21
5.5	Operation of the fixed-setpoint controller	22
5.6	Operation of the program controller	23
5.6.1	Entering programs	24
5.6.2	Shifting the program profile	26
6	Operator level	27
7	Parameter level	29
8	Configuration	31
8.1	Analog inputs “InP”	33
8.2	Controller “Cntr”	37
8.3	Generator “Pro”	39
8.4	Limit comparators “LC”	42
8.5	Outputs “OutP”	46
8.6	Binary functions “binF”	49
8.7	Display “diSP”	52
8.8	Timer “tFct”	53
8.9	Interfaces “IntF”	54
9	Tuning (optimization)	55
9.1	Autotuning (self-optimization)	55
9.2	Check of the tuning	58
10	Extra codes	59
10.1	Math and logic module	59
10.2	Difference, humidity and ratio controllers	59

Contents

11	Retrofitting of modules	61
12	Appendix	63
12.1	Technical data	63
12.2	Alarm messages	66
13	Index	67

Contents

1.1 Description

The controller series consists of four freely programmable instruments in different DIN formats for controlling temperature, pressure and other process variables. The high-contrast, multicolor LCD display for process value, setpoint and operator prompting contains two four-digit 7-segment displays, two single-character 16-segment displays, display of the active setpoints, six status indicators, and displays for the unit, ramp function and manual operation.



Just four keys on the front panel are needed for operation, parameterization and configuration. The instruments can be used as 2-state, 3-state, modulating or continuous controllers. The controller software includes a program or ramp function, parameter set changeover, autotuning (self-optimization), a math and logic module, as well as 4 limit comparators.

Linearizations for the usual transducers are stored, and a customer-specific linearization table can be programmed.

A setup program is available for user-friendly configuration from a PC.

An RS422/485 or a Profibus-DP interface can be used to integrate the instrument into a data network.

The electrical connection is made at the back of the instrument, via screw terminals.

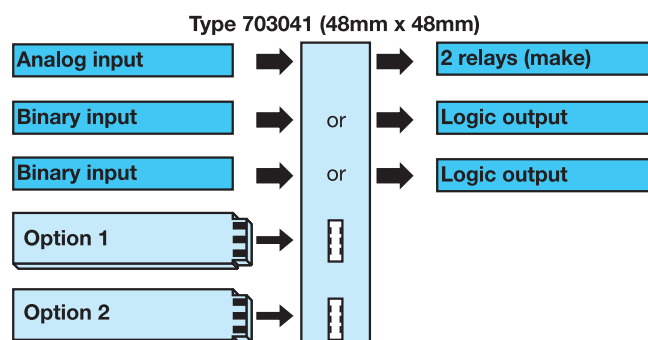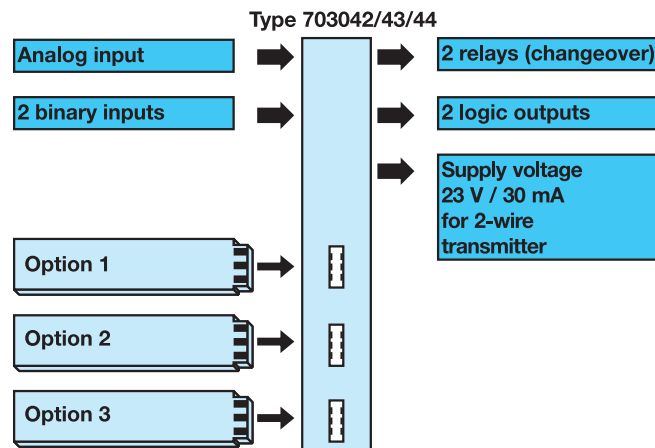

1 Introduction

1.2 Typographical conventions

Warning signs



Danger

This symbol is used when there may be **danger to personnel** if the instructions are ignored or not followed correctly!



Caution

This symbol is used when there may be **damage to equipment or data** if the instructions are ignored or not followed correctly!



Caution

This symbol is used where special care is required when handling components liable to damage through electrostatic discharge.

Note signs



Note

This symbol is used when **your special attention** is drawn to a remark.



Reference

This symbol refers to further information in other operating instructions, chapters or sections.



Action instruction

This symbol indicates that an action to be performed is described.

The individual steps are marked by this asterisk, e.g.

* Press **EXIT**

Representation

Menu items

Texts from the setup program are shown in italics, for example: *edit program*.

Blinking display



2 Identifying the instrument version

2.1 Type designation

	Basic type
703041	Type 703041, format 48mm x 48mm incl. 1 analog input, 2 relay outputs and 2 binary inputs or 2 logic outputs
703042	Type 703042, format 48mm x 96mm (portrait format) incl. 1 analog and 2 binary inputs, 2 relays and 2 logic outputs
703043	Type 703043, format 96mm x 48mm (landscape format) incl. 1 analog and 2 binary inputs, 2 relays and 2 logic outputs
703044	Type 703044, format 96mm x 96mm incl. 1 analog and 2 binary inputs, 2 relays and 2 logic outputs

Basic type extensions		
1		Basic type 1
		Version
	8	standard, with factory settings
	9	programming to customer specification
		logic outputs (2 are available as standard)
	1	0 / 12V
	2	0 / 18V

				Type 703042/43/44	Type 703041 (no option 3)		
1.	2.	3.	Option slot	Max. number	Max. number	Option 1	Option 2
0	0	0	not used			X	X
1	1	1	analog input 2 (universal)	1	1	X	X
2	2	2	relay (changeover)	2	1	X	-
3	3	3	2 relays (make contact)	2	1	X	-
4	4	4	analog output	2	2	X	X
5	5	5	2 binary inputs	2	1	X	X
6	6	6	solid-state relay 1 A	2	2	X	X
7	7	7	RS422/485 interface	1	1	X	X
8	8	8	Profibus-DP interface	1	1	X	X

X = available in this option slot, - = not available in this option slot

Supply		
2	3	110 — 240V AC -15/+10%, 48 — 63Hz
2	5	20 — 53V AC/DC, 48 — 63Hz

			Extra codes
0	0	0	none
2	1	4	math and logic module
2	1	7	ratio controller (requirement: 2 analog inputs)
2	1	8	difference controller (requirement: 2 analog inputs)
2	1	9	humidity controller (requirement: 2 analog inputs)

			Approvals
0	0	0	none
0	6	1	Underwriters Laboratories Inc. (UL)

/ 1 8 1 - 1 4 0 - 2 3 / 0 0 0 , 0 6 1

703041 / 1 8 1 - 1 4 0 - 2 3 / 0 0 0 , 0 6 1

2 Identifying the instrument version

2.2 Scope of delivery

- 1 controller
- 1 seal
- mounting brackets
- brief operating instructions
- 1 CD including DEMO-software & operating manuals as pdf-file
(Actual DEMO-software can be downloaded at www.JUMO.net.
To enable DEMO-software to full rights, contact your local JUMO subsidiary.)


2.3 Accessories

PC interface

PC interface with TTL/RS232 converter and adapter
(socket connector) for setup program
Sales No. 70/00350260


Setup programs

Versions:
Setup program with program editor¹
Sales No. 70/00445417
Setup program with program editor
and startup¹
Sales No. 70/00445443

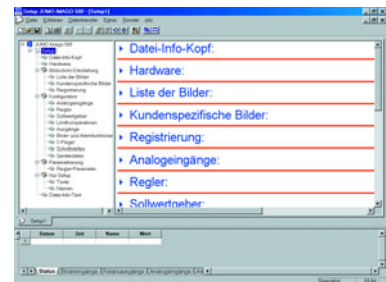

Program editor

Program editor (software)¹
Sales No. 70/00445444

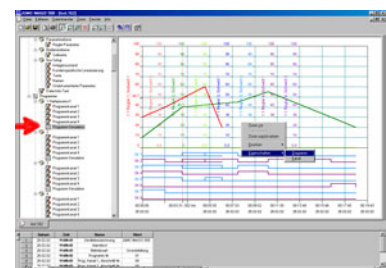

1. Requirements: Windows[®] 98/NT4.0/ME/2000/XP, PC Pentium II, 128 Mbyte RAM, 30 Mbyte free on hard disk, CD-ROM, one free serial interface


3 Mounting

3.1 Mounting site and climatic conditions

The conditions on the mounting site must meet the requirements specified in the technical data. The ambient temperature on the mounting site can be from 0 to 55 °C, with a relative humidity of not more than 90 %.


3.2 Dimensions

3.2.1 Type 703044

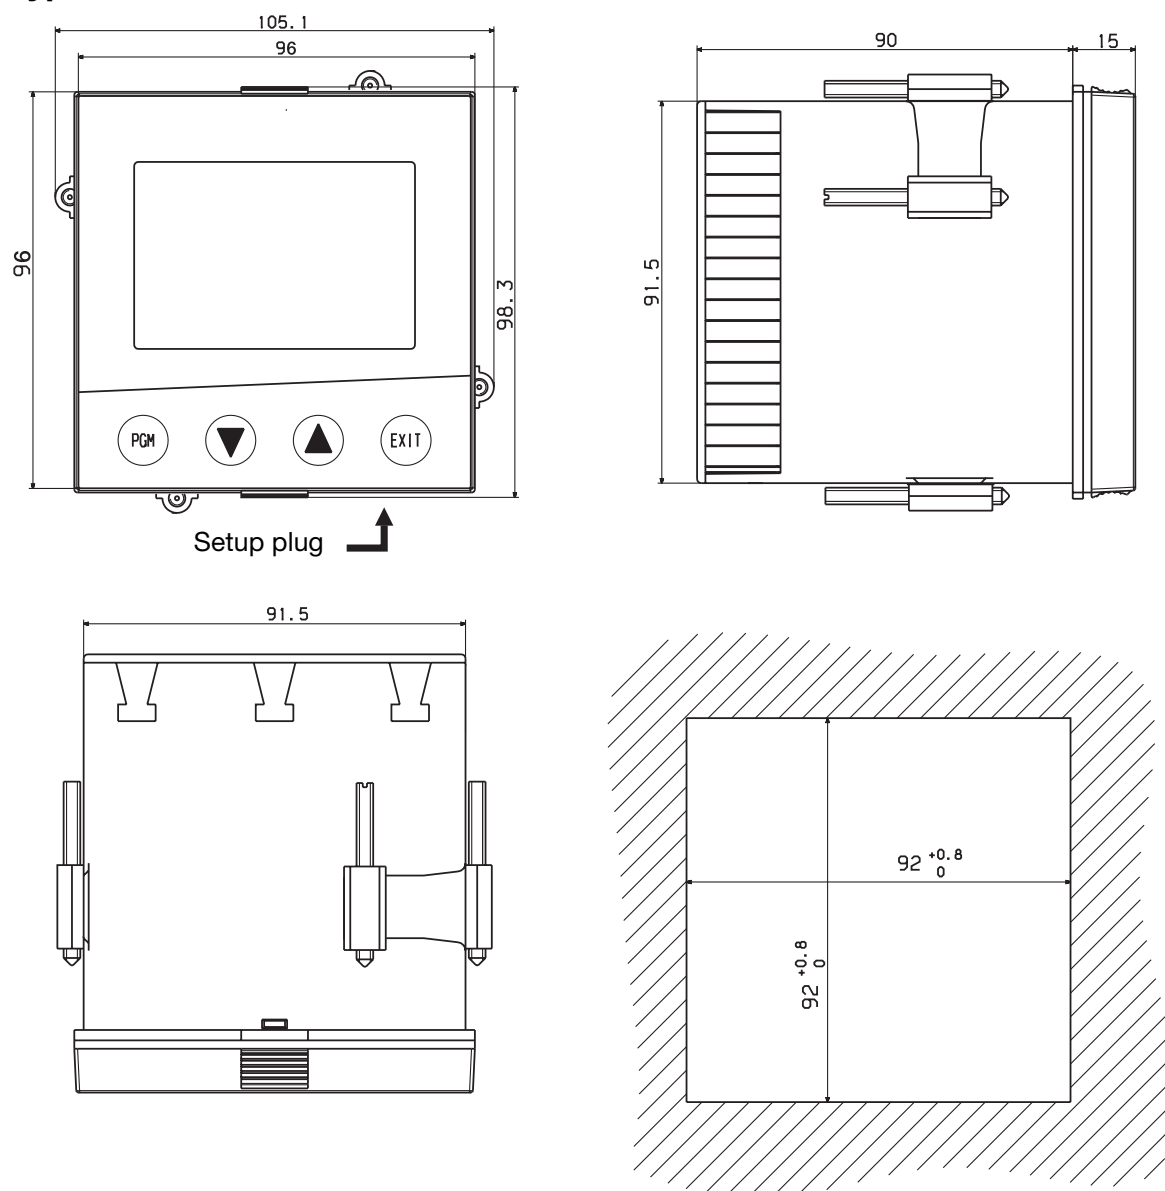


3 Mounting

3.2.2 Type 703042/43

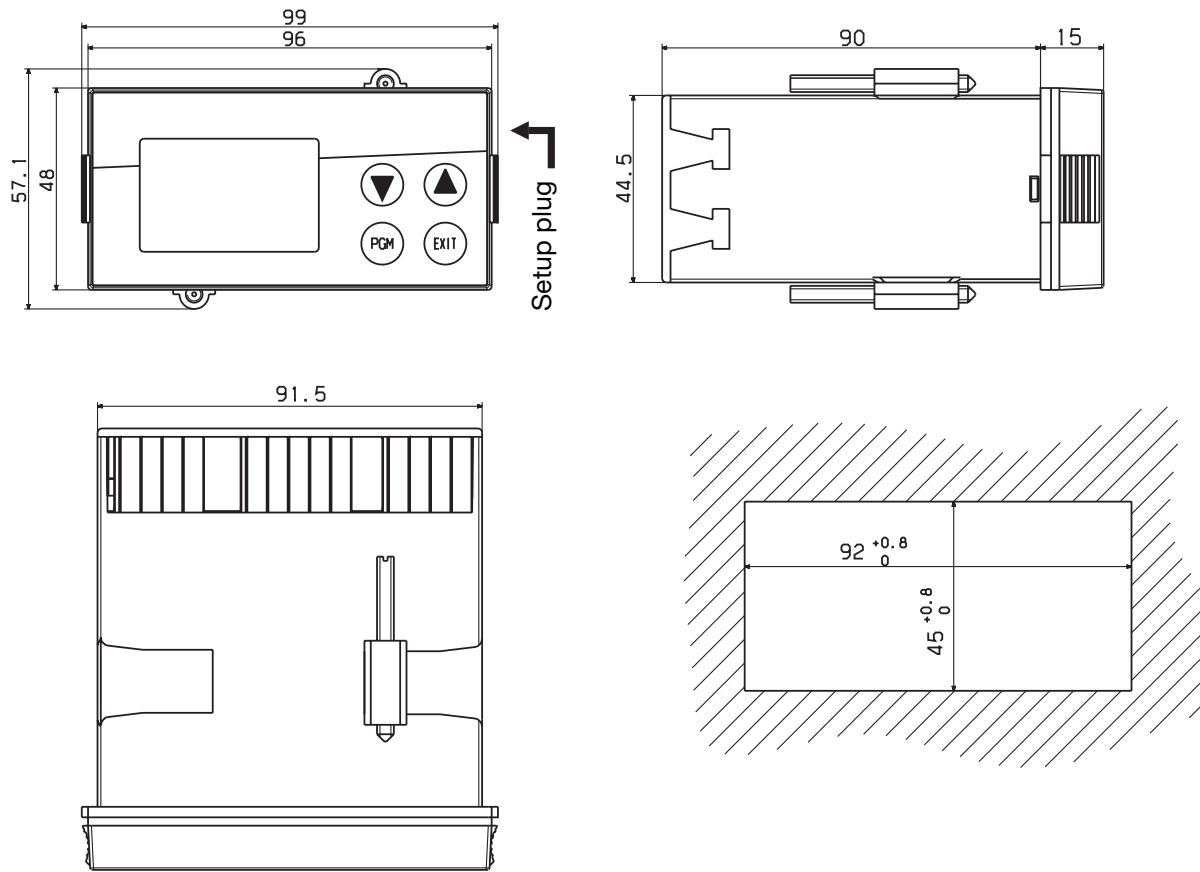

3.2.3 Type 703041

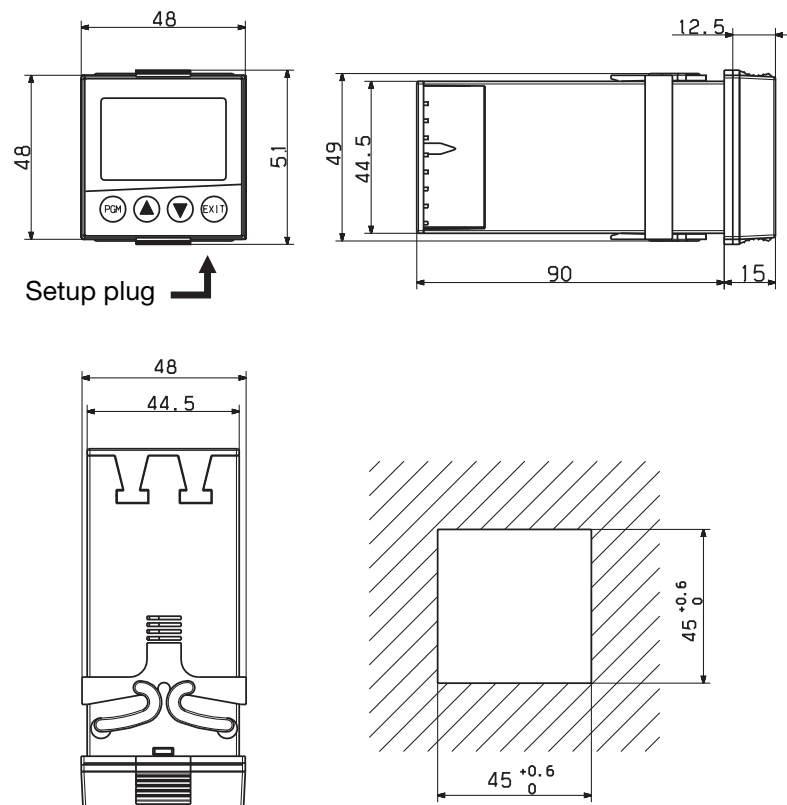


3.3 Side-by-side mounting

Minimum spacing of panel cut-outs		
Type	horizontal	vertical
without setup plug:		
703041 (48mm x 48mm)	11 mm	30mm
703042 (portrait format: 48mm x 96mm))	11 mm	30mm
703043 (landscape format: 96mm x 48mm)	30mm	11 mm
703044 (96mm x 96mm)	11 mm	30mm
with setup plug (see arrow):		
703041 (48mm x 48mm)	11 mm	65mm
703042 (portrait format: 48mm x 96mm))	11 mm	65mm
703043 (landscape format: 96mm x 48mm)	65mm	11 mm
703044 (96mm x 96mm)	11 mm	65mm

3.4 Fitting in position


Type 703042/43/44

- * Fit the seal that is supplied onto the instrument body.
- * Insert the controller from the front into the panel cut-out.
- * From behind the panel, slide the mounting brackets into the guides on the sides of the housing.
The flat faces of the mounting brackets must lie against the housing.
- * Push the mounting brackets up to the back of the panel, and tighten them evenly with a screwdriver.

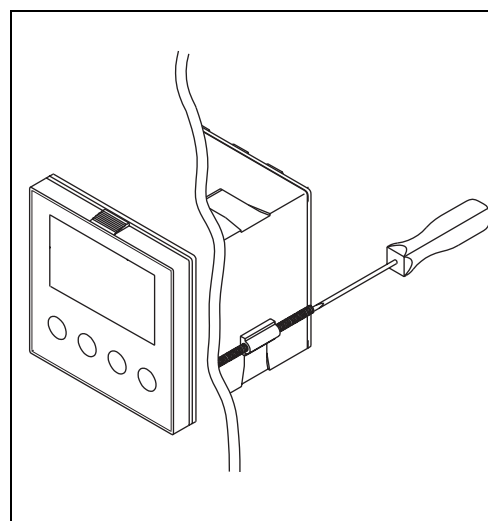

Type 703041

- * Fit the seal that is supplied onto the instrument body.
- * Insert the controller from the front into the panel cut-out.
- * From the back of the panel, push the mounting frame onto the instrument body and press it against the back of the panel, compressing the springs, until the latches snap into the notches provided and it is firmly fixed in position.

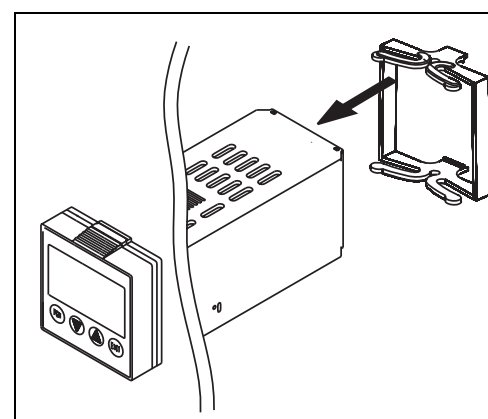

Care of the front panel


The front panel can be cleaned with normal commercial washing, rinsing and cleaning agents. It has a limited resistance to organic solvents (e.g. methylated spirits, white spirit, P1, xylol etc.). Do not use high-pressure cleaning equipment.

3 Mounting

3.5 Removing the controller module

The controller module can be removed from its housing for servicing.

- * Press together the knurled areas (top and bottom, or left and right for landscape format) and pull out the controller module.

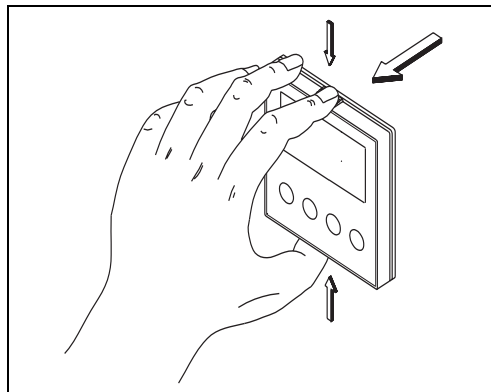


When inserting the controller module, make sure that the latches (below the knurled areas) snap into place.

4.1 Installation notes

- The choice of cable, the installation and the electrical connection must conform to the requirements of VDE 0100 "Regulations on the Installation of Power Circuits with Nominal Voltages below 1000 V" or the appropriate local regulations.
 - The electrical connection must only be carried out by qualified personnel.
 - If contact with live parts is possible while working on the unit, it must be disconnected from the supply on both poles.
 - A fuse interrupts the supply circuit in the event of a short-circuit. The load circuit must be fused for the maximum relay current, in order to prevent the output relay contacts becoming welded in the event of a short circuit.
 - Electromagnetic compatibility conforms to the standards and regulations cited in the technical data.
- ⇒ Chapter 12.1 "Technical data"
- Run input, output and supply cables separately and not parallel to one another.
 - Sensor and interface cables should be shielded cables with twisted conductors. Do not run them close to current-carrying components or cables. Ground the shielding on one side.
 - Do not connect any additional loads to the supply terminals of the instrument.
 - The instrument is not suitable for use in areas with an explosion hazard (Ex areas).
 - In addition to faulty installation, incorrect settings on the controller (setpoint, data of the parameter and configuration levels, internal alterations) can also interfere with the correct operation of dependent processes, or even cause damage. Safety devices should always be provided that are independent of the controller (such as overpressure valves or temperature limiters/monitors) and only capable of adjustment by specialist personnel. Please observe the relevant safety regulations for such matters. Since adaptation (self-optimization) can not be expected to handle all possible control loops, an unstable parameterization is theoretically possible. The stability of the actual value that is produced should therefore be checked.

4 Electrical connection

4.2 Electrical isolation

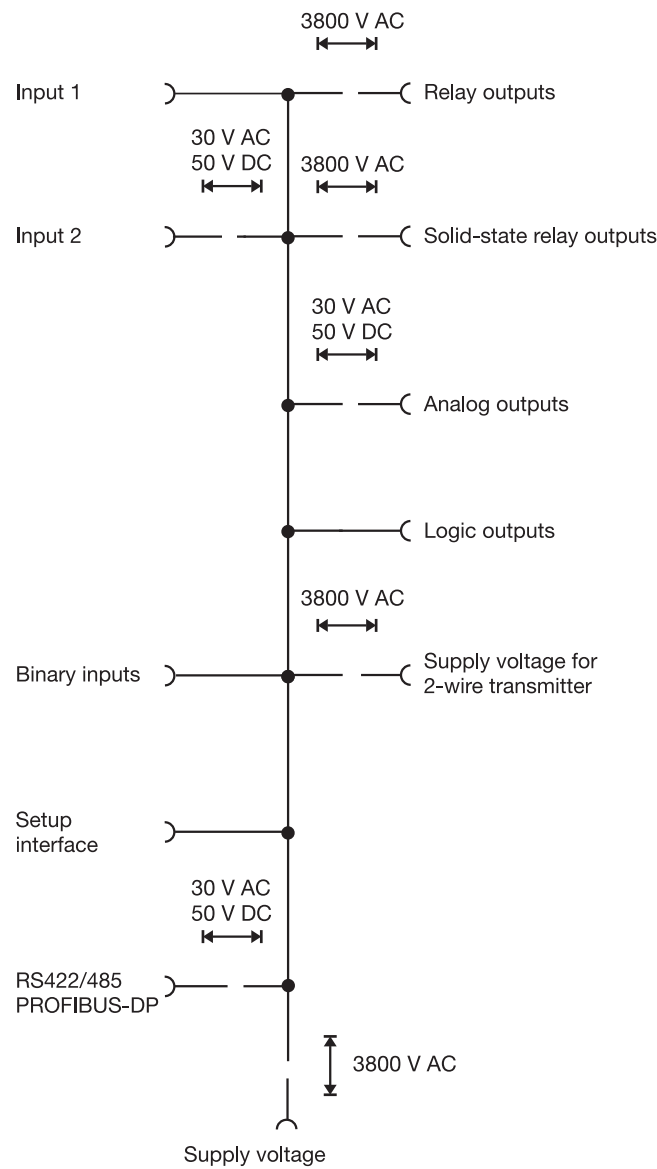

4 Electrical connection

4.3 Connection diagrams


4.3.1 Type 703041




The electrical connection must only be carried out by specialist personnel.




The instrument version can be identified by the typecode.

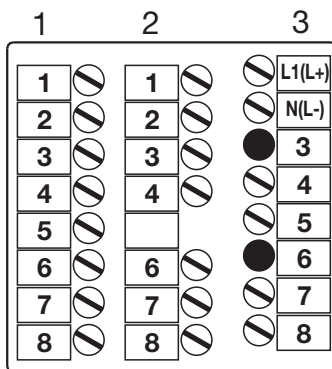


Terminal strip 3

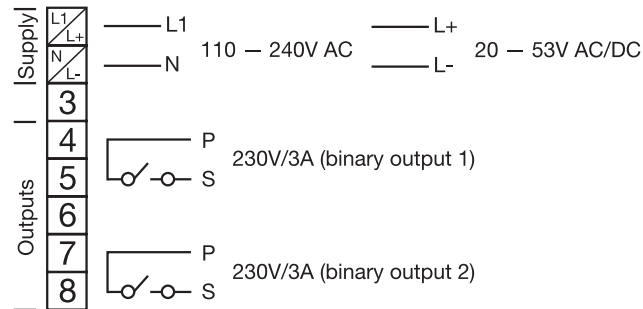

Terminal strip 2

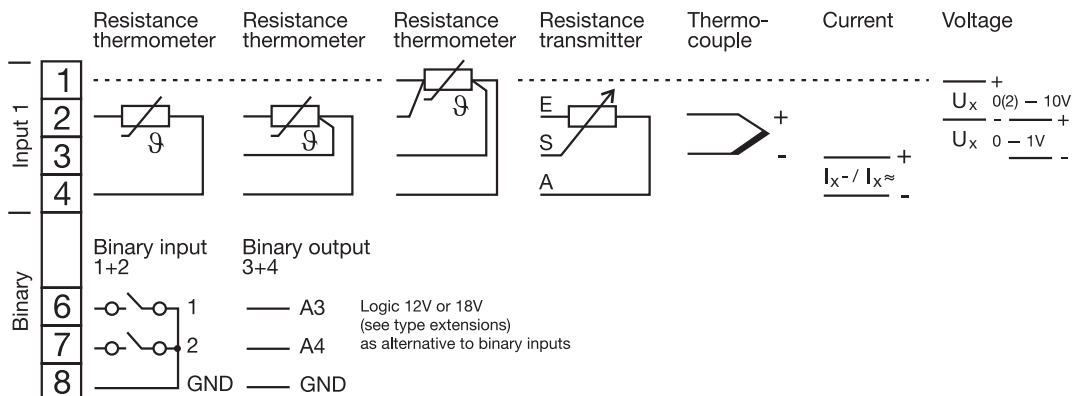

Terminal strip 1

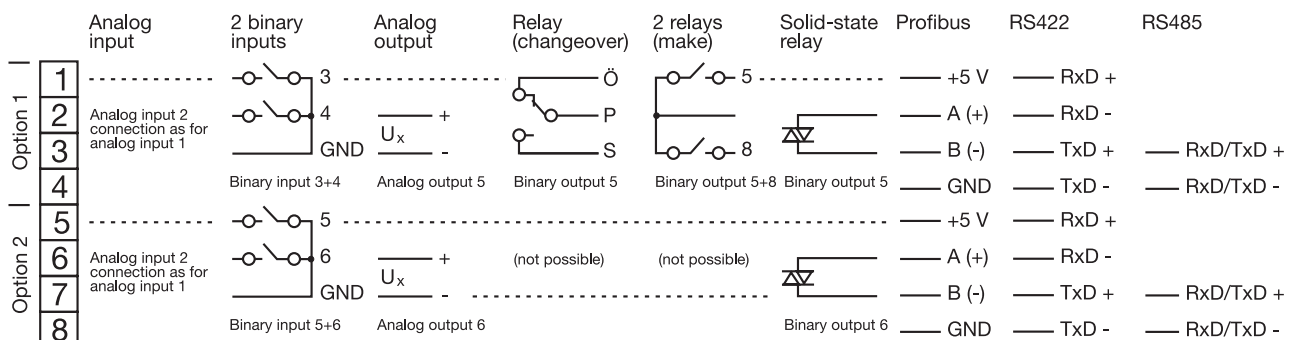

4 Electrical connection



4.3.2 Type 703042/43/44




The electrical connection must only be carried out by specialist personnel.



The instrument version can be identified by the type code.

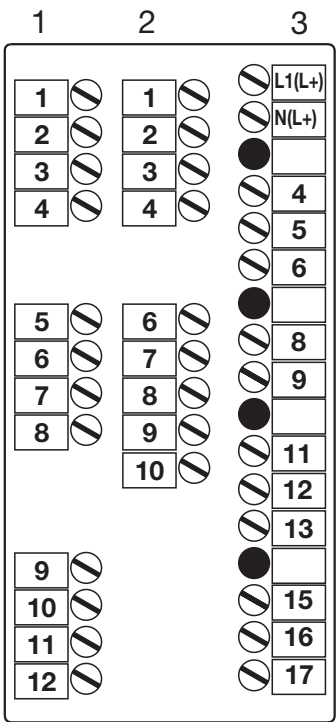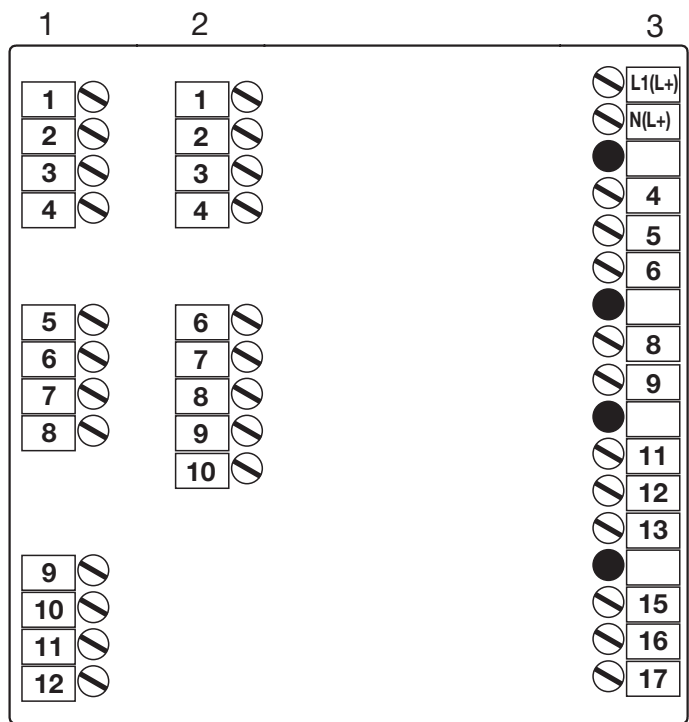


Terminal strip 3

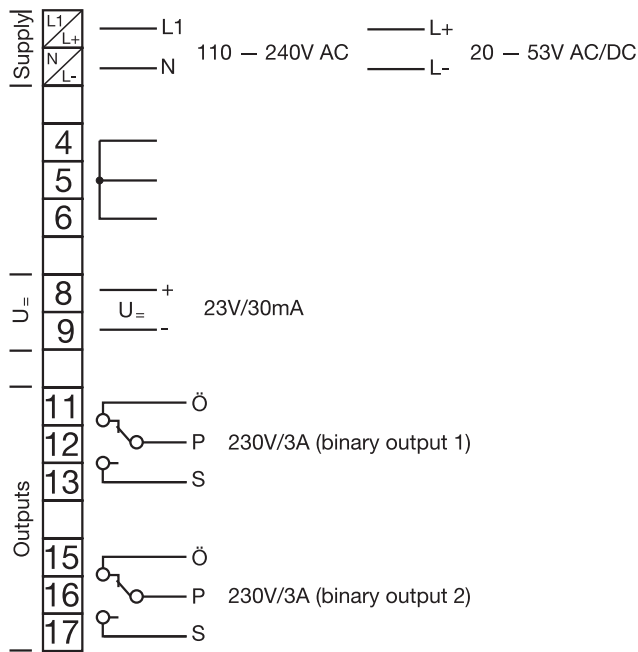


4 Electrical connection

Terminal strip 2

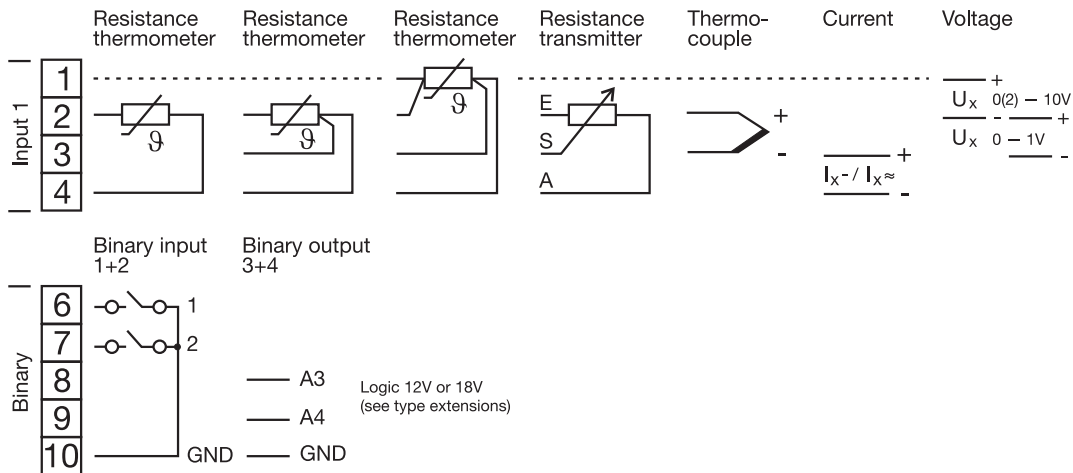


Terminal strip 1

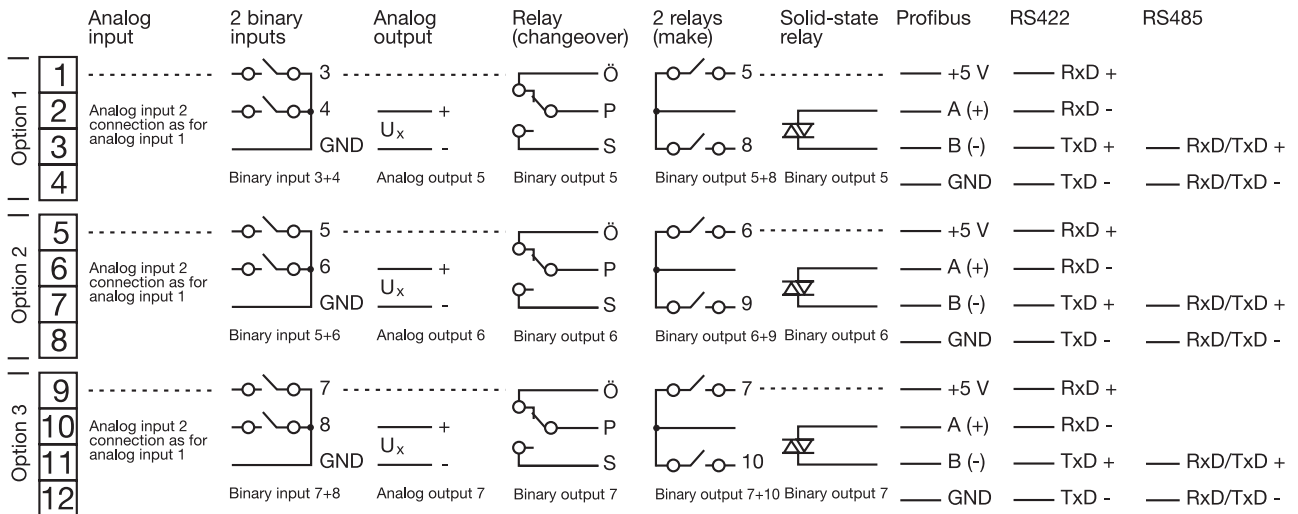

4 Electrical connection

5.1 Displays and keys

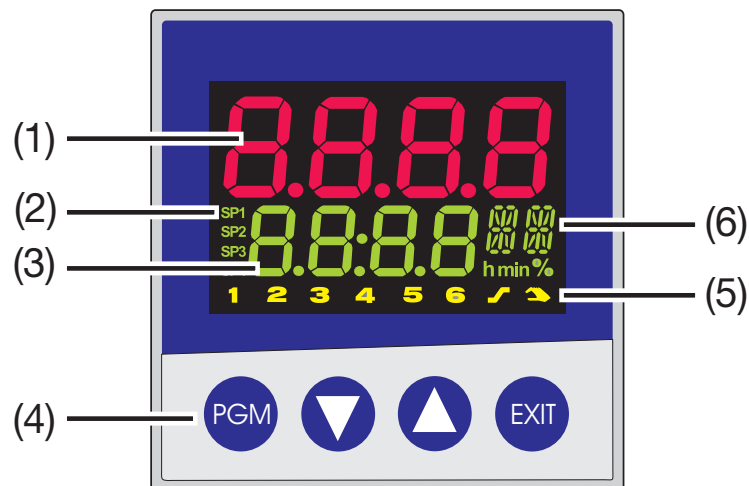

(1)	7-segment display (factory setting: process value) four-digit, red, decimal place is configurable (automatic adjustment on display overflow)
(2)	Active setpoint (factory setting: SP1) SP1, SP2, SP3, SP4 (SP=setpoint); green;
(3)	7-segment display (factory setting: setpoint) four-digit, green; decimal place is configurable; also used for operator prompting (display of parameter and level symbols)
(4)	Keys
(5)	Indication yellow, for - switch status of binary outputs 1 – 6 (display lights up = on) - ramp/program function is active - manual operation is active
(6)	16-segment display + dim. units two-digit, green; for the unit °C/°F and symbols for h, min, % In addition, the current segment number (program), the parameter set or any two-place letter/number combination can be displayed through the setup program.


The displays are configurable.

⇒ Chapter 8.7 “Display “diSP””

5 Operation

5.2 Level concept

The parameters for making the settings on the instrument are arranged at different levels.

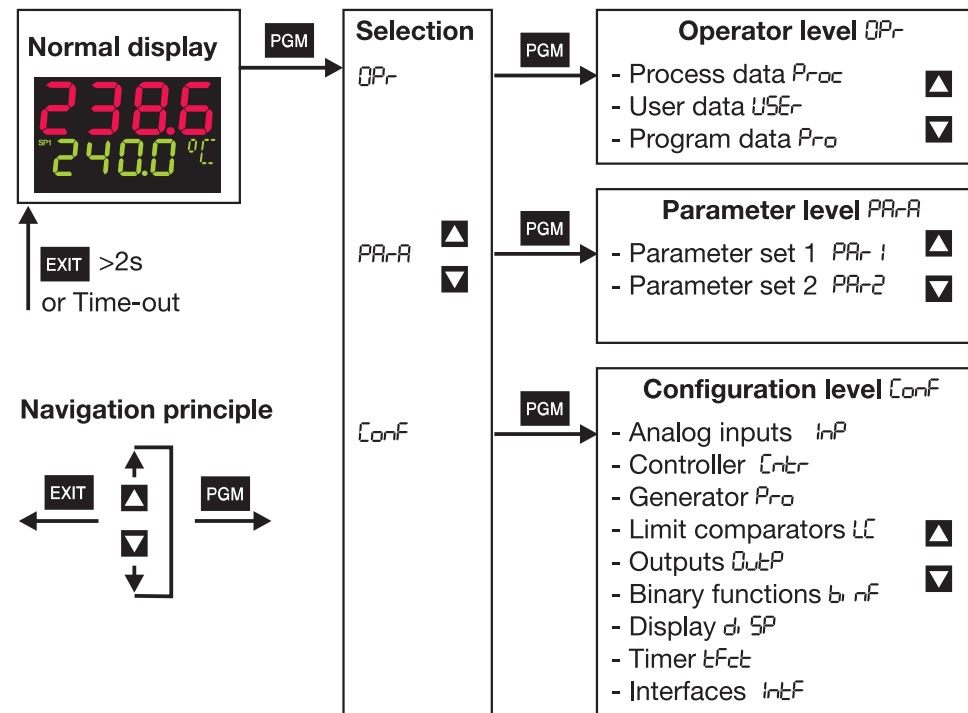

Time-out

If no key is pressed for 30sec, the instrument returns to normal display.

- ⇒ Chapter 6 “Operator level”
- ⇒ Chapter 7 “Parameter level”
- ⇒ Chapter 8 “Configuration”
- ⇒ Setup/Display - Operation/Time-out

5.3 Level inhibit

The access to the individual levels can be prevented.

Code	Operator level	Parameter level	Configuration level
0	enabled	enabled	enabled
1	enabled	enabled	inhibited
2	enabled	inhibited	inhibited
3	inhibited	inhibited	inhibited

- * Go to code entry with **PGM** and **▼** (simultaneously for >5sec).
- * Alter code with **PGM** (display blinks!)
- * Enter code with **▲** and **▼**. Ex-factory: all levels enabled.
- * Return to normal display with **EXIT** or automatically after approx. 30sec

The parameter and configuration levels can also be inhibited via the binary function.

- ⇒ Chapter 8.6 “Binary functions “binF””

5.4 Entries and operator prompting

Entering values


When entries are made within the levels, the parameter symbol is shown in the lower display.



- * Select parameter with ▲ or ▼
- * Change to entry mode with **PGM** (lower display blinks!)
- * Alter value with ▲ and ▼
The value alters dynamically with the duration of the key stroke.
- * Accept the setting with **PGM** or automatically after 2sec
or
- * Cancel entry with **EXIT**.
The value is not accepted.

Entering times

When entering times (e.g. timer time), the time unit is shown in addition.

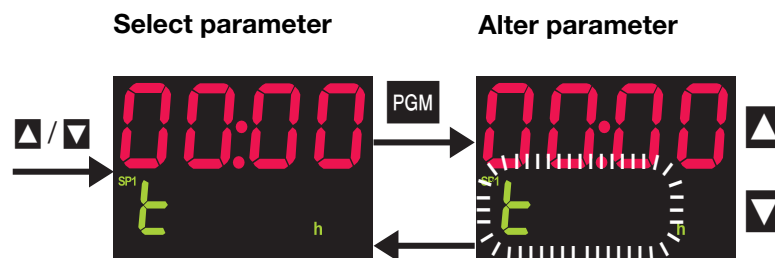


The highest time unit of the display is shown for the unit.

If, for instance, "h" is shown for the hour, then the time format for the value is hh:mm.

- * Select parameter with ▲ or ▼
- * Change over to the entry mode using **PGM** (lower display blinks!)
- * Alter value with ▲ and ▼
The value alters dynamically with the duration of the key stroke.
- * Accept the setting with **PGM** or automatically after 2sec
or
- * Cancel entry with **EXIT**.
The value is not accepted.

5 Operation

5.5 Operation of the fixed-setpoint controller

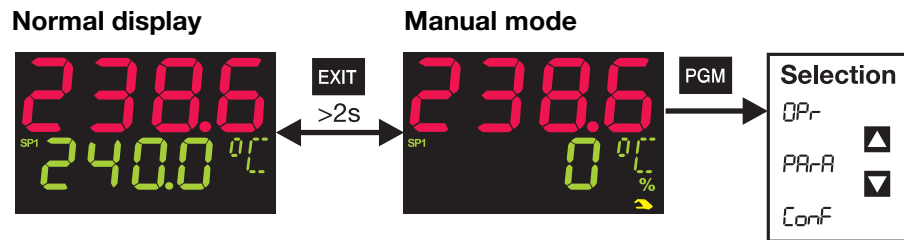

Altering the setpoint

In normal display:

- * Alter the present setpoint with ▲ and ▼ (the value is accepted automatically)

Manual mode

In manual mode, the controller output can be altered by hand.

- * Change to manual mode with **EXIT** (press for more than 2 seconds)

The output appears in the lower display. The hand symbol and the unit “%” light up in addition.

- * Alter the output with ▲ and ▼

In the case of a modulating controller, the actuator is opened or closed using the keys.

The various levels can be accessed from the manual mode.

- * Return to the normal display with **EXIT** (press for more than 2 seconds)


The output entry on a changeover is configurable. The manual mode can be inhibited.

⇒ Chapter 8.2 “Controller “Cntr””

Additional operating options for the fixed-setpoint controller can be implemented via the binary functions.

⇒ Chapter 8.6 “Binary functions “binF””

5.6 Operation of the program controller

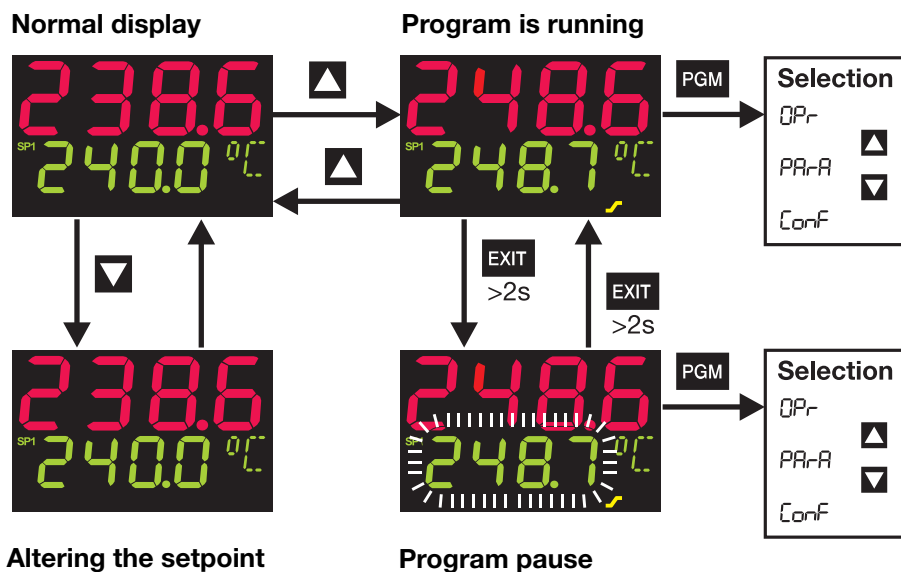

Normal display

No program run in normal display, the controller controls to the selected setpoint.

Altering the setpoint

From normal display:

- * Change to setpoint input with
- * Alter the present setpoint with and (the value is accepted automatically)

Starting the program

From normal display:

- * Start program with (the ramp symbol lights up!)

A delay time can be configured through the setup program. When the delay time has elapsed, "Start" is shown in the lower display, and then the program is processed.

Canceling the program

When the program is running:

- * Cancel program with

Pausing the program

When the program is running:

- * Pause program with **EXIT** (press for more than 2 seconds) (the lower display blinks!)
- * Continue with **EXIT** (press for more than 2 seconds)

The program is canceled in the event of a power failure.

Additional program control functions via binary functions.


⇒ Chapter 8.6 "Binary functions "binF""

5 Operation

5.6.1 Entering programs

Function

A setpoint profile can be implemented with a maximum of 8 program segments.

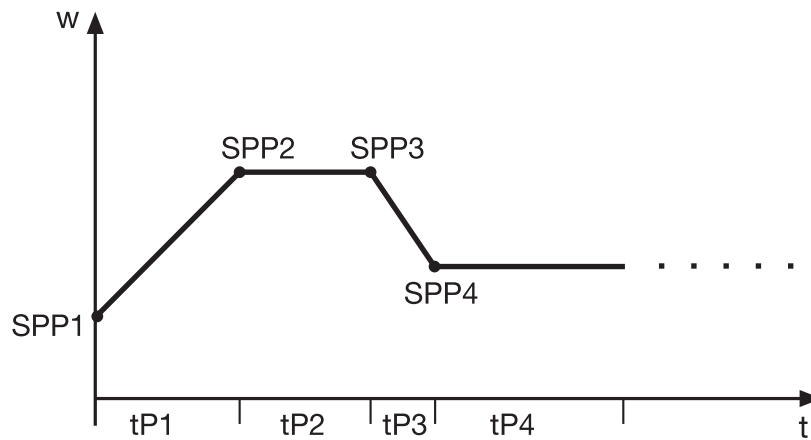

Entry on the instrument


The instrument must be configured as a program controller/generator.

⇒ Chapter 8.3 “Generator “Pro”” (Function)

Configurable time base: mm:ss, hh:mm und dd:hh (s=seconds, m=minutes, h=hours, d=days).


⇒ Chapter 8.3 “Generator “Pro”” (unit)

The segment setpoints (SPP1 — SPP8) and segment times (tP1 — tP8) are set at the operator level (program data).

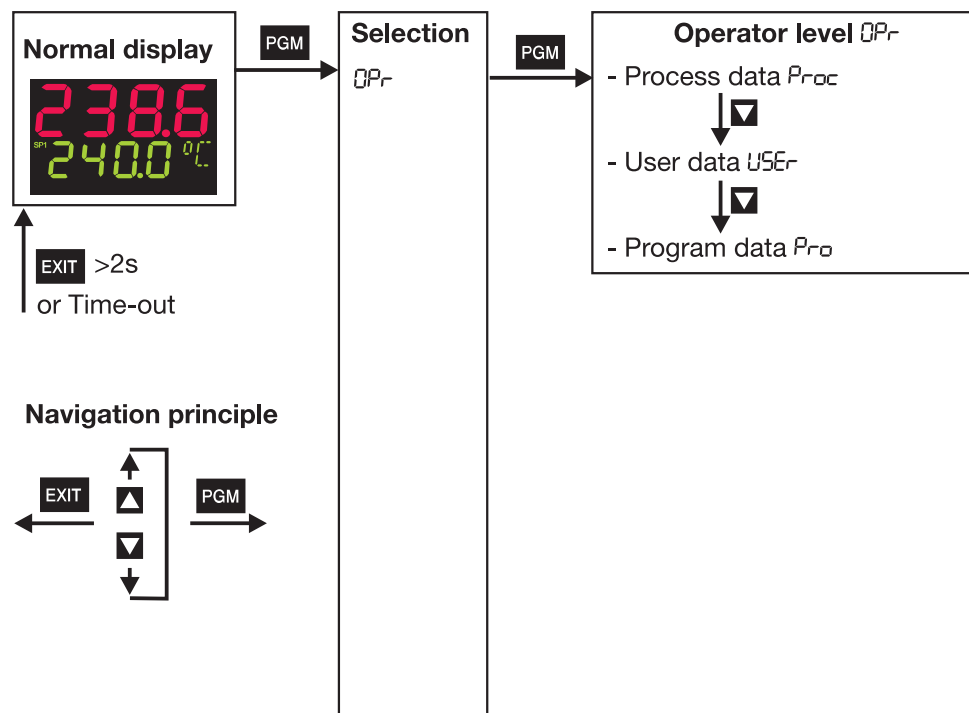

5 Operation

The program segments (up to eight) are defined by the segment setpoint and the segment time.

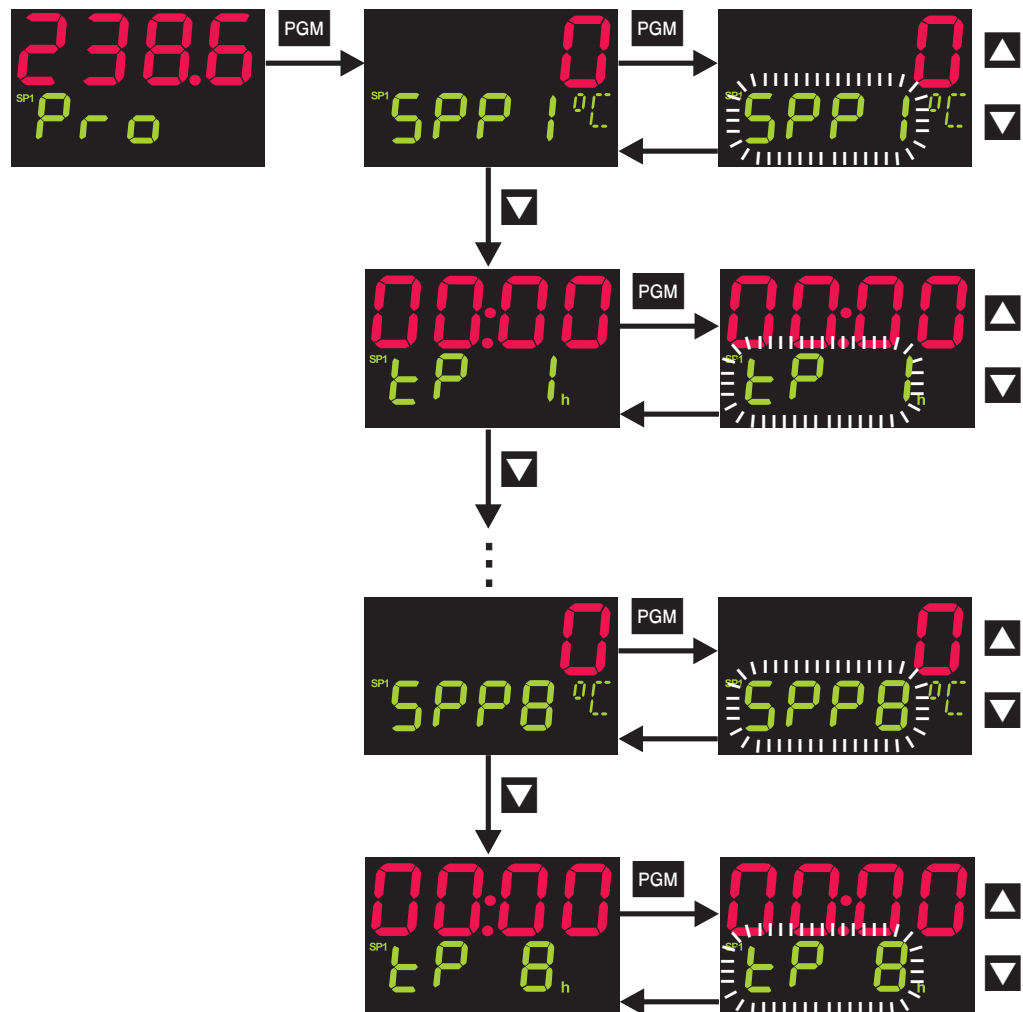

Entry through setup program

The setup program (accessory) features a user-friendly program editor, with a graphical presentation of the program profile.


Additional functions via the setup program

- Start at the process value
- Response to over/underrange
- Repeat program
- Setpoint input (ramp/step)
- Process is controlled to the most recent setpoint
- Delay time
- Program editor/management with graphical preview
- Up to four control contacts can be programmed segment by segment
- Parameter sets can be assigned segment by segment

5 Operation

5.6.2 Shifting the program profile


The function “External setpoint with correction” can be used to shift the program profile upwards or downwards (configurable through the setup program only).

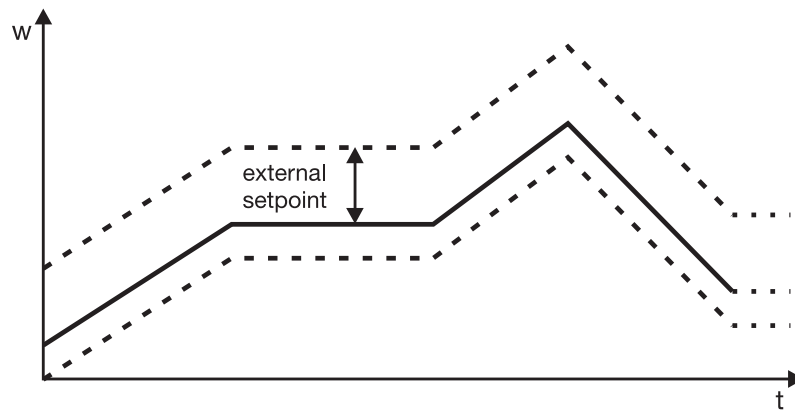

The external setpoint is defined via an analog signal.

⇒ Chapter 8.2 “Controller “Cntr””

Access

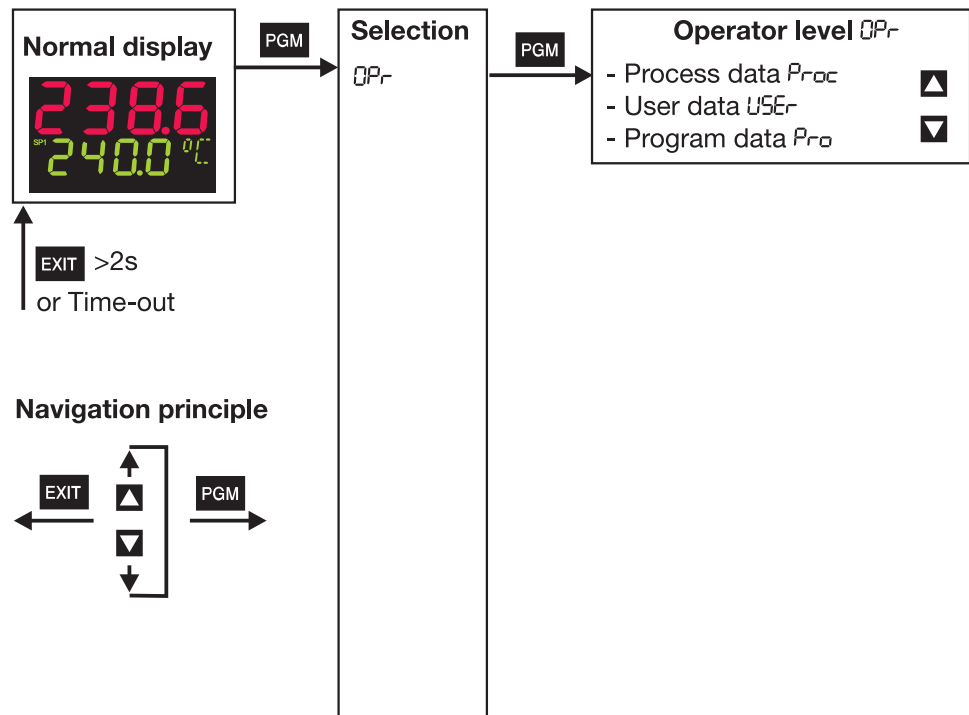


Process data “Proc”

The four setpoints are displayed and edited here, and additional process variables are shown in accordance with the configuration.

Symbol	Meaning
SP_1	Setpoint 1 (editable)
SP_2	Setpoint 2 (editable)
SP_3	Setpoint 3 (editable)
SP_4	Setpoint 4 (editable)
SP_r	Ramp setpoint (only if configured)
INP_1	Measurement of analog input 1
INP_2	Measurement of analog input 2 (only if available)
F_1	Calculated result of math formula 1 (only if available)
F_2	Calculated result of math formula 2 (only if available)
y	Controller output
t_{run}	Program run time (only with program controller/generator)
t_{res}	Residual program time (only with program controller/generator)
t_1	Timer: time 1 (only if configured)
t_2	Timer: time 2 (only if configured)

6 Operator level

Definition of the program times

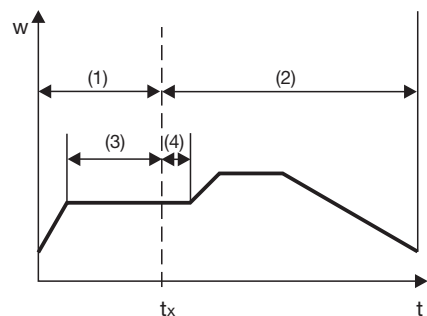

(1) Program time	(3) Segment time
(2) Residual program time	(4) Residual segment time

User data “USER” Any number of parameters (up to eight) can be displayed and edited here using the setup program.

⇒ Setup/Configuration level/Display - Operation/User data

The user himself can assign the symbol that is to be displayed for each parameter. Otherwise the standard symbol is used. Any letters and numbers are permitted that can be displayed in a 7-segment display.

Program data “Pro” A program with up to eight segments is defined here, via the segment setpoints $SPP\ 1 \dots SPP\ 8$ and segment times $tP\ 1 \dots tP\ 8$.


This can only be accessed when the instrument is configured as a program controller/generator.

7 Parameter level

General

Two parameter sets (PAr1 and PAr2) can be stored.

Access

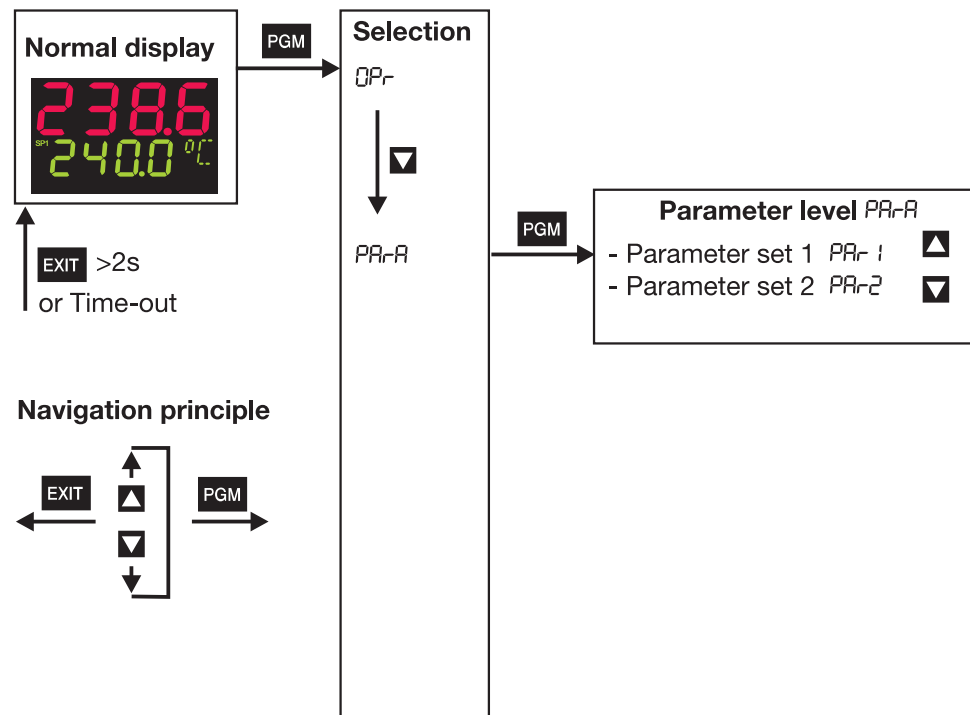

The level can be inhibited.

Applications

- Parameter set switching via binary function
⇒ Chapter 8.6 “Binary functions “binF””
- Allocating parameter sets to program segments (only through the setup program)
⇒ *Program editor/Program*


Example

Setting a 2-state controller with PI action:

Pb1=12°C (proportional band)
rt=160sec (reset time; I component)
dt=0sec (derivative time, D component)

7 Parameter level

PARA → PAR 1 (PAR 2)

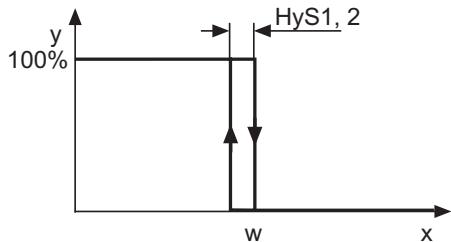Parameter	Display	Value range	Factory setting	Meaning
Proportional band	Pb 1	0...9999	0	Size of the proportional band
	Pb 2	0...9999	0	The gain of the controller decreases with increasing proportional band. With Pb 1,2 = 0 the controller structure is ineffective (limit comparator response). Continuous controllers: Pb1,2 must be >0.
Derivative time	dt	0...9999 s	80 s	Influences the differential component of the controller output signal The effect of the D component increases with increasing derivative time.
Reset time	rt	0...9999 s	350 s	Influences the integral component of the controller output signal The effect of the I component decreases with increasing reset time.
Actuator time	tt	5...3000 s	60 s	Actuator time range used by the control valve for modulating controllers.
Cycle time	Cy 1	0.0...999.9 s	20 s	With a switched output, the cycle time should be chosen so that a) the pulsed energy flow to the process does not cause any impermissible PV fluctuations and b) the switching elements are not overloaded.
	Cy 2	0.0...999.9 s	20 s	
Contact spacing	db	0.0...999.9	0	The spacing between the two control contacts for 3-state or modulating controllers.
Switching differential	HyS 1	0.0...999.9	1	Hysteresis for switching controllers with Pb1,2 = 0. 
	HyS 2	0.0...999.9	1	
Working point	y0	-100...+100%	0%	Output for P and PD controllers (when x = w then y = y0).
Output limiting	y 1	0...100%	100%	The maximum limit for the output.
	y 2	-100...+100 %	-100%	The minimum limit for the output.

The parameters Pb2, Cy2, HyS2 and y2 refer to the second controller output for a 3-state or modulating controller.

The decimal place of some parameters depends on the decimal place setting in the displays.



The parameter display on the instrument depends on the controller type selected.

⇒ Chapter 8.2 “Controller “Cntr””

8 Configuration

General

The following applies to the representation of parameters and functions at the configuration level:

The parameter is not displayed or can not be selected if

- the equipment level does not permit the function assigned to the parameter.


Example: Analog output 2 can not be configured if
analog output 2 is not implemented in the instrument.



Some parameters can only be programmed through the setup program. These are marked in the symbol column with “(setup)”.

The symbol (appears in the display) that corresponds to the menu item is shown in the chapter headings (e.g. 8.1 Analog inputs “InP”).

Access

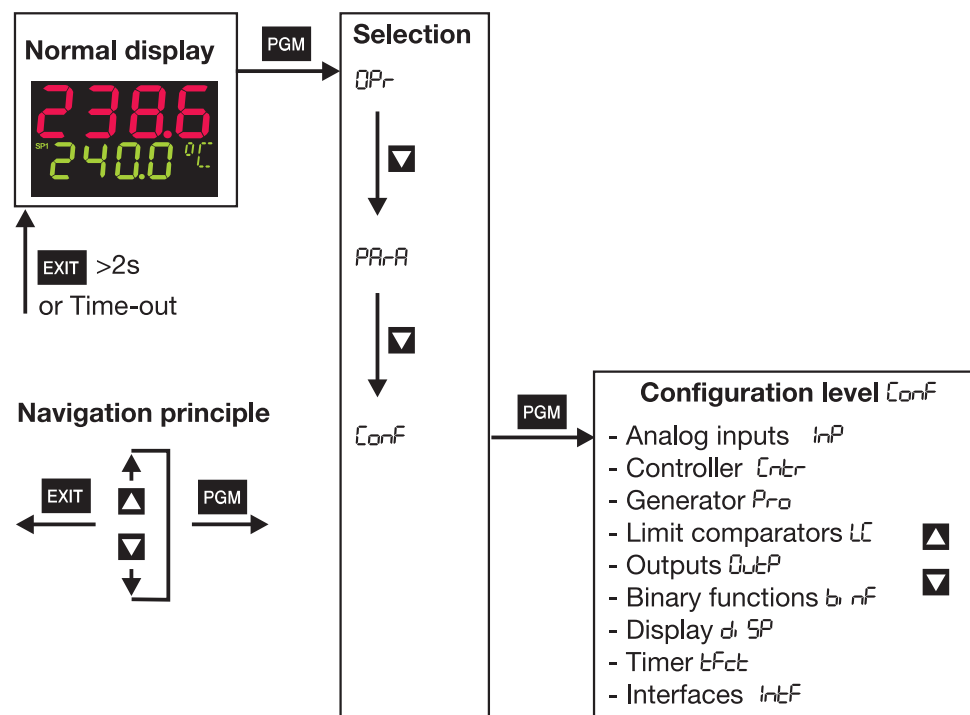

Levels can be inhibited.

⇒ Chapter 5.3 “Level inhibit”

8 Configuration

Analog selector

With some parameters, you can choose from a series of analog values. To provide you with an overview, this selection is listed below.

- 0 no function

1 analog input 1

2 analog input 2

3 process value

4 present setpoint

5 ramp end value

6 program setpoint

7 math 1

8 math 2

9 setpoint 1

10 setpoint 2

11 setpoint 3

12 setpoint 4

13 controller output level

14 controller output 1

15 controller output 2
- 21 program run time in sec

22 residual program time in sec

23 segment run time in sec

24 residual segment time in sec

25 timer run time for timer 1 in sec

26 timer run time for timer 2 in sec

27 residual run time for timer 1 in sec

28 residual run time for timer 2 in sec

29 present segment end value


30 analog marker (Profibus)

31 any analog value from storage address (only via setup program)

32 internal Pt100 in Ohm

33 sampling cycle time in msec

Definition of the program times

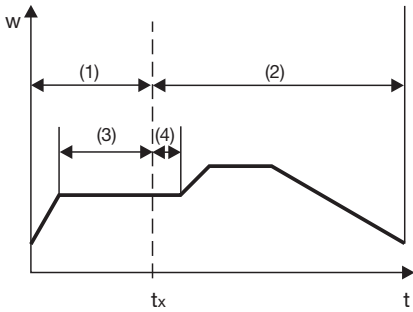

(1) Program time	(3) Segment time
(2) Residual program time	(4) Residual segment time

8.1 Analog inputs “InP”

Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

Depending on the instrument version, up to two analog inputs are available.

Analog input 1 InP1 →
Analog input 2 InP2 →

	Symbol	Value/selection	Description
Sensor type	SEnS	0 1 2 3 4 5 6 7 8 9 10 11	no function Resistance thermometer in 3-wire circuit Resistance thermometer in 2-wire circuit Resistance thermometer in 4-wire circuit Thermocouple Resistance transmitter Heater current 0 – 50mA AC (analog input 2 only) 0 – 20mA 4 – 20mA 0 – 10V 2 – 10V 0 – 1V
			factory-set on analog input 2: no function
Linearization	Li n	0 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18	Linear Pt100 Pt500 Pt1000 KTY11-6 W5Re_W26Re C W3Re_W25Re D NiCr-Con E Cu-Con T Fe-Con J Cu-Con U Fe-Con L NiCr-Ni K Pt10Rh-Pt S Pt13Rh-Pt R Pt30Rh-Pt6Rh B NiCrSi-NiSi N W3Re_W26Re customized linearization
			For customized linearization, a maximum of 10 knee-points can be implemented, or a 5th order polynomial function programmed (only through the setup program). For the linearization “KTY11-6”, the resistance is 2kΩ at 25°C (only through the setup program).

Factory settings are shown **bold**.

8 Configuration

Analog input 1 $I_{NP1} \rightarrow$
Analog input 2 $I_{NP2} \rightarrow$

	Symbol	Value/selection	Description									
Measurement offset	OFFS	-1999... 0 ... +9999	The measurement offset is used to correct a measured value by a certain amount upwards or downwards. Examples: <table><tr><td>Measured value</td><td>offset</td><td>Displayed value</td></tr><tr><td>294.7</td><td>+0.3</td><td>295.0</td></tr><tr><td>295.3</td><td>- 0.3</td><td>295.0</td></tr></table>  The controller uses the corrected value (= displayed value) for its calculation. This value is not the same as the actually measured value. If incorrectly applied, this can result in impermissible values of the control variable. Special case: 2-wire circuit If the input is connected to a resistance thermometer in 2-wire circuit, then the lead resistance is set in ohms here.	Measured value	offset	Displayed value	294.7	+0.3	295.0	295.3	- 0.3	295.0
			Measured value	offset	Displayed value							
294.7	+0.3	295.0										
295.3	- 0.3	295.0										
Display start	5CL	-1999...0...+9999	On transducers with standard signal and on potentiometers, a display value is assigned to the physical signal.									
Display end	5CH	-1999...100...+9999	Example: 0 — 20mA $\triangle$ 0 — 1500°C. The range of the physical signal can be 20 % wider or narrower without generating an out-of-range signal.									
Filter time constant	dF	0...0.6... 100 s	To adjust the digital input filter (0sec = filter off). 63% of the alterations are acquired after 2x filter time constant at a signal step change. When the filter time constant is large: - high damping of disturbance signals - slow reaction of the process value display to process value changes - low limit-frequency (2nd order low-pass filter)									
Fine tuning start value	FtS	-1999... 0 ...+9999	see description on the following pages.  Unlike all the other settings, entry of the start and end value is linked to the latest measurement at the input concerned. As a rule, these values can not be adopted by another instrument.									
Fine tuning end value	FtE	-1999...1 ...+9999										
Heater current monitoring (output)	HEAL	0 1...10	No function Output 1—10 The AC heater current can be measured by using a current transformer on analog input #2. An alarm can be configured by using the LK-1 function and sent to a relay while the monitoring is active.									
KTY correction value at 25°C	(setup)	0...2000...4000 Ω	Resistance at 25°C/77°F for linearization “KTY 11-6”									

Factory settings are shown **bold**.

Analog inputs (general) in 12 →


Symbol	Value/selection	Description
Temperature unit	Unit	0 deg. Celsius
		1 deg. Fahrenheit
		Unit for temperature values
Sampling cycle time	CYC	0 50msec
		1 90msec
		2 150msec
		3 250msec
Supply frequency	(setup)	50Hz
		60Hz
		Adaptation of the conversion time of the input circuitry to the supply frequency

Factory settings are shown **bold**.

Customized fine tuning

A signal is processed electronically (conversion, linearization ...) to produce a measured value via the analog inputs of the controller. This measured value enters into the calculations of the controller and can be visualized in the displays (measured value = displayed value).

This fixed relationship can be modified if required, i.e. the position and the slope of the measurement characteristic can be altered.

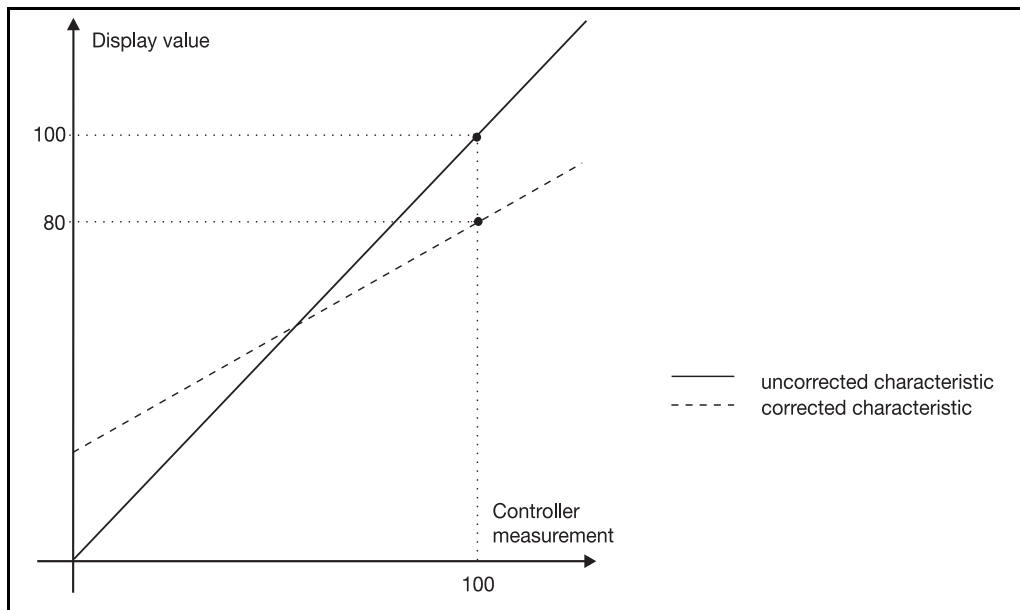

8 Configuration

Procedure


Apply two measurement points ((1), (3)), one after another, to the controller; they should be as far apart as possible.

At these measurement points, enter the required display value (start value FtS, end value FtE) in the controller. A reference instrument is most convenient for determining the measured values M1 and M2.

Measurement conditions must remain stable during programming.

Programming

- * Move to measurement point (1)
- * Enter start value (2)¹
- * Move to measurement point (3)
- * Enter end value E (4)¹

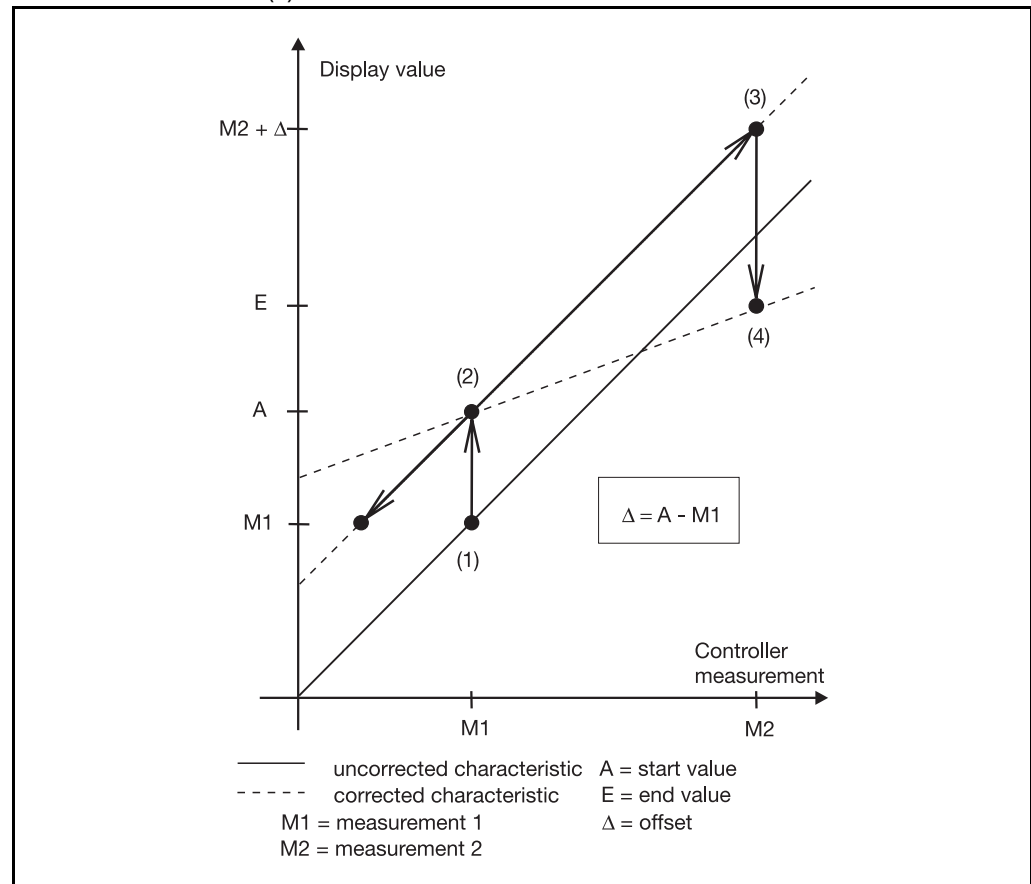

 If fine tuning is carried out without a reference instrument, the offset Δ must be taken into account when moving to measurement point (3).

To undo fine tuning, the start and end values (FtS, FtE) have to be programmed to the same value. This automatically sets the start value to 0 and the end value to 1.


Any subsequent fine tuning will otherwise be based on the corrected characteristic.

1. If start value=0 or end value=1 is to be set, then the value must first be altered using  or  to enable correction.

8.2 Controller “Cntr”

Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

The following are set here: controller type, input variables of the controller, the setpoint limits, conditions for manual mode and the presettings for autotuning (self-optimization).

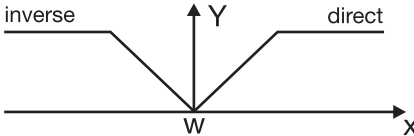	Symbol	Value/selection	Description
Configuration			
Controller type	CTYP	0 1 2 3 4	no function 2-state controller 3-state controller Modulating controller Continuous controller
Control action	CACT	0 1	Direct Inverse  inverse: The controller output Y is > 0 when the process value is smaller than the setpoint (e. g. heating). direct: The controller output Y is > 0 when the process value is larger than the setpoint (e. g. cooling).
Inhibit manual mode	INHd	0 1	enabled inhibited If the manual mode is inhibited, changing over to “manual” is not possible from the keys or via the binary input.
Manual output	HAmd	-100... 101	Defines the controller output level after changing over to manual mode. 101 = last output
Range output	ROUT	-100... 0 ...101	Output on over/underrange. 101 = last output
Setpoint low	SPL	- 1999 ...+9999	Setpoint limiting prevents the input of values outside the defined range.  The setpoint limits are not effective with setpoint input via the interface. The correction value is limited for external setpoint with correction.
Setpoint high	SPH	-1999...+ 9999	

Factory settings are shown **bold**.

8 Configuration


	Symbol	Value/selection	Description
Inputs			
Controller process value	$\overline{P_r}$	(analog selector) Analog inp. 1	Defines the source for the process value of the control channel. ⇒ See “Analog selector” on Page 32.
External setpoint	$\overline{ESP}$	(analog selector) switched off	Activates the external setpoint input and defines the source for the external setpoint. ⇒ See “Analog selector” on Page 32. External setpoint with correction: External setpoint + setpoint 1 = present setpoint The external setpoint is corrected up or down from the keypad (setpoint 1). The display shows the present setpoint. Can only be adjusted through the setup program.
Output feedback	$\overline{FEEd}$	(analog selector) switched off	Defines the source for output feedback for a modulating controller. ⇒ See “Analog selector” on Page 32.
Autotuning			
Method of tuning	$\overline{tYPt}$	0 1	0 Oscillation method 1 Step response method ⇒ Chapter 9.1 “Autotuning (self-optimization)”
Inhibit tuning	$\overline{INHt}$	0 1	enabled inhibited The start of autotuning can be inhibited from the keys or through the binary function.
Output of tuning 1	$\overline{OEt1}$	0 1 2	Relay Solid-state + logic Continuous The type of the physical output for the signal of the controller outputs 1 and 2 has to be defined.
Output of tuning 2	$\overline{OEt2}$		
Controller standby output	$\overline{SOUt}$	-100... 0 ...+100 %	Initial output with step response
Step size	$\overline{StS1}$	10... 30 ...100 %	Step size with step response

Factory settings are shown **bold**.

8.3 Generator “Pro”




Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

The basic function of the instrument is defined here. The instrument can be operated as a fixed-setpoint controller with or without a ramp function, or warm-up ramp for hot-channel equipment, program controller or program generator.

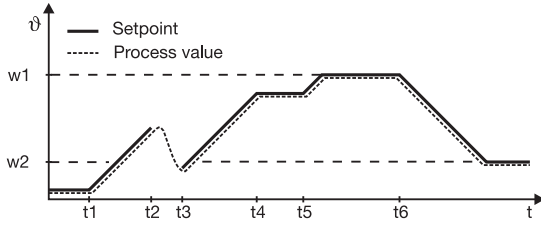	Symbol	Value/selection	Description
Function	General		
	Fnct	0 Fixed-setpoint controller 1 Ramp function 2 Program controller 3 Program generator 4 Hot-channel controller	Ramp function: A rising or a falling ramp function can be implemented. The ramp end value is determined by the setpoint input.  t1 Power on (w1 aktiv) t2...t3 Power failure / manual operation / probe break t4...t5 Ramp stop t6 Setpoint changeover to w2 The ramp function can be paused or canceled via the binary functions. ⇒ Chapter 8.6 “Binary functions “binF”  The ramp function is interrupted on a probe break, or for manual mode. The outputs react as for overrange/underrange (configurable). Program generator: The setpoint profile is output via a continuous output.
Unit of slope	Unit	0 °C/min 1 °C/hour 2 °C/day	Ramp function Program mm:ss hh:mm dd:hh s=seconds; m=minutes; h=hours; d=days Unit of ramp slope in °C per time unit, or format of segment times for program controller/generator.

Factory settings are shown **bold**.


8 Configuration

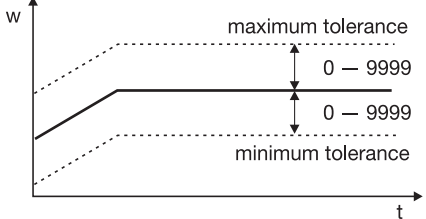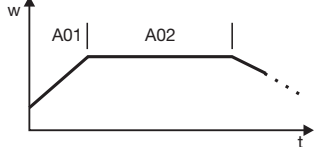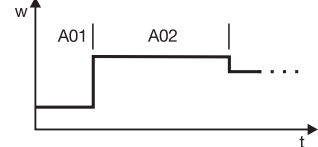	Symbol	Value/selection	Description
Ramp slope	rASL	0...9999	Value of slope for ramp function
Tolerance band	tOLP	0...999	0=off For a program controller/generator and ramp function, the process value can be monitored by applying a tolerance band around the setpoint profile. If the upper or lower limit is infringed, a tolerance limit signal is generated, which is internally processed or produced via an output.  0 = switched off Processing the tolerance limit signal, see: ⇒ Chapter 8.5 "Outputs "OutP"" ⇒ Chapter 8.6 "Binary functions "binF""
Program			
Program start	(setup)	Program start start at the process value	Defines whether the program starts with the first program setpoint or whether the present process value is accepted as the first program setpoint.
Range response	(setup)	Continue pause program	Defines the response to over/underrange
Response to power-on	(setup)	No start automatic start	Defines whether the program starts on connecting the supply voltage.
Program repeat	(setup)	none cyclic	The "Cyclic" setting has the effect of continuously repeating the program.
Setpoint input	(setup)	Ramp Step	Setpoint ramp  Setpoint step 
Control to the most recent setpoint	(setup)	inactive active	If active, the process is controlled to the most recent program setpoint after the program has ended.
Delay time	(setup)	0...9999 min	Delays the program start by an adjustable time. "Sett" is shown in the lower display.
Basic status			
Control contacts	(setup)	SK1 SK2 SK3 SK4	The four control contacts can be activated in the basic status (when the program is not running).

Factory settings are shown **bold**.

Hot-channel controller

The warm-up ramp for hot-channel equipment is used, for example, for the gentle operation of ceramic heater elements. Damage can be avoided by allowing moisture to evaporate slowly from the hygroscopic heater elements during the warm-up phase ($t_0 - t_2$).

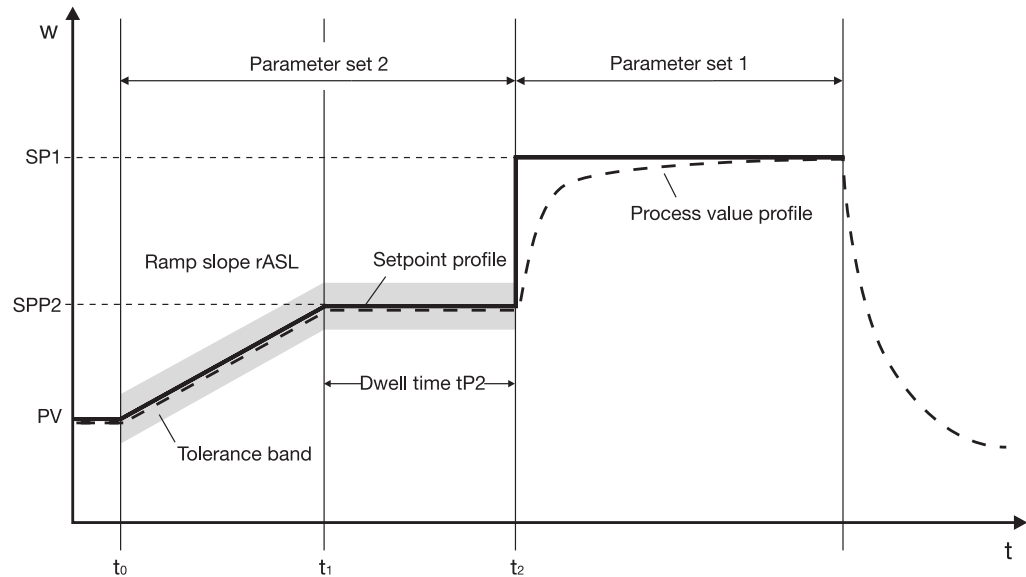

The present setpoint is accepted as the start value for the ramp at time t_0 . Within the time period $t_0 - t_1$, the programmed ramp slope $rASL$ is used to approach the hold setpoint $SPP2$. Within this period, the ramp setpoint is increased linearly. This is followed by the programmable dwell time $tP2$ ($t_1 - t_2$), after which the process is controlled to the present setpoint (factory setting: setpoint 1 ($SP1$)).

The hot-channel function, with the settings for the ramp function and the program, is implemented through the setup program.

Relevant settings:

Setup/Generator/General

- Ramp slope $rASL$ with time unit
- Tolerance band (optional)

Setup/Generator/Program

- Configure program start to "Start at process value"
- Define response after power-on; the warm-up ramp either starts automatically when switching on the supply voltage, or by pressing the  key.

Setup/Parameter level/Controller parameters

- Output limiting for parameter sets 1 and 2 (optional)

Setup/Program editor/Program

- Set parameter set 2 for segment 1 (segment setpoint and time are not taken into account)
- Configure segment 2 with segment setpoint (= hold setpoint $SPP2$), segment time (= dwell time $tP2$) and parameter set 2

Setup/Display - Operation/ User data

- Relevant parameters can optionally be placed in the user data (operator level)

8 Configuration

8.4 Limit comparators “LC”

Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

Limit comparators (threshold monitors, limit contacts) can be used to monitor an input variable (process value for the limit comparator) against a fixed limit or another variable (the setpoint for the limit comparator). When a limit is exceeded, a signal can be output or an internal controller function initiated.

4 limit comparators are available.

Limit comparator functions (lk)

Limit comparators can have different switching functions.

The hysteresis functions “asymmetrical, left” and “asymmetrical, right” can only be set through the setup program. The “symmetrical” hysteresis function is used as standard.

	Hysteresis function		
	asymmetrical, left	symmetrical	asymmetrical, right
lk1			
lk2			
lk3			
lk4			
lk5			
lk6			

8 Configuration

In the case of the limit comparator functions lk7 and lk8, the measurement that is set is monitored with respect to a fixed value AL.

Hysteresis function			
	asymmetrical, left	symmetrical	asymmetrical, right
lk7			
lk8			

Limit comparator 1 **LC1** →

Limit comparator 2 **LC2** →

Limit comparator 3 **LC3** →

Limit comparator 4 **LC4** →




Function	Symbol	Value/selection	Description
	Funct	0	no function
		1	lk1
		2	lk2
		3	lk3
		4	lk4
		5	lk5
		6	lk6
		7	lk7
		8	lk8
Limit value	AL	-1999... 0 ...+9999	Limit value to be monitored Limit range for lk1 and lk2: 0 — 9999
Switching differential	HYSt	0... 1 ...9999	Switching differential

Factory settings are shown **bold**.

8 Configuration

Limit comparator 1 $LC1 \rightarrow$
 Limit comparator 2 $LC2 \rightarrow$
 Limit comparator 3 $LC3 \rightarrow$
 Limit comparator 4 $LC4 \rightarrow$

Action/
range response

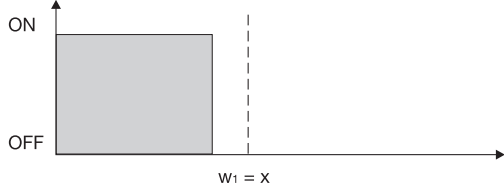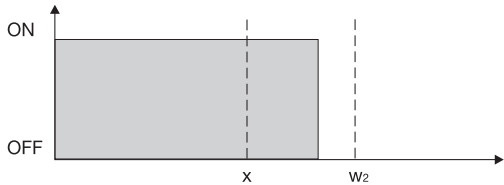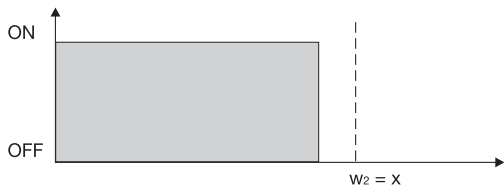Symbol	Value/selection	Description
ACR	0 absolute/off 1 relative/off 2 absolute/on 3 relative/on	Action: Defines the switching action of the limit comparators on a setpoint change or power-on. absolute: At the time of alteration, the limit comparator acts according to its function. relative: The limit comparator is in the OFF status. An alteration of the limit value or the (limit comparator) setpoint could cause the limit comparator to switch ON. Such a reaction will be suppressed, and this condition is maintained until the (limit comparator) process value has moved out of the switch-on region (gray area). Example: Monitoring the (controller) process value x with function lk4 Setpoint alteration $w_1 \rightarrow w_2$ a) Initial condition  b) Condition at the time of the alteration The limit comparator remains OFF, although the process value is within the switch-on region.  c) Stabilized condition The limit comparator again operates in accordance with its function.  This function also prevents a limit comparator from being triggered during the approach phase.
Switch-on delay	t_{ON} 0...9999	Delays the switch-on edge by a definable time period
Switch-off delay	t_{OFF} 0...9999s	Delays the switch-off edge by a definable time period

Factory settings are shown **bold**.

8 Configuration

Limit comparator 1 LC1 →
Limit comparator 2 LC2 →
Limit comparator 3 LC3 →
Limit comparator 4 LC4 →

	Symbol	Value/selection	Description
Acknowledgement	ACKL	0 1 2	no acknowledgement acknowledgement; only with inactive limit comparator acknowledgement; always possible For settings with acknowledgement, the limit comparator is latching, which means it remains ON, even when the switch-on condition is no longer present. The limit comparator must be reset via the ▼ + EXIT keys or binary signal.
Pulse time	tPUL	0... 9999s	The limit comparator is automatically reset after an adjustable time period.
Limit comparator PV	LCPr	(analog selector) switched off	see circuit diagrams ⇒ See “Analog selector” on Page 32.
Limit comparator SP	LCSP	(analog selector) switched off	see circuit diagrams (only with Ik1 — Ik6) ⇒ See “Analog selector” on Page 32.
Hysteresis function	(setup)	symmetrical asymmetrical, left asymmetrical, right	see circuit diagrams ⇒ Chapter 12.2 “Alarm messages”

Factory settings are shown **bold**.

8 Configuration

8.5 Outputs “OutP”

Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

Configuration of the instrument outputs are subdivided into analog outputs (OutA; max. 2) and binary outputs (OutL; max. 9). Binary outputs are relay, solid-state relay and logic outputs. Display and numbering of the outputs depends on the assignment of the option slots.

Numbering of the outputs

Standard for all instrument versions:

- (Binary) output 1 = relay
- (Binary) output 2 = relay
- (Binary) output 3 = logic output
- (Binary) output 4 = logic output

Extended numbering for the option slots:

Slot	Plug-in board with 1 analog output	Plug-in board with 1 binary output	Plug-in board with 2 binary outputs
Option 1	Output 5	Output 5	Output 5+8
Option 2	Output 6	Output 6	Output 6+9
Option 3	Output 7	Output 7	Output 7+10

The switching states of the binary outputs 1 — 6 are shown in the display.

8 Configuration

Binary outputs **OutL**

	Symbol	Value/selection	Description
Binary output 1	Out 1	0	no function
		1	Controller output 1
		2	Controller output 2
...	...	5	Binary input 1
		6	Binary input 2
Binary output 10	Out0	7	Binary input 3
		8	Binary input 4
		9	Binary input 5
		10	Binary input 6
		11	Binary input 7
		12	Binary input 8
		13	Limit comparator 1
		14	Limit comparator 2
		15	Limit comparator 3
		16	Limit comparator 4
		17	Control contact 1
		18	Control contact 2
		19	Control contact 3
		20	Control contact 4
		21	Logic formula 1
		22	Logic formula 2
		23	Timer 1 active
		24	Timer 2 active
		25	Program active
		26	Program end signal
		27	Tolerance limit signal
		28	Manual mode on/off
		29	Binary marker
		30	Any binary value from storage address (only through setup)
		31	always active
			Function of the binary output

Factory settings are shown **bold**.

8 Configuration

Analog outputs **OutA** → **Output 5 Out5** →
Output 6 Out6 →
Output 7 Out7 →

	Symbol	Value/selection	Description									
Function	<i>Fnct</i>	(analog selector) switched off	Function of the output ⇒ See “Analog selector” on Page 32.									
Type of signal	<i>S, Sn</i>	0 1 2 3	0 – 10V 2 – 10V 0 – 20mA 4 – 20mA Physical output signal									
Range output	<i>rOut</i>	0 ...101 %	Signal on going above/below range 101 = last output signal If the output is a controller output, the controller switches over to manual mode and produces the output level defined under “Controller”. The setting for rOut is not taken into account. ⇒ Chapter 8.2 “Controller “Cntr””									
Zero point	<i>OPnt</i>	-1999... 0 ...+9999	A physical output signal is assigned to the value range of an output variable. Example: Setpoint 1 (value range 150 to 500 °C) is to be output via an analog output (0 – 20mA). i.e.: 150 to 500°C <u>Δ</u> 0 – 20mA Zero point: 150 / End value: 500 Setting for controller outputs for cooling. The following settings have to be defined for 3-state controllers: Zero point: 0 / End value: -100									
End value	<i>End</i>	-1999... 100 ...+9999										
Offset	(setup)	-1999... 0 ...+9999	The offset is used to correct the output signal by a certain amount upwards or downwards. Examples: <table><tr><td>Original value</td><td>Offset</td><td>Output value</td></tr><tr><td>294.7</td><td>+0.3</td><td>295.0</td></tr><tr><td>295.3</td><td>- 0.3</td><td>295.0</td></tr></table>	Original value	Offset	Output value	294.7	+0.3	295.0	295.3	- 0.3	295.0
Original value	Offset	Output value										
294.7	+0.3	295.0										
295.3	- 0.3	295.0										

Factory settings are shown **bold**.

8.6 Binary functions “binF”


Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

Functions are assigned here to the binary signals of the binary inputs and limit comparators.

In addition, the functions for control contacts, tolerance limit signal and program end signal are defined for program controllers/generators.

In the case of a fixed-setpoint controller, functions can be assigned to the ramp end signals.

Switching action

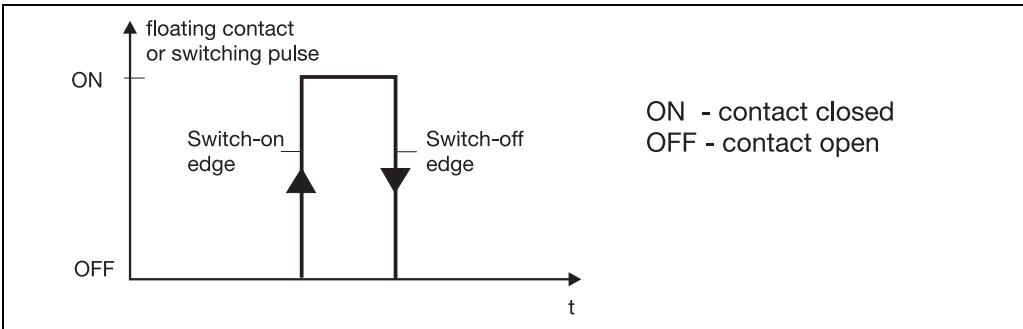

The functions are arranged in two groups:

Edge-triggered functions

The binary function reacts to switch-on edges.

The following functions are edge-triggered:

- Start/stop of autotuning
- Acknowledge limit comparators
- Program start/cancel
- Start timer
- Segment change

State-triggered functions

The binary function reacts to switch-on or switch-off states.

- All remaining functions

8 Configuration

	Symbol	Value/selection	Description
Binary input 1	b₁n1	0	no function
...		1	Start autotuning
Binary input 8	b₁n8	2	Cancel autotuning
Limit comparator 1	LC1	3	Change to manual mode
...		4	Controller off (controller outputs are switched off)
Limit comparator 4	LC4	5	Inhibit manual mode
Timer 1	EF1	6	Hold ramp
Timer 2	EF2	7	Cancel ramp
Logic 1	Lo1	8	Setpoint changeover
Logic 2	Lo2	9	Parameter set switching
Control contact 1	CC1	10	Key inhibit
...		11	Level inhibit
Control contact 4	CC4	12	Display "off" with key inhibit
Tolerance limit signal	tolS	13	Acknowledge limit comparators
Program end signal	PRE5	14	Inhibit program start
		15	Start program
		16	Pause program
		17	Cancel program
		18	Segment change
		19	Start timer 1
		20	Start timer 2
		21	Cancel timer 1
		22	Cancel timer 2
			Level inhibit: The parameter and configuration levels are inhibited.
			Program end signal: The signal is active after approx. 1 second (pulse)
			Text display: If the binary function is active, a configurable text is shown in the lower display. The text can be uniquely defined (only through the setup program).
			Type 703041: The settings for the binary inputs 1+2 have priority over those for the logic outputs.

Factory settings are shown **bold**.

Setpoint and parameter set switching

A binary function can be used to switch between setpoint 1 and setpoint 2 or parameter set 1 and parameter set 2.

Setpoint switching	Parameter set switching	Binary signal
Setpoint 1 active	Parameter set 1 active	0/contact open
Setpoint 2 active	Parameter set 2 active	1/contact closed

In order to switch between the four possible setpoints, two binary functions must be configured to "setpoint switching". The states of the two binary functions are designated Z1 and Z2 and switch the setpoints over as shown in the table below:

Setpoint	Z2	Z1
Setpoint 1	0	0
Setpoint 2	0	1
Setpoint 3	1	0
Setpoint 4	1	1

0 = contact open /OFF


1 = contact closed /ON

The states Z1 and Z2 are assigned to the binary functions in descending order (see list on the right), i.e. the first binary function selected in the list is Z1.

Control variable	State
Binary input 1	
...	
Binary input 8	
Limit comparator 1	
...	
Limit comparator 4	
Timer 1	Z1 Z2
Timer 2	
Logic formula 1	
Logic formula 2	
Control contact 1*	
...	
Control contact 4*	
Tolerance limit signal*	
Program end signal*	

* only for program controller/generator

Example:

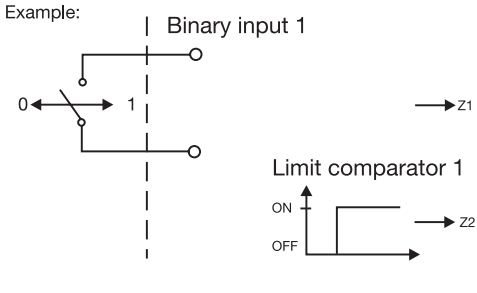

Example:


The setpoint is to be selected via a binary input and the state of one limit comparator.

This results in the following assignment:

Z1 - binary input 1
Z2 - limit comparator 1

The binary function for the binary input 1 and limit comparator 1 have to be configured to “setpoint switching”

Depending on the further configuration, the following diagram applies:

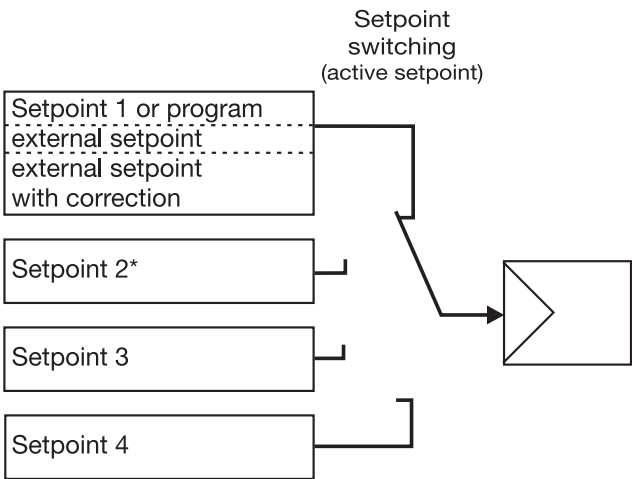

* An exception to this is the configuration for a program controller with external setpoint input, with or without correction. Setpoint 2 is the program setpoint in this case.

Additional functions via the setup program

Several binary functions can be combined through the setup program. In addition, the binary function “Text display” can be implemented. This is used to show a letter combination in the lower display.

8 Configuration

8.7 Display “diSP”

Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

	Symbol	Value/selection	Description
	General		
Upper display	d, SU	(analog selector) controller process value	Displayed value for the upper display ⇒ See “Analog selector” on Page 32.
Lower display	d, SL	(analog selector) controller setpoint	Displayed value for the lower display ⇒ See “Analog selector” on Page 32.
Decimal point	dEcP	0 1 2	no decimal place one decimal place two decimal places If the value that is to be displayed can no longer be represented with the programmed decimal point, then the number of decimal places will be automatically reduced. If, subsequently, the measured value decreases, the number increases to the programmed value of the decimal point.
Brightness	br, b	0...5	(bright) 0 – 5 (dark)
16-segment display	(setup)	switched off Unit current segment current parameter set text	Displayed value for the two-digit 16-segment display
Time-out	(setup)	0... 30 ...255 s	Time period, after which the instrument automatically returns to normal display if no key is pressed.
Level inhibit	(setup)	none configuration level parameter/ configuration level operator/ parameter/ configuration level	The access to the individual levels can be inhibited.
User level (setup program)			
Up to eight parameters from different levels can be shown under User data (operator level) on the instrument and edited. The symbols for these parameters (shown in the lower display) must be assigned by the user himself.			

Factory settings are shown **bold**.

8.8 Timer “tFct”

Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

Time-dependent control actions can be carried out with the help of the timer. The timer signal (timer 1 + 2) shows whether the timer is active. It can be output via the binary outputs or processed internally.


The timers are started or canceled via the binary functions.

⇒ Chapter 8.6 “Binary functions “binF””

The current times for the timers can be viewed at the operator level (process data).

Timer 1 tF1 →

Timer 2 tF2 →

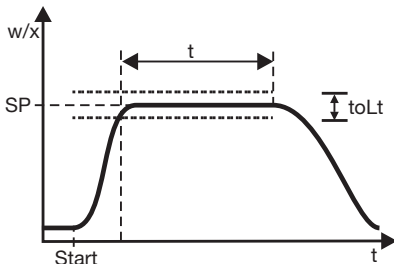Function	Symbol	Value/selection	Description
	tFct	0 no function 1 with the timer running: binary signal=1 (signal is active) 2 with the timer running: binary signal=0 (signal is not active) 3 Tolerance band	Function: “Tolerance band”  Timer is running when the process value has reached a tolerance band around the setpoint.
Timer time	t	0...99:59 (hh:mm)	Time input
Tolerance limit	tol	0 ...999	0=off

Factory settings are shown **bold**.

8 Configuration

8.9 Interfaces “IntF”

Configuration
Analog inputs
Controller
Generator
Limit comparators
Outputs
Binary functions
Display
Timer
Interfaces

The interface parameters for the RS422/485 or Profibus-DP interface have to be configured in order to communicate with PCs, bus systems and peripheral devices.

PROFIBUS-DP PrOF →

	Symbol	Value/selection	Description
Protocol	Prot	0 Motorola 1 Intel 2 Intel integer	
Device address	Addr	0... 128 ...255	Address in data network
Analog marker	AnAP	-1999... 0 ...+9999	Analog value
Binary marker	binP	0 ...255	Binary value

Factory settings are shown **bold**.

MODbus r422 →

	Symbol	Value/selection	Description
Protocol	Prot	0 MODbus 1 MODbus integer	
Baud rate	bdrb	0 9600 bps 1 19200 bps 2 38400 bps	
Data format	dFb	0 8 data bits, 1 stop bit, no parity 1 8 data bits, 1 stop bit, odd parity 2 8 data bits, 1 stop bit, even parity 3 8 data bits, 2 stop bits, no parity	
Device address	Addr	0... 1 ...255	Address in data network
Min. response time	(setup)	0 ...500ms	Minimum time that elapses between the request of a device in the data network and the response of the controller.

Factory settings are shown **bold**.



Interface description B70.3041.2

9 Tuning (optimization)


9.1 Autotuning (self-optimization)

Oscillation method

Autotuning (self-optimization, SO) establishes the optimum controller parameters for a PID or PI controller.

Depending on the controller type, the following controller parameters can be defined: Reset time (r_t), derivative time (d_t), proportional band (P_b), cycle time (C_y), filter time constant (dF)

The controller selects one of two procedures (**a** or **b**), depending on the size of the control deviation:

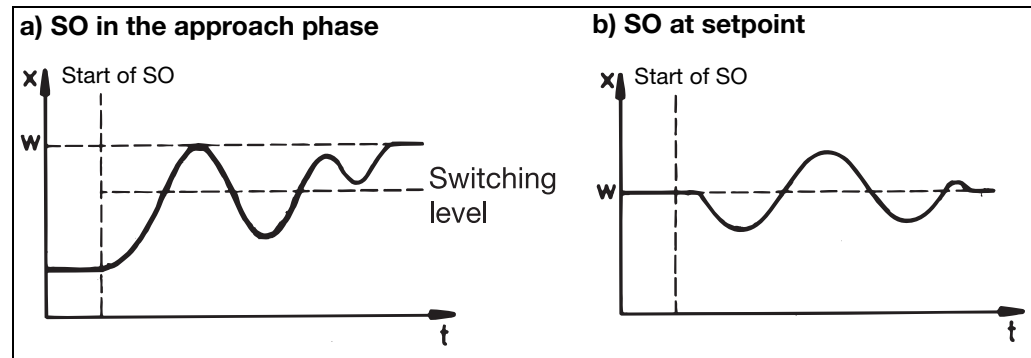

Step response method

This type of optimization involves determining the control parameters through an output step that is applied to the process. First a standby output is produced until the process value is “steady” (constant). Afterwards, an output step (step size), which can be defined by the user, is automatically applied to the process. The resulting response of the process value is used to calculate the control parameters.

Autotuning establishes the optimum control parameters for a PID or PI controller, according to the selected control structure.

Depending on the controller type, the following control parameters can be determined: Reset time (r_t), derivative time (d_t), proportional band (P_b), cycle time (C_y), filter time constant (dF)

Autotuning can be started from any system status, and can be repeated as often as is required.

The controller outputs (continuous, relay, solid-state), the controller standby output and the step size (min. 10%) have to be defined.

Principal applications of the step response method

- Autotuning instantly after “power on”, during the approach phase
Considerable time savings, setting: controller standby output = 0 %.
- The process does not readily permit oscillations (e.g. highly insulated furnaces with small losses, long oscillation period)
- Process value must not exceed setpoint
If the output (with stabilized setpoint) is known, overshoot can be avoided through the following adjustment:
 $\text{standby output} + \text{step size} \leq \text{output in stabilized condition}$

9 Tuning (optimization)




With output type “solid-state”, the cycle time during autotuning is reduced to 8 x the sampling cycle time.

With the “relay” output type, care has to be taken that the process value is not influenced by the cycle time, since otherwise autotuning can not be completed successfully.


Solution: Reduce the cycle time C_y , until the process value is no longer influenced. (Manual mode can be used for the adjustment!)

Start of autotuning after power-on and during the approach phase

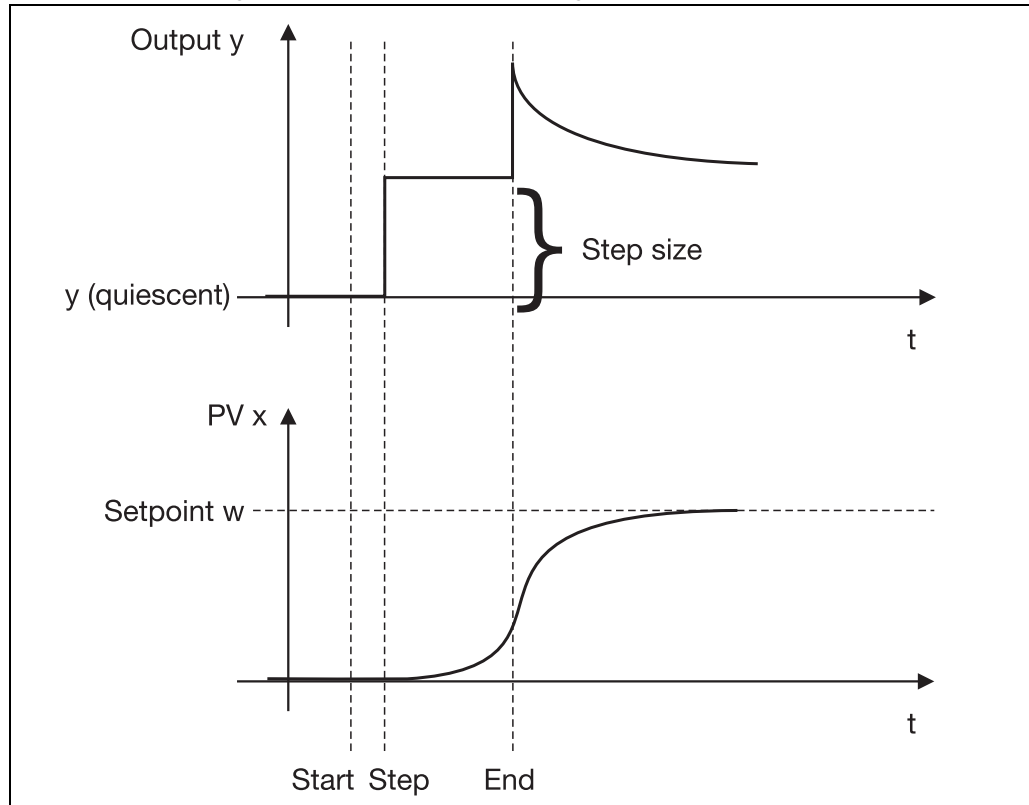

9 Tuning (optimization)

Start of autotuning during operation

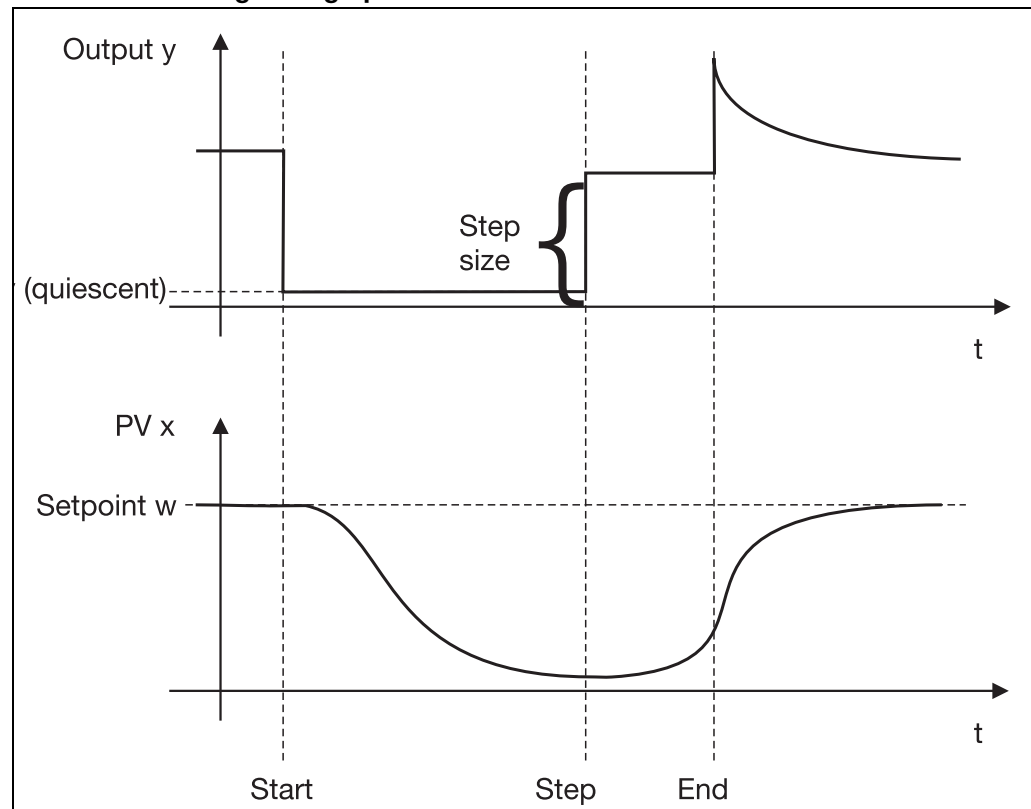

Starting auto-tuning

- * Start with  and  (simultaneously >2sec
“tUnE” is shown, blinking, in the lower display

Autotuning is ended when the display automatically changes over to normal display.

The duration of autotuning depends on the control process.



The controller output types have to be defined for autotuning.

⇒ Chapter 8.2 “Controller “Cntr””

For a program controller, autotuning can only be started in the normal display.

Canceling auto-tuning


- * Cancel with  and  (simultaneously)

9 Tuning (optimization)

9.2 Check of the tuning

The optimum adaptation of the controller to the process can be checked by recording the approach phase with the control loop closed. The diagrams below indicate possible maladjustments and how these can be corrected.

The control response of a third-order control loop for a PID controller is shown as an example. However, the procedure for adjusting the controller parameters can also be applied to other control loops.

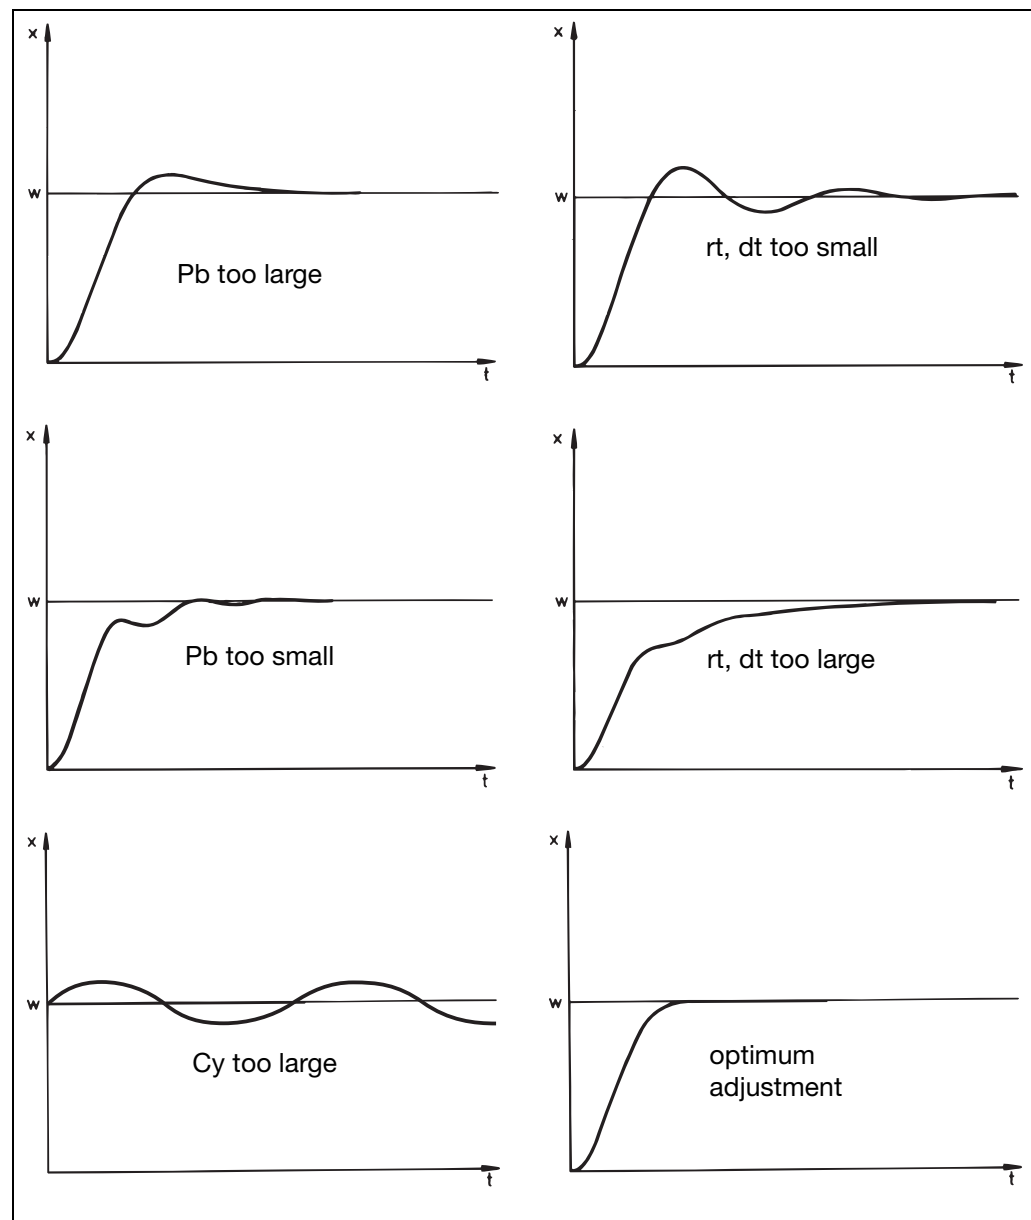

10.1 Math and logic module

The setup program can be used to implement two mathematical calculations or logical combinations of various signals and process variables from the controller in a formula.

With math formulae, the calculated result is presented through the two signals “Math 1” and “Math 2” in the analog section. With logic formulae, the result of the logical combination is presented through the signals “Math 1” and “Math 2” of the configuration for binary functions.

Chapter 8.6 “Binary functions “binF””

Entering formulae

- The string of signs in the formula consists of ASCII characters, and can have a maximum length of 60 characters.
- The formula can only be entered in the setup program.
- Formulae can be freely entered according to normal mathematical rules.
- Spaces can be inserted at will into the formula character string. But spaces are not permitted within function labels, variable names and constants.

10.2 Difference, humidity and ratio controllers

If the extra code is activated, these three types of controller can be selected through the setup program.

⇒ *Setup/Only setup/Math/Logic*

The process variables for the two analog inputs have a fixed definition.


Ratio control

The control is always based on analog input 1 (E1).

The math module forms the ratio of the measurements from E1 and E2, and produces the setpoint for the controller. The ratio of the measurements can be called up through the functions “Math 1” or Math 2” and displayed.

The required ratio E1/E2 is programmed as the setpoint (ratio setpoint) in the setpoint definition.

Ratio: E1/E2

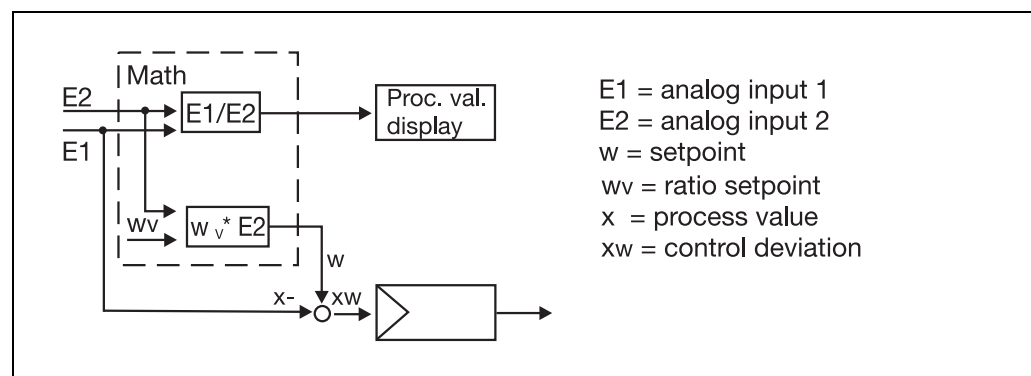

10 Extra codes

Humidity control

The humidity controller receives the process value from a psychrometric humidity probe, through the mathematical combination of wet bulb and dry bulb temperatures.

RELF (E1, E2)

E1 - Dry bulb temperature, via analog input 1

E2 - Wet bulb temperature, via analog input 2

Difference control

The difference between the two input signals is taken as the process value.

Difference: E1-E2

E1 - Analog input 1

E2 - Analog input 2

11 Retrofitting of modules

The following steps are necessary for retrofitting modules:

Safety notes



Retrofitting must only be carried out by qualified professional persons.



For safety reasons, care must be taken that, after making the changes, the back panel and the fixing screws are correctly replaced and fitted.



The modules can be damaged by electrostatic discharge. So avoid electrostatic charge during fitting and removal. Carry out retrofitting on a workbench that is earthed.


Identifying the module

* Identify the module by the Sales. No. glued onto the packaging

Modules	Code	Sales No.
Analog input 2	1	70/00442785
1 relay (changeover contact)	2	70/00442786
2 relays (make contact)	3	70/00442787
1 analog output	4	70/00442788
2 binary inputs	5	70/00442789
1 solid-state relay 230V/1 A	6	70/00442790
RS422/485 interface	7	70/00442782
PROFIBUS-DP	8	70/00442791

Removing the controller module

* Press together the knurled surfaces on the front panel (top and bottom, or left and right for landscape format) and pull out the controller module.

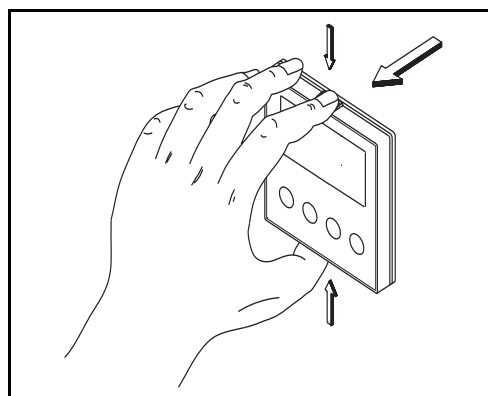


11 Retrofitting of modules

Retrofitting of modules


- * Select the slot for the option
(Observe the restrictions for Type 703041! (see connection diagram))

Type 703041

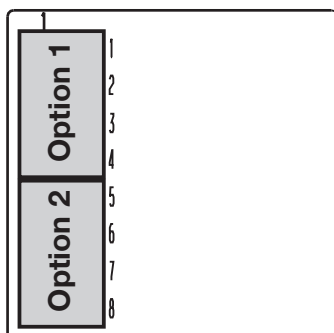


On Type 703041, relays can only be retrofitted in option slot 1!

Type 703042/43/44

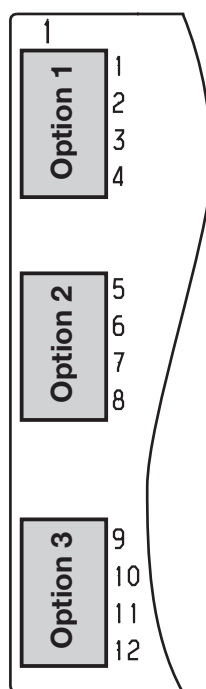

- * Push the module into the slot until the plug connector snaps into place

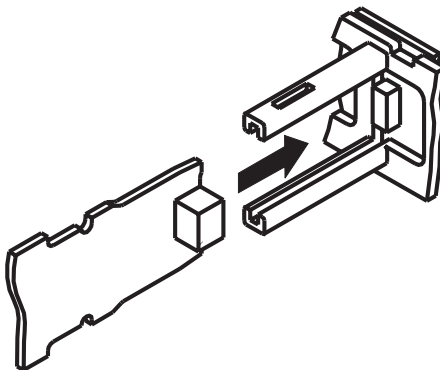

- * Push the module into the housing until the lugs snap into their slots

12.1 Technical data

Thermocouple input

Designation	Measuring range	Measuring accuracy	Ambient temperature error
Fe-Con L	-200 to + 900 °C	≤0.25%	100 ppm / °C
Fe-Con J EN 60 584	-200 to +1200 °C	≤0.25%	100 ppm / °C
Cu-Con U	-200 to + 600 °C	≤0.25%	100 ppm / °C
Cu-Con T EN 60 584	-200 to + 400 °C	≤0.25%	100 ppm / °C
NiCr-Ni K EN 60 584	-200 to +1372 °C	≤0.25%	100 ppm / °C
NiCr-Con E EN 60 584	-200 to +1000 °C	≤0.25%	100 ppm / °C
NiCrSi-NiSi N EN 60 584	-100 to +1300 °C	≤0.25%	100 ppm / °C
Pt10Rh-Pt S EN 60 584	0 to 1768 °C	≤0.25%	100 ppm / °C
Pt13Rh-Pt R EN 60 584	0 to 1768 °C	≤0.25%	100 ppm / °C
Pt30Rh-Pt6Rh B EN 60 584	0 to 1820 °C	≤0.25% ¹	100 ppm / °C
W5Re-W26Re C	0 to 2320 °C	≤0.25%	100 ppm / °C
W3Re-W25Re D	0 to 2495 °C	≤0.25%	100 ppm / °C
W3Re-W26Re	0 to 2400 °C	≤0.25%	100 ppm / °C
Cold junction	Pt100, internal		

1. in the range 300 to 1820 °C

Input for resistance thermometer

Designation	Connection	Measuring range	Measuring accuracy		Ambient temperature error
			3-/4-wire	2-wire	
Pt100 EN 60 751	2-wire / 3-wire / 4-wire	-200 to +850 °C	≤0.05%	≤0.4%	50 ppm / °C
Pt500 EN 60 751	2-wire / 3-wire / 4-wire	-200 to +850 °C	≤0.2%	≤0.4%	100 ppm / °C
Pt1000 EN 60 751	2-wire / 3-wire / 4-wire	-200 to +850 °C	≤0.1%	≤0.2%	50 ppm / °C
KTY11-6	2-wire	-50 to +150 °C	≤1.0%	≤2.0%	50 ppm / °C
Sensor lead resistance	max. 30 Ω per lead for 3-wire or 4-wire circuit				
Measuring current	approx. 250 μA				
Lead compensation	Not required for 3-wire or 4-wire circuit. With a 2-wire circuit, the lead resistance can be compensated in software by a correction of the process value.				

Input for standard signals

Designation	Measuring range	Measuring accuracy	Ambient temperature error
Voltage	0(2) — 10V 0 — 1V input resistance $R_{IN} > 100k\Omega$	≤0.05% ≤0.05%	100 ppm / °C 100 ppm / °C
Current	0(4) — 20mA, voltage drop ≤ 1.5V	≤0.05%	100 ppm / °C
Heating current	0 — 50mA AC	≤1%	100 ppm / °C
Resistance transmitter	min. 100 Ω, max. 4kΩ	≤0.5%	100 ppm / °C

Binary inputs

Floating contacts	
-------------------	--

■ Standard version

12 Appendix

Measuring circuit monitoring

In the event of a fault, the outputs move to a defined (configurable) status.

Sensor	Overrange / underrange	Probe or lead short-circuit	Probe or lead break
Thermocouple	•	-	•
Resistance thermometer	•	•	•
Voltage 2 — 10V 0 — 10V	• •	• -	• -
Current 4 — 20mA 0 — 20mA	• •	• -	• -

• = recognized - = not recognized

Outputs

Relay (changeover) for type 703042/43/44 contact rating contact life	3A at 230V AC resistive load 350,000 operations at rated load / 750,000 operations at 1A
Relay (changeover) (option) contact rating contact life	8A at 230V AC resistive load 100,000 operations at rated load / 350,000 operations at 3A
Relay (make) for type 703041 contact rating contact life	3A at 230V AC resistive load 150,000 operations at rated load / 350,000 at 1A
Relay (changeover) (option) contact rating contact life	3A at 230VAC resistive load 350,000 operations at rated load / 900,000 operations at 1A
Logic output	0/12V / 30mA max. (sum of all output currents) or 0/18V / 25mA max. (sum of all output currents)
Solid-state relay (option) contact rating protection circuitry	1A at 230V varistor
Voltage (option) output signals load resistance	0 — 10V / 2 — 10V $R_{load} \geq 500\Omega$
Current (option) output signals load resistance	0 — 20mA / 4 — 20mA $R_{load} \leq 500\Omega$
Supply voltage for 2-wire transmitter voltage	electrically isolated, not stabilized 30V DC with no load 23V at 30mA load

Controller

Controller type	2-state controller, 3-state controller, modulating controller, continuous controller
Controller structures	P/PD/PI/PID
A/D converter	dynamic resolution up to 16-bit
Sampling cycle time	250msec
	50msec, 90msec, 150msec, 250msec

Electrical data

Supply voltage (switchmode PSU)	110 — 240V AC -15/+10%, 48 — 63Hz 20 — 53V AC/DC, 48 — 63Hz
Electrical safety	to EN 61 010, Part 1 Overvoltage category II, pollution degree 2 for type 703041 with power supply AC/DC connect to SELV and PELV only
Power consumption	max. 7VA
Data backup	EEPROM
Electrical connection	at the back, via screw terminals, conductor cross-section up to 1.5mm ² with core ferrules (length: 10mm)
Electromagnetic compatibility interference emission interference immunity	EN 61 326 Class B to industrial requirements

■ Standard version

Housing

Housing type	plastic housing for panel mounting to DIN 43 700
Depth behind panel	90 mm
Ambient/storage temperature range	0 to 55°C / -40 to +70°C
Climatic conditions	rel. humidity ≤90% annual mean, no condensation
Operating position	horizontal
Enclosure protection	to EN 60 529, front IP65 / back IP20
Weight (fully fitted)	JUMO dTRON316: approx. 220g JUMO dTRON308: approx. 380g JUMO dTRON304: approx. 490g

Interface

MODbus

Interface type	RS422/485
Protocol	Modbus, Modbus-integer
Baud rate	9600, 19200, 38400
Device address	0 — 255
Max. number of nodes	32

Profibus

Device address	0 — 255
----------------	---------

12 Appendix

12.2 Alarm messages

Display	Cause	Fault removal test/repair/replace
- 1999 (blinking!)	Underrange for the value being displayed.	Is the medium being measured within the range (too hot? too cold?) Check probe for short-circuit and probe break Check the probe connection and the terminals. Check the cable.
9999 (blinking!)	Overrange for the value being displayed.	
all displays on; lower 7-segment display is blinking	Watchdog or power-on trigger initialization (reset).	Replace the controller if the initialization continues for more than 5sec.
PrOF	PROFIBUS error	Can be suppressed by setting the PROFIBUS address to "0".
OPt	Hardware configuration error	Check which option boards are installed in the slots.

Overrange / underrange covers the following events:

- Probe break or short-circuit
- Measurement is outside the controllable range for the probe that is connected
- Display overflow

A

Access code 31
Accessories 8
Acknowledgement 45
Analog input 33
Analog marker 54
Analog selector 32
Autotuning (self-optimization) 38, 55

B

Baud rate 54
Binary functions 49
Binary marker 54
Binary output 47
Brightness 52

C

Commissioning 2
Connection diagrams 15
Control action 37, 53–54
Control contacts 40
Controller 37
Controller module, removing 12
Controller standby output 38
Controller type 37, 47, 50, 53

D

Data format 54
Decimal point 52
Delay time 40
Device address 54
Difference control 60
Dimensions 9–10
Display 52
Display end 34
Displays 19

E

Electrical isolation 14
End value 48
Entering formulae 59
Entering programs 24
Entering times 21
Entering values 21

F

Filter time constant 34
Fine tuning 35
 customized 34
Fitting 11
Front panel, care of 11

H

Heater current monitoring 34
Hot-channel controller 41
Humidity control 60

I

Installation notes 13
Interface 54

L

Level concept 20
Level inhibit 20, 52
Limit comparator 42
Limit comparator functions 42
Limit value 43
Linearization 33

M

Manual mode 48
Manual mode, inhibiting 37
Manual output 37
Measurement offset 34
Module
 identification 61
 retrofitting 61
Mounting site 9

O

Outputs 46
 numbering 46

P

Parameter level 29
Parameter set switching 50
Password 31
PC interface 8
Process data 27
Program data 28
Program editor 8
Program profile, shifting 26
Program start 40
Protocol 54
Pulse time 45

R

Ramp slope 40
Range output 37
Ratio control 59

S

Safety notes 61
Sampling cycle time 35
Scope of delivery 8
Sensor type 33
Setpoint 27
 external 38
Setpoint limits 37
Setpoint switching 50
Setup program 8
Side-by-side mounting 11
Signal type 48
Step response method 55
Step size 38
Supply frequency 35
Switching action 49
Switching differential 43
Switch-on delay 44

T

Text display 50
Time-out 52
Tolerance band 40, 53
Tuning (optimization) 58
Type designation 7

U

Unit 35, 39
User data 28

W

Warranty 2

Z

Zero point 48

Overview of the configuration level

InP Page 33	InP 1 InP2	SEnS L, n OFFS SCL SCH dF FtS FtE HEAt		Sensor type Linearization Measurement offset Display start Display end Filter time constant Fine tuning start value Fine tuning end value Heater current monitoring
	InP 12	Un, t CYcl		Temperature unit Sampling cycle time
Cntr Page 37		CtYP CRct InHA HARnd rOut SPL SPH CP- ESP FEEd tYPt InHt OEt 1 OEt2 SOUt StS 1		Controller type Control action Inhibit manual mode Manual output Range output Setpoint low Setpoint high Controller process value External setpoint Output feedback Method of tuning Inhibit tuning Output of tuning 1 Output of tuning 2 Controller standby output Step size
	Pro Page 39	Fncf Un, t rASL tolP		Function Unit of slope Ramp slope Tolerance band
LC Page 42	LC 1 LC2 LC3 LC4	Fncf AL HYSb ActRA tOn tOFF ActnL tPUL LCPr LCSP		Function Limit value Switching differential Action/range response Switch-on delay Switch-off delay Acknowledgement Pulse time Limit comparator PV Limit comparator SP
	OutP Page 46	Out5	Fncf Si, Sn rOut OPnt End	Analog output 5 Function Type of signal Range output Zero point End value
		...		...
		Out7 Out 1		Analog output 7 Binary output 1
		...		...
		Out8		Binary output 10
b, nF Page 49		b, n 1 ...		Binary input 1 ...
		b, n8 LC 1 ...		Binary input 6 Limit comparator 1 ...
		LC4 tF 1 tF2 Lo 1 Lo2 CC 1 ...		Limit comparator 4 Timer 1 Timer 2 Logic 1 Logic 2 Control contact 1 ...
		CC4 tolS PrES		Control contact 4 Tolerance limit signal Program end signal
di, SP Page 52		di, SU di, SL dEcP br, 6		Upper display Lower display Decimal point Brightness
	tFct Page 53	tF 1 tF2	Fncf t tolL	Function Timer time Tolerance limit
InEF Page 54	ProF	Prot Adr		Protocol Device address
	r422	Prot bdrb dFt Adr		Protocol Baud rate Data format Device address



JUMO GmbH & Co. KG

Street address:
Moltkestraße 13 - 31
36039 Fulda, Germany
Delivery address:
Mackenrodtstraße 14
36039 Fulda, Germany
Postal address:
36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
e-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow, Essex CM20 2TT, UK
Phone: +44 1279 635533
Fax: +44 1279 635262
e-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO PROCESS CONTROL INC.

885 Fox Chase, Suite 103
Coatesville, PA 19320, USA
Phone: 610-380-8002
1-800-554-JUMO
Fax: 610-380-8009
e-mail: info@JumoUSA.com
Internet: www.JumoUSA.com