


**DX-200/215 Accessory and I/O Configuration Reference Guide (Website)**


**STANDARD ACCESSORIES/SPARE PARTS**




SH-300  
Syringe Holder




7045-0120  
Air Line Holder



7045-9020  
Foot Switch




7045-0080  
Wire Bracket Holder




1700-0014  
Power Adapter



FTKIT  
Air Hose Fitting

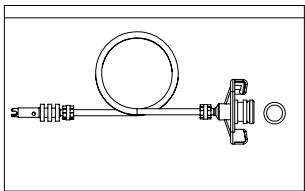

71003RHB  
700 10cc Receiver head Assembly



DXSAMPLENEEDLE  
TE/TT Sample Needles


**OPTIONAL ACCESSORIES**



881-000-000  
Inline Filter (Optional)



TSD800-6  
Air Filter (Optional)

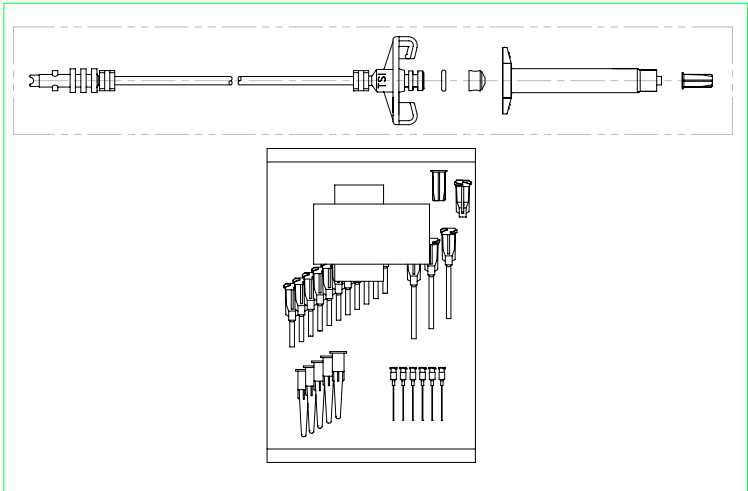

700KIT  
Receiver Head Assembly  
And Needle Kit (Optional)




**Spare Parts/Repair Parts**

| Part Number | Description               |
|-------------|---------------------------|
| TSD600-39   | Pressure Gauge, 0-100 psi |
| TSD600-40   | Pressure Gauge, 0-15 psi  |

|              |                                            |
|--------------|--------------------------------------------|
| TSD500-48    | Regulator, Air 0 - 15 psi                  |
| TSD600-41    | Vacuum Gauge, 0 - 15 PSI/1-1 Bar           |
| 2900-0013    | LCD, 16x2 with Back Light                  |
| 7045-9010    | PCBA, DX300                                |
| INTFKIT      | Internal Fitting/Tubing Kit                |
| TSD500-30    | Regulator, Air 0 - 100 psi                 |
| TSD210-3     | Valve, Needle                              |
| TSD201-22    | Check valve                                |
| 9000-000-008 | Vacuum Venturi                             |
| TSD600-26    | Pressure Gauge                             |
| 535          | Coupler, Panel Mt. Quick Disc. Assy. Black |
| TSD1121-22   | Knob, Small                                |
| TSD1121-23   | Knob, Large                                |

## I/O Configuration and End of Cycle Switch

Upon completion of a dispense cycle, an open collector circuit closes and remains closed until the next dispense cycle. This circuit can be used to signal back to a host computer, start another device in sequence, or drive any other operations that need to be tied to the completion of the dispense cycle. Upon closure, (end of dispense cycle), power from an external source is allowed to pass through the circuit to operate a 5 to 24 VDC load. Power consumption must not exceed 250 mA. The load could be a relay, solenoid, counter, LED, or any device that will operate within a 5 to 24 VDC range and a maximum of 250 mA.

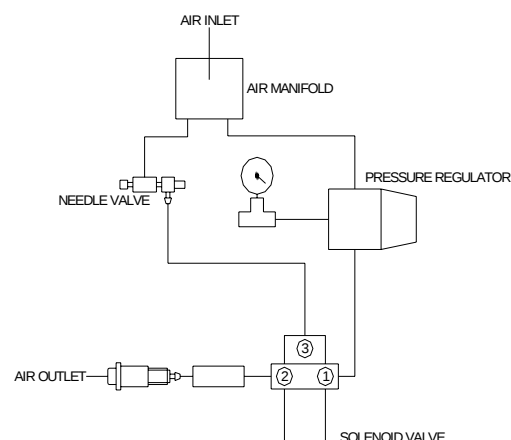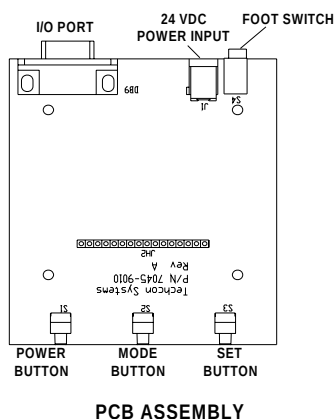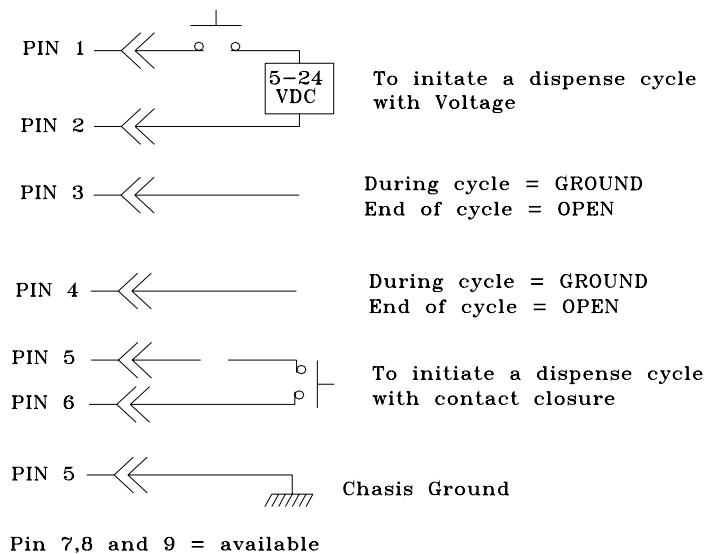

PNEUMATIC DIAGRAM

# Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

[OK International:](#)

[7045-9010](#) [9000-000-008](#) [TSD600-39](#) [TSD600-40](#) [TSD600-41](#)